



**Florida Municipal Power Agency**

**REQUEST FOR PROPOSALS  
FOR  
TCEC CT EXHAUST SEAL REPLACEMENT**

Florida Municipal Power Agency  
8553 Commodity Circle  
Orlando, Florida 32819-9002  
(407) 355-7767 Fax (407) 355-5796

# REQUEST FOR PROPOSALS

(This is not an order)

R  
E  
T  
U  
R  
N  
TO: 8553 Commodity Circle  
Orlando, Florida 32819  
Attn: Sharon Samuels

RFP FMPA 2025-209

Date Issued: June 26, 2025

Telephone: (407) 355-7767

SEALED PROPOSALS MUST PHYSICALLY BE IN THE FLORIDA MUNICIPAL POWER AGENCY OFFICE PRIOR TO PROPOSAL OPENING AT **2:00 P.M. ON JULY 31, 2025**, WHICH WILL BE IN THE FMPA FIRST FLOOR CONFERENCE ROOM LOCATED IN THE FMPA BUILDING AT 8553 COMMODITY CIRCLE, ORLANDO, FLORIDA 32819.

- Proposals shall be submitted on the forms provided and must be manually signed.
- Proposals shall be sealed in an envelope with the proposal number, opening date, and time clearly indicated.
- Proposals received after the opening date and time may be rejected and returned unopened.
- The attached Request for Proposals shall become part of any purchase order resulting from this Request for Proposal.

---

## DESCRIPTION

---

**June 2025**

**Florida Municipal Power Agency  
Request for Proposals for  
TCEC CT Exhaust Seal Replacement**

See attached Request for Proposals, General Conditions, Specifications, and Proposal Forms for detailed description.

---

It is the intent and purpose of the Florida Municipal Power Agency that this Request for Proposal promotes competitive bidding. It shall be the proposer's responsibility to advise if any language, requirements, etc. or any combination thereof, inadvertently restricts or limits the requirements stated in this Request for Proposal to a single source. Such notification must be submitted in writing and must be received by not later than ten (10) days prior to the proposal opening date.

## **ADVERTISEMENT**

Proposal For

**June 2025**

### **FLORIDA MUNICIPAL POWER AGENCY REQUEST FOR PROPOSALS FOR TCEC CT EXHAUST SEAL REPLACEMENT**

#### **REQUEST FOR PROPOSALS FMPA 2025-209**

Sealed proposals will be received by the Florida Municipal Power Agency (FMPA), 8553 Commodity Circle, Orlando, Florida 32819, until **2:00 P.M. on JULY 31, 2025**, when at that time Proposals will be opened publicly by a FMPA representative.

The proposal is for the Treasure Coast Energy Center (TCEC) CT Exhaust Seal Replacement as more fully described in the Scope of Work section of the Request for Proposals package.

RFP packages for this project may be obtained from FMPA at the above address, by telephone (407) 355-7767, via e-mail request to [bidinfo@fmpa.com](mailto:bidinfo@fmpa.com), or via Internet download at [www.fmpa.com](http://www.fmpa.com).

No proposal may be altered, withdrawn, or resubmitted after the scheduled closing time for receipt of proposals, except as otherwise permitted in the RFP package. Proposals received after the day and time stated above will not be considered.

Proposals will be accepted for TCEC CT Exhaust Seal Replacement from companies who have established, through demonstrated expertise and experience, that they are qualified to provide the services as specified.

The Florida Municipal Power Agency reserves the right to reject any and all proposals in total or in part and to waive defects in proposals.

Jacob Williams  
General Manager and CEO  
Florida Municipal Power Agency

**FLORIDA MUNICIPAL POWER AGENCY**  
**Request for Proposals for**  
**TCEC CT Exhaust Seal Replacement**

**1. FMPA Description**

Formed by Florida's municipal electric utilities in February 1978, the Florida Municipal Power Agency (FMPA or the Agency) is a non-profit, governmental, wholesale electric utilities company created to serve the needs of municipal electric utilities in Florida. All 33 municipal systems in the State are FMPA members who participate at varying levels in Agency activities.

**2. Introduction - General Description of Services Sought**

Florida Municipal Power Agency, (FMPA/Owner) invites proposals to Treasure Coast Energy Center (TCEC) CT Exhaust Seal Replacement

Based on the relevant previous experience, your firm has been selected to receive this RFP and is invited to submit a proposal to supply the work described herein.

The scope includes details for the work at the Treasure Coast Energy Center, 4545 Energy Lane, Fort Pierce, FL 34981.

**3. Overview**

Upon selection of the awarded Contractor(s), FMPA will enter into a Master Agreement specifying terms and conditions. FMPA will issue a Purchase Order with project-specific technical specifications.

The submission of a proposal implies a general acceptance on the part of the bidder of the terms of this RFP, form of contract, and especially of those parts establishing warranties and guarantees.

**4. Purchasing Services**

Subsequent to the award, FMPA shall issue Purchase Orders to the Contractor(s) awarded the agreement pursuant to this Request for Proposal.

**5. Indemnity**

After notification of award, the successful bidder shall indemnify and save harmless FMPA from and against all claims, suits, actions, damages, or causes or action arising during the terms of the resulting agreement for any personal injury, loss of life, or damage to property sustained by reason of a result of the performance of the services or delivery of goods for which the resulting agreement was entered into, or its agents, employees, invitees, and all other persons, and for and against any orders, judgements, or decrees, which may be entered thereto, and from and against all costs, attorney's fees, expenses and liabilities incurred in or by reason the defense of any such claim, suit or action, and the investigation therefore.

Nothing in the award, resulting agreement, contract or Purchase Order shall be deemed to affect the rights, privileges and immunities of FMPA as set forth in Florida Statute 768.28.

The successful bidder(s) covenants and agrees to indemnify and save harmless FMPA and to defend from all cost, expenses, damages, attorney's fees, injury or loss to which FMPA may be subjected by any person, firm, corporation, or organization by reason of any wrongdoing, misconduct, want, or need of care or skill, negligence or default or breach of contract, guaranty, or warranty, by the successful bidder(s), his employees, his agents or assigns.

## **6. Notice to Proposers**

Sealed proposal packages will be received until **2:00 P.M. ON JULY 31, 2025** ("Proposal Due Date") at the offices of Florida Municipal Power Agency. Each proposer is required to submit a Proposer Information Form (included in this RFP package), other forms included in this package as appropriate, and all other information necessary to allow a complete evaluation of the proposal. Registered proposers will be notified through the issue of RFP addenda of any change in the Proposal Due Date or other necessary revision to information contained in this RFP. FMPA reserves the right to reject all proposals received after the Proposal Due Date.

One (1) original hard copy (including original signatures) and one (1) electronic version (*flash drives or CD are acceptable; do not email this version*) of the proposal response package should be sealed and delivered to the following address:

Ms. Sharon Samuels  
Florida Municipal Power Agency  
8553 Commodity Circle  
Orlando, Florida 32819

Clearly legible on the outside of the sealed envelope shall be "**TCEC CT Exhaust Seal Replacement**, FMPA RFP 2025-209".

## **7. Duration of Offer**

Proposals submitted in response to this RFP are irrevocable 120 days, unless withdrawn or modified as provided in Section 16 below. This period may be extended at FMPA's request only by written agreement of the proposer. The content of this RFP and the proposal of the successful proposer will be included by reference in any resulting contract.

## **8. Right of Rejection**

This RFP is not an offer establishing any contractual rights. This solicitation is solely an invitation to submit proposals.

FMPA reserves the right to:

- Reject any and all proposals received in response to this RFP;
- Waive any requirement in this RFP;
- Waive any irregularities, regardless of the severity
- Not disclose the reason for rejecting a proposal;
- Not select the proposal with the lowest price; and

- Seek and reflect clarifications to proposals.
- Negotiate with the selected bidder in the event that the price exceeds available funds.
- If performance issues with Awarded Bidder; FMPA moves to next best evaluated bidder to complete work.
- Award to more than one bidder.
- Select the proposal that is in the best interest of FMPA

## 9. **Proposal Contents**

The submission of a proposal implies a general acceptance on the part of the bidder of the terms of this form of contract, and especially of those parts establishing warranties and guarantees

The proposal should include a description of the firm's capabilities and experience with providing the requested services, including a description of any special qualifications which are indicative of working familiarity with similar projects.

The following information must be included:

1. Demonstration of first-hand experience in providing similar services to those requested in this RFP;
2. Description of the resources available, including staffing levels, qualifications of key personnel who will be performing the work, equipment and capabilities; and locations of offices;
3. Proof of Insurance coverage;
4. Proof of licenses and certifications, if applicable;
5. Safety protocols;
6. A schedule for the work, including the range of start dates to which your firm is prepared to commit to and anticipated completion dates.
7. General description of how projects will be staffed, managed, and completed, including project management and invoicing;
8. Identification of any work or services that may be provided by a subcontractor. Bidder shall provide information similar to that above concerning subcontractor's equipment, personnel, and qualifications; including a minimum of two (2) reference projects with similar scope of work. If after award of the RFP, the successful bidder(s) desire to utilize a subcontractor other than listed in the bid, the bidder must obtain approval of the subcontractor from FMPA.

Denial of a subcontractor by FMPA will NOT absolve the bidder from getting the work done for the contracted price;

9. List of at least two (2) references for which similar projects were conducted, including name, company, title, phone number and email address, and a brief description of the project including the start and end dates;
10. List any past CT Exhaust Seal Replacement experience for which your firm conducted work for FMPA, as well as others. Provide a brief description of the project including the start and end dates and point of contact.
11. The name and contact information of the person in Bidder's firm who would be the official contact person for any contractual relationship.
12. Fully executed forms as provided in Appendix C - Bid Forms.

## **10. RFP Schedule**

FMPA's timetable for this RFP process is shown below. Note that the dates shown are only estimates and may be modified at any time by FMPA.

Public Notice/Distribution of RFP	June 26, 2025
Intent to Bid & Questions Deadline	July 14, 2025
Sealed Proposals Due Date	July 31, 2025
Notice of Award ( <i>Estimated date</i> )	August 29, 2025

## **11. Evaluation**

The proposals will be evaluated based on information provided by each proposer by the Proposal Due Date. No additional data will be considered after the Proposal Due Date, except for clarifications requested by FMPA. FMPA will evaluate the proposals in terms of cost and other quantitative and non-quantitative factors.

Selection and rejection of proposals and notification of proposers at all stages will remain entirely with FMPA's discretion. FMPA intends to notify proposers not selected under this solicitation within a reasonable amount of time.

The evaluation criteria will include a variety of considerations, which may include:

- a. Experience with similar projects and references
- b. Past Performance
- c. Schedule, availability and lead time
- d. Warranty and support offerings
- e. Safety and quality plans
- f. Pricing

Proposals must include sufficient information supporting pricing to permit FMPA to evaluate all proposals, which may include different pricing elements, different products, and different methods and assumptions, on an equal basis. If sufficient information supporting pricing is not provided, FMPA may have to make pricing assumptions in evaluating proposals to achieve, in FMPA's judgment, an equal evaluation of all proposals. Those pricing assumptions made by FMPA are at FMPA's discretion and based upon FMPA's subjective evaluations of the proposals received, and may or may not be shared with proposers.

Any proposer that proposes an alternative to any FMPA specified technical or business terms, or specified-products, must clearly identify such alternatives and provide supporting

information for why the proposer believes its alternative(s) are superior to FMPA's specifications. FMPA is not obliged to accept any proposer's alternatives.

**12. Performance Bond/Surety**

Neither a bid nor a performance bond or surety is required pursuant to this RFP.

**13. Budgetary Constraints**

The Florida Municipal Power Agency reserve the right to reduce or increase the quantity, retract any item from the bid, or upon notification, terminate entire agreement without any obligations or penalty based upon availability of funds.

**14. Interpretations and Addenda**

All questions regarding interpretation of this RFP, technical or otherwise, must be submitted in writing to the following:

By E Mail: *sharon.samuels@fmpa.com*

By Fax: Ms. Sharon Samuels  
(407) 355 - 5796

By Mail or Courier: Ms. Sharon Samuels  
Florida Municipal Power Agency  
8553 Commodity Circle  
Orlando, Florida 32819

Only written responses provided by FMPA to proposers' questions will be considered official. A verbal response by FMPA will not be considered an official response. Written responses to questions and requests for interpretations will be provided to all potential proposers. Copies of all addenda issued in connection with this RFP may be sent to all potential proposers.

**Questions and Answers**

Questions will be accepted through the deadline noted in the schedule from potential bidders who notify us that they will be a bidder. We reserve the right not to answer other questions.

Bidders are to submit questions via email to [sharon.samuels@fmpa.com](mailto:sharon.samuels@fmpa.com). Questions will be answered and all answers will be distributed to all bidders.

Upon receipt of this Request for Proposals ("RFP"), potential Contractors shall immediately cease direct contact with individual FMPA or Generating Facility employees regarding the subject matter of this RFP.

Notwithstanding the previous sentence, If FMPA has questions about a particular proposal that, in the judgment of FMPA, would be appropriate to ask a proposer to clarify, explain, or otherwise provide supporting information for its proposal, FMPA reserves the right to pose such questions to proposers. In the event FMPA does this, it will provide a notice to all proposers of the proposers that received questions from FMPA, and the general nature of the questions, but FMPA will not provide information that it believes will give an proposer any competitive advantage over another. FMPA will evaluate answers received from proposers, but will not accept modifications to proposals after the Proposal Due Date.



**15. Errors, Modifications or Withdrawal of Proposal**

Each proposer should carefully review the information provided in the RFP prior to submitting a response. The RFP contains instructions which must be followed by all proposers. Modifications to proposals already received by FMPA will only be accepted prior to the Proposal Due Date. Proposals may be withdrawn by giving written notice to FMPA prior to the Proposal Due Date.

**16. Proprietary Confidential Business Information**

All proposals shall become property of FMPA. FMPA will not disclose to third parties any information that is clearly labeled "Proprietary Confidential Business Information" in a proposal unless, in the opinion of counsel for FMPA, such disclosures are required by law or by order of the court or government agency having appropriate jurisdiction. Each page of Proprietary Confidential Business Information must be clearly labeled "PROPRIETARY CONFIDENTIAL BUSINESS INFORMATION" at the top of the page. FMPA reserves the right to disclose information contained in proposals to its consultant(s) for the sole purpose of assisting in the proposal evaluation process. FMPA will require the consultant(s) to maintain the confidentiality of the document.

**17. Default and Damages Provisions**

FMPA will negotiate standard terms and conditions for default and damages with the awarded Contractor(s). All proposers are requested to include proposed default and damages provisions in their proposals.

**18. Public Entity Crimes Statement**

Pursuant to Section 287.133(2)(a), FLORIDA STATUTES, all proposers should be aware of the following:

"A person or affiliate who has been placed on the convicted vendor list following a conviction for a public entity crime may not submit a bid on a contract to provide any goods or services to a public entity, may not submit a bid on a contract with a public entity for the construction or repair of a public building or public work, may not submit bids on leases of real property to a public entity, may not be awarded or perform work as a contractor, supplier, subcontractor, or consultant under a contract with any public entity, and may not transact business with any public entity in excess of the threshold amount provided in Section 287.017, for CATEGORY TWO for a period of 36 months from the date of being placed on the convicted vendor list."

**19. Collusion**

By offering a submission pursuant to this RFP, the proposer certifies the proposer has not divulged, discussed, or compared his proposal with other proposers and has not colluded with any other proposer or parties to this proposal whatsoever. Also, the proposer certifies, and in the case of a joint proposal, each party thereto certifies, as to his own organization, that in connection with this proposal:

1. Any prices and/or cost data submitted have been arrived at independently, without consultation, communication, or agreement for the purpose of restricting competition, as to any matter relating to such prices and or cost data, with any other proposer or with any competitor
2. Any prices and/or cost data quoted for this proposal have not knowingly been disclosed by the proposer and will not knowingly be disclosed by the proposer prior to the scheduled opening directly or indirectly to any other proposer or to any competitor

3. No attempt has been made or will be made by the proposer to induce any other person or firm to submit or not to submit a proposal for the purpose of restricting competition
4. The only person or persons interested in this proposal, principal or principals is/are named therein and that no person other than therein mentioned has any interest in this proposal or in the contract to be entered into and
5. No person or agency has been employed or retained to solicit or secure this contract upon an agreement or understanding for a commission, percentage, brokerage, or contingent fee excepting bona fide employees or established commercial agencies maintained by the Proposer for the purpose of doing business.

## **20. Drug Free Workplace**

A Drug-Free Workplace Statement must be completed, signed, and returned prior to award of proposal. This form will be used whenever two or more proposals that are identical with respect to price, quality, delivery, and service are received; a proposal received from a business that certifies that it has implemented a drug-free workplace program shall be given preference in the award process.

## **21. Subcontracted Services**

Proposal should indicate which, if any, of the services to be provided would be subcontracted by the proposer to independent contractors. If work is intended to be subcontracted, BID SUBMITTAL MUST BE ACCOMPANIED BY BACKGROUND MATERIALS AND REFERENCES FOR PROPOSED SUBCONTRACTOR(S) - NO EXCEPTIONS. In addition, Contractor(s) must notify FMPA any time work will include subcontracted services. FMPA maintains the right to reject the proposed subcontractor for specific project work.

## **22. Definitions**

The words and terms defined in this document shall have the following meanings as used throughout.

ACCEPTANCE – Written acknowledgement by the FMPA and authorized representative that the Work has been completed in a manner consistent with the terms, conditions and specifications of a Contract or Purchase Order.

CONTRACTOR – The business entity (and its affiliates and authorized assigns), which has been awarded by FMPA or executed a contract with FMPA shall include any and all subcontractors, affiliates and authorized assigns that provide or perform any or all of the Work. This entity may also be referred to as the Contractor, successful bidder, or successful proposer.

PARTICIPANT CONTRACT – The aggregation of all documents that constitute the binding agreement between the Contractor and FMPA. The Participant Contract may include but shall not be limited to The Award or Agreements that result from this solicitation, Blanket Orders, Purchase Orders, Order Releases, and all attachment agreements.

PURCHASE ORDER (PO) – A Work authorization, issued by FMPA or an FMPA Member, which is issued subject to the terms and conditions of the Award or Agreement. The term “Purchase Order” shall also include “blanket order

releases” and any other ordering methodology agreed to in writing by FMPA and Contractor.

WORK – Labor, materials, supplies, equipment, goods, and services including any related documentation, software, reports, testing, transport, administration, management, tools and any and all other requirements to be furnished or performed by Contractor under this Agreement and/or a Participant Contract together with all other additional necessities that are not specifically recited in this Agreement or Participant Contract but which could be reasonably inferred as necessary to complete all obligations and fully satisfy the intent of this Agreement and/or a Participant Contract.

**23. Entire Contract**

These General Terms and Conditions, the Master Agreement between FMPA and the selected Contractor(s), and the Purchase Order (PO) for which they are being provided (including attachments thereto) constitute the entire agreement between FMPA and the Contractor.

**24. Acceptance of Services and Work Product**

The Product or Services shall be subject to FMPA and authorized staff’s inspection at any time. FMPA may reject Product/Services within a reasonable time after completed, if such Product/Services do not comply with the requirements of the Purchase Order or the specifications for the Product/Service. The making or failure to make any inspection of, or payment for or acceptance of Product/Service shall in no way impair FMPA’s right to reject or revoke its acceptance of nonconforming Product/Service, or to avail itself of any other remedies to which FMPA may be entitled, notwithstanding FMPA’s knowledge of the nonconformity, its substantiality or ease of discovery.

Final acceptance of the Services and Work Product for purposes of the Purchase Order shall be the date upon which FMPA confirms that all Services and Work Product have been completed in accordance with the terms of the Purchase Order (“Final Acceptance”).

**25. Site Access Conditions**

FMPA and authorized staff shall provide Contractor access to the Facility as necessary to perform the Work or Services. Access shall be subject to Contractor’s obligation to comply with the following conditions:

1. Contractor shall confine its activities to only those portions of the Facility necessary for performance of the Services.
2. Contractor shall take all safety measures reasonably necessary to protect FMPA and FMPA property, its permittees and licensees and the property of each, from injury or damage caused by or resulting from the performance of Services. Contractor shall follow any and all safety and security procedures established by FMPA for the Facility. In the event of a security emergency, FMPA and its Members may deny Contractor access to a Facility or request that Contractor leave the Facility.
3. Contractor shall maintain all required insurance coverage’s set forth in Section 27 at all times during the term of the Purchase Order.
4. Contractor’s performance of Services shall not interfere with the use, occupancy or enjoyment of the Facility by FMPA and its Members.

5. No work or activity performed as part of the Services shall cause FMPA and its Members to be in violation of any requirement of law nor shall Contractor or any agent, employee or representative violate any federal, state or local laws while performing Services.
6. All Services shall be performed in a manner that will not damage the Facility and Contractor shall promptly notify FMPA and shall be responsible for the cost of repairing any such damage should it occur.
7. FMPA rules on maintaining a drug-free workplace shall be strictly followed and enforced by Contractor with respect to all of its employees or subcontractors and none of Contractor's employees, subcontractors, agents or representatives shall be permitted to use non-prescription drugs or alcohol at any FMPA and its Member Facility.

**26. Required Insurance**

The Contractor shall acquire and maintain at all times during the performance of Services the insurance coverage set forth below. Contractor shall furnish FMPA a copy of the insurance certificate. Additional information on insurance requirements are noted in Appendix B, page 5.

The liability limits shall not be less than:

Workers' Compensation Statutory

Commercial General Liability \$2,000,000

Automobile Liability \$1,000,000

Product Liability as set forth in the Purchase Order, if any;

Pollution Insurance as set forth in the Purchase Order, if any;

**27. Termination for Default**

Any failure by Contractor to perform or comply with the terms and conditions of the Purchase Order which continues for ten (10) calendar days after written notice from FMPA to Contractor demanding that such failure to perform be cured, shall be deemed an event of default by Contractor. Upon the occurrence of any such event of default, FMPA may terminate the Purchase Order and pursue any remedies available at law or in equity.

**28. Termination for Convenience**

FMPA shall have the right in its sole discretion to terminate by written notice, in whole or in part, the Purchase Order for its convenience. FMPA shall pay Contractor for any Services performed under the Specifications of the Bid Package prior to the termination date.

**29. Termination for Cause**

The performance of work on a Purchase Order issued under this Award agreement may be terminated for cause by a FMPA or Participating Member (s) in accordance with this clause in whole, or from time to time, in part, whenever the authorized FMPA or Member representative, in his or her sole judgment, determines that the Awarded Bidder is not meeting the minimum performance level required. If the Award agreement is terminated

under this provision, the FMPA or Member shall not be required to purchase any remaining items or continue any work. Additionally, the terminated Bidder shall not be eligible for consideration for any replacement Award agreement.

FMPA shall have the right in its sole discretion to terminate by written notice, in whole or in part, the Purchase Order for performance issues. FMPA reserves the right to terminate the Contract with that Contractor(s) and re-advertise or select a second Contractor(s) from the original solicitation.

**30. Use of Ideas**

All materials submitted in response to the RFP become the property of FMPA and will be returned only at the option of FMPA. Except as otherwise prohibited by law, FMPA has the right to use any and all ideas presented in response to this RFP. Selection or rejection of a proposal does not affect this right.

**31. Warranties**

Reference Warranty section of Appendix B, page 3.

**32. Hazardous Materials of Contractor**

Any Hazardous Materials used by Contractor in the performance of the Services shall be packaged, shipped, handled, labeled and disposed of by Contractor in a manner that complies with all federal, state and local laws or regulations applicable to Hazardous Materials. No Hazardous Materials shall be stored by Contractor at the FMPA and its Member's Facility before, during or after the performance of Services hereunder. Contractor shall, at its expense, remove, transport and dispose of all Hazardous Materials (i) brought by Contractor to the Facility or (ii) disturbed by Contractor's performance of Services or created by Contractor's use, handling or combination of non-hazardous materials brought by Contractor to the Facility during the performance of Services. For purposes of the Purchase Order, the term "Hazardous Materials" shall mean any substance which by law requires special handling, containment or disposal, including without limitation "hazardous substances" as defined in the Comprehensive Environmental Response, Compensation and Liability Act of 1980, as amended (42 USC Sections 9601, et seq.), the Hazardous Materials Transportation Act, as amended (49 USC Sections 5101, et seq.), "hazardous wastes" as defined in the Resource Conservation and Recovery Act, as amended (42 USC Sections 9601, et seq.), "toxic substances" as defined in the Toxic Substance Control Act as amended (15 USC Section 2601 et seq.), as amended and in the regulations adopted, published, and promulgated pursuant thereto. Contractor shall be responsible for obtaining and maintaining any licenses, permits, and/or other authorizations of any kind required for the performance of the Services. Contractor shall pay all costs of such licenses, permits and authorizations and all costs and expenses incurred in obtaining and maintaining them. The Contractor shall comply with all federal, state and local laws, and rules and regulations that are applicable to the performance of the services requested by FMPA.

**33. Safety and Protection**

Contractor shall be solely responsible for initiating, maintaining and supervising all safety precautions and programs in connection with work under this RFP. Contractor shall take all necessary precautions for the safety of, and shall provide the necessary protection to prevent damage, injury or loss to:

1. All persons on the site who may be affected by the project work;
2. All Work and materials and equipment to be incorporated therein, whether in storage on or off of the project site. Any off-site storage logistics such as sourcing/allocation, safety, security and transfer/delivery, etc. will be the sole responsibility of the contractor.
3. Other property at the site or adjacent thereto, including trees, shrubs, lawns, walks, pavements, roadways, structures, utilities and underground facilities not designated for removal, relocation or replacement in the course of the project.

**34. Control of Work and Subcontractors**

Contractor shall be solely responsible for all construction means, methods, techniques, sequences, procedures, and safety programs in connection with the performance of the Work. In addition, Contractor shall be solely responsible for the engagement and management of any subcontractors used to perform any portion of the Work.

**35. Domestic Preference**

As appropriate and to the extent consistent with law, Contractor should, to the greatest extent practicable, provide a preference for the purchase, acquisition, or use of goods, products, or materials produced in the United States (including but not limited to iron, aluminum, steel, cement, and other manufactured products).

**36. Public Records**

Supplier acknowledges that FMPA is subject to Florida's Government in the Sunshine Law, including, without limitation, Chapter 119, Florida Statutes. As such, any documents submitted in response to this RFP may be public records subject to public disclosure. Please refer to Section 16, above, for confidential proprietary business information or trade secrets contained in such records. If Supplier does not designate its confidential proprietary business information in its response in accordance with Section 17, above, FMPA may disclose all undesignated information that FMPA is legally bound to disclose in response to a public records request.

**37. Change Orders**

Contractor is **not authorized** to act on any Change Order until they receive a written revision to the Purchase Order for the added scope and price.

FMPA has no obligation to pay for any goods or services outside of the authorized Purchase Order.

# **APPENDIX A**

## **SCOPE OF WORK**

# TCEC CT Exhaust Seal Replacement Scope

## **1. Project Overview**

The Florida Municipal Power Agency (FMPA) is requesting proposals for a comprehensive repair and refurbishment of the A042 Diffuser System at the Treasure Coast Energy Center. This includes the supply of all materials and kits, technical supervision, and labor necessary to complete the scope outlined below. The unit will be available for work from September 22<sup>nd</sup> until October 2<sup>nd</sup>.

## **2. Scope of Work**

### **A. A042 Diffuser Repairs Kit (Reference: Figure 1)**

Vendor shall provide a complete material package and documentation to completely rebuild the Flex Seal system:

- a. Complete Material Kit to Rebuild the Flex Seal System
- b. Installation Drawings, including one digital set and two printed sets
- c. Complete set of Inconel Flex Seals
- d. 100% Bulb Seal, Flat Gasket, Rope Seal
- e. 100% Flange Hardware and Insulation Retaining Clips
- f. Clamp Bar Studs
- g. Gasket and Rope Seal Clamp Plates with Shims and Stops
- h. Trough Liner Studs, Nuts, and Washers
- i. Any additional components needed

### **B. A042 Flex Seal Insulation Kit**

- a. Installation Instructions including one digital set and two printed sets
- b. Inner, Intermediate, and Outer Insulation Pillows
- c. Aluminum Lagging
- d. Installation Hardware including “B” Clips, Studs, Nuts, and Hog Ring Staples
- e. Any additional components needed

### **C. Reinsulate Aft Expansion Joint to HRSG Forward Wall**

Scope includes removal of the internal liner and re-insulation between the Expansion Joint and HRSG Forward Wall.

- a. Liner Studs, Nuts, Washers
- b. All necessary Insulation
- c. Any additional components needed



#### **D. Milestone Inspections & As-Found Reporting**

Scope to include in the schedule for milestone “checkpoints” in which FMPA will inspect removed components for verification of “problems” and confirmed resolution for confidence in rebuild. Vendor will also supply a summarized field report of “as-found” findings for pre & post demolition.

#### **E. Cleanup**

Scope includes two (2) complete staged cleanups (vacuuming, etc.) of ALL debris such as insulation fiber, metal shavings, etc. after removal of old components and then repeated upon completion of installation. Prior to completion of each stage, FMPA will inspect for thoroughness.

#### **F. In Kind Replacement and Upgrades**

For the purposes of this bid the base scope will be an in kind replacement of the existing material. Upgrade options with pricing may be included but the base scope is an in kind replacement and must be bid as such.

### **3. Additional Services Required (Turnkey Supply and Installation)**

Proposer shall include all of the following in the proposal:

- Technical Advisor Services
- On-site Supervision
- Qualified Craft Labor
- All Required Materials including consumables & prudent spares for any items not immediately available.
- Packaging and Shipping to Site
- All Tools and Equipment
- Welding Equipment including Gas Supply
- Scaffolding for Access
- Internal lighting
- Insulators for Removal and Reinstallation of External Insulation
- Warranty for parts and labor on all materials and workmanship
- Experience list and References for completed projects of this type with a preference for GE 7FA A042 units. Please include in the above the original bid value as well as discovery work & T&M costs for budgeting purposes.

### **4. Deliverables**

- Detailed Bill of Materials at least 60 days prior to the start of the outage.
- Technical and Installation Drawings at least 60 days prior to the start of the outage.
- Detailed proposed schedule at least 30 days prior to the start of the outage in Gantt chart format.
- Detailed Warranty & expected lifespan Information with the proposal

- Safety and QA/QC Plan with the proposal
- Labor and Equipment Rates with the proposal
- Lump Sum Pricing with a list of T&M rates for supervision and craft labor.

## 5. Site Information

Location:  
 FMPA Treasure Coast Energy Center  
 4545 Energy Lane  
 Fort Pierce, FL 34772

## 6. Division of Responsibilities

Item	Supplier	FMPA
Sanitary and Wash Facilities		<b>X</b>
Office and Break Trailers	<b>X</b>	
LOTO		<b>X</b>
Safety Orientation		<b>X</b>
Forklift and Material Handling	<b>X</b>	
Electrical Supply		<b>X</b>
Diesel	<b>X</b>	
Scaffolding & Insulation	<b>X</b>	
Laydown Area and Parking		<b>X</b>
Internal Lighting	<b>X</b>	

## 7. Evaluation Criteria

Proposals will be evaluated based on the following:

- Technical compliance with specifications
- Vendor experience and references
- Schedule and delivery timelines
- Warranty and support offerings
- Safety and quality plans
- Cost competitiveness
- Other (*FMPA discretion*)

8

7

6

5

4

3

2

1

FORMAT: W1424D 2.1.1

## NOTES:

- ALL FABRICATION SHALL BE PER AISC AND AWS LATEST EDITION.
  - ALL STRUCTURAL STEEL SHALL BE R-ST 37-2 OR A36 CARBON STEEL.
  - SHELL PLATE SHALL BE R-ST 37-2 OR A36 CARBON STEEL.
  - SOLID LINER SHALL BE 11 (3.0) GA. ASTM A240-T321 STAINLESS STEEL IN TROUGH, ASTM A240-T409 APT OF TROUGH.
  - BATTEN CHANNELS: 11 (3.04) GA. ASTM A240-T409 SS SEPARATOR BARS: 12 (2.7) GA. MIN, 11 GA. OR 3MM ASTM A240-T409 SS. STUDS/NUTS: .750-10UNC ASTM A193-B8 EXCEPT TROUGH STUD/NUTS (FLEX SEAL CLAMP BARS ONLY) SHALL BE .750-10UNC ASTM A193-B8C.
  - ALL EXTERIOR STIFFENERS SHALL BE SEAL WELDED.
  - CLEANING SHALL BE PER P4A-AL-1801 SPIO EXTERIOR AND INTERIOR.
  - PAINTING:
    - ALL EXTERIOR AND INTERIOR SURFACES OF DIFFUSER SHALL HAVE ONE SHOP COAT OF INORGANIC ZINC RICH PRIMER PER P6C-A025.
    - ALL SUPPORT STEEL NOT DIRECTLY WELDED TO THE DIFFUSER SHALL BE HOT DIP GALVANIZED PER ASTM A123.
    - ALL EXTERNAL SURFACES OF THE EXHAUST SYSTEM SHALL BE PAINTED WITH HIGH TEMPERATURE ALUMINUM PAINT IMMEDIATELY AFTER FINAL INSTALLATION PER GE SPECIFICATION P6C-A631 BY CUSTOMER.
  - ALL WELDING INCLUDING SCALLOP BARS TO BE DONE PRIOR TO PAINTING.
  - ALL STUDS TO HAVE CUT THREADS.
  - INSULATION: 8 LBS/CU.FT DENSITY - GE SPECIFICATION ASD12B4.
  - ALL DIMENSIONS IN BRACKETS [ ] ARE IN MILLIMETERS.
  - ALL EXTERNAL BOLTS, NUTS AND WASHERS TO BE HOT DIP GALVANIZED.
  - TEFLON SLIDE PADS AT FORWARD AND AFT SUPPORTS.
  - EXPANSION JOINT CYCLIC MOVEMENTS SEE NOTE 1 BELOW
    - 1.00 (25.4) COMPRESSION
    - .50 (12.7) EXTENSION
- NOTE 1:  
IN ADDITION TO THE ABOVE CYCLIC MOVEMENTS THE EXPANSION JOINT IS CAPABLE OF ACCOMODATING THE FOLLOWING ADDITIONAL INSTALLATION MISALIGNMENTS BETWEEN THE AFT DIFFUSER AND BOILER DUCT FLANGES  
AXIAL MISALIGNMENT: 1.00 (25.4) IN THE JOINT COMPRESSION DIRECTION  
.50 (12.7) IN THE JOINT EXTENSION DIRECTION  
LATERAL MISALIGNMENT: .50 (12.7) BETWEEN THE DIFFUSER AFT FLANGE AND THE BOILER DUCT FLANGE IN THE LATERAL DIRECTION (PERPENDICULAR TO FLOW DIRECTION)  
SEE ERECTION DRAWINGS FOR INSTRUCTIONS ON VERIFICATION OF INSTALLATION MISALIGNMENT LIMITS.
- ANCHOR BOLTS, NUTS, WASHERS AND GROUT NOT SUPPLIED BY GE.
  - ACOUSTICAL BARRIER WALL, ARCHITECTURAL SIDING OR SUPPORT STRUCTURE, IF SUPPLIED, SHALL BE FABRICATED PER SPECIFIED DRAWING (SEE BOM).
  - BEFORE INSTALLING FLEX SEAL INSULATION BLANKETS, TACK WELD BOLT HEAD TO "A" CLIP USING 347 STN STL WELD WIRE, IF NOT DONE IN SHOP.
  - TORQUING PROCEDURE: FOR FLEX SEAL CLAMP BARS AND 0706 FLANGE SEE SH.4, FOR INTERNAL LINER NUTS SEE SH.3 NOTES 1-3, FOR EXTERNAL FLANGE NUTS SEE SH.3 NOTE 4, FOR EXPANSION LINER NUTS SEE SH.5.

- ALL STIFFENERS AND FLEX SEAL CLAMP BARS SHALL BE PLASMA CUT OR LASER CUT. ROLLED STIFFENERS ARE NOT ALLOWED.
  - CASINGS SHALL BE FIXTURED TO ALLOW INTERCHANGEABILITY BETWEEN CASING SECTIONS. BOLT HOLES IN FLANGES SHALL MATCH FROM CASING TO CASING.
  - BLEED PIPES LOCATION AND INSTALLATION MUST BE FIXTURED.
  - STUD INSTALLATION ON SEPARATOR BARS SHALL BE FIXTURED.
  - A TOOL SHALL BE MADE TO PROPERLY LOCATE THE SEPARATOR BARS TO THE DUCT.
  - LINER SHEET TEMPLATE SHALL BE USED TO ENSURE LINER SHEETS WILL MOVE WITHOUT BINDING ON THE STUDS.
  - SUPPLIER SHALL RECORD ALL CTO DIMENSIONS, PROCESS STEPS AND FUNCTIONALITY REQUIREMENTS AS SPECIFIED ON THIS DRAWING. CTO'S SHALL BE SUBMITTED TO G.E. ELECTRONICALLY.
  - CTP DIMENSIONS SHALL BE RECORDED BUT NOT SUBMITTED TO G.E.
- INTERFACE NO. 18 AS SHOWN ON MLI 0239, OUTLINE MECH. INTERFACES. THIS INTERFACE IS CONTROLLED AND SHALL NOT BE CHANGED UNLESS A DCI IS WRITTEN SCHEDULING MLI'S A042, 0706 AND 0239 FOR REVISIONS.
  - INTERFACE NO. 19 AS SHOWN ON MLI 0239, OUTLINE MECH. INTERFACES. THIS INTERFACE IS CONTROLLED AND SHALL NOT BE CHANGED UNLESS A DCI IS WRITTEN SCHEDULING MLI'S A042, 0306 A096 AND 0239 FOR REVISIONS.
  - TYPICAL CUSTOMER SUPPLIED JOINT SHOWN. CONFIGURATION MAY DIFFER. FULL PENETRATION WELDS OF SHELL ARE DESIRABLE AND TYPICAL FOR GE SUPPLIED JOINTS AND CUSTOMER SUPPLIED JOINTS. TYPICAL TORQUE VALUE FOR FIELD BOLTED JOINTS IS 325 FT-LBS, REFERENCE CUSTOMER SUPPLIED INSTALLATION PROCEDURES FOR ACTUAL TORQUE VALUE REQUESTED FOR THIS JOINT.

PART NO. 1 THRU 99: ARCH SIDING ASSY, ACOUSTIC BARRIER WALL ASSY  
SUPPORT STRUCTURE ASSY  
(MAJOR SUBASSY)

PART NO. 100 THRU 199: CASING PARTS, STIFFENERS  
(SH. 6, 7, 8)

PART NO. 200 THRU 299: SEPARATOR BARS, INSULATION, STUDS-304 & 347  
(SH. 10, 11)




PART NO. 300 THRU 399: LINERS, HOLD DOWN BARS, CHANNELS, LINER NUTS  
(SH. 21)

PART NO. 400 THRU 499: FLEX SEALS CLAMP BARS, ROPE SEALS, HOLD DOWN BARS, FLEX SEALS, FLEX SEAL BOLTS & ANGLE  
(SH. 21)

PART NO. 500 THRU 599: AFT EXPANSION JOINT ASSY & PARTS



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	(1) ADDED GROUP 10 LARRY KENNEDY	07-01-21 LDK	LDK TMA

REVISE ON CAD ONLY  
UG PART: 131E4039P001  
SPEC: 131E4039SH1-6

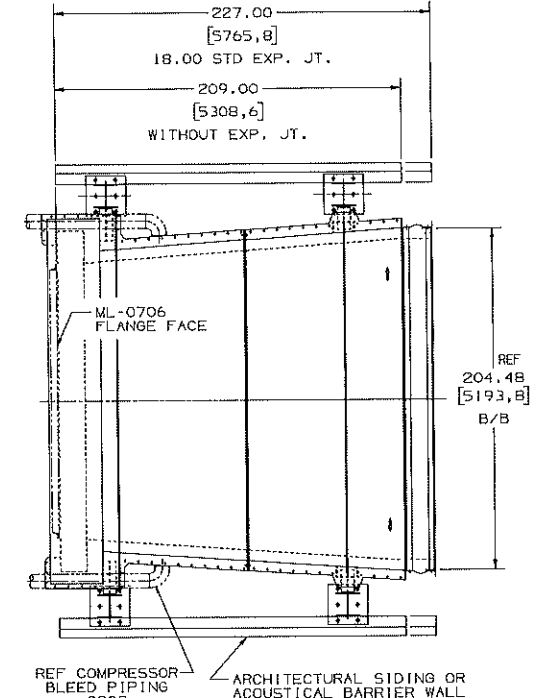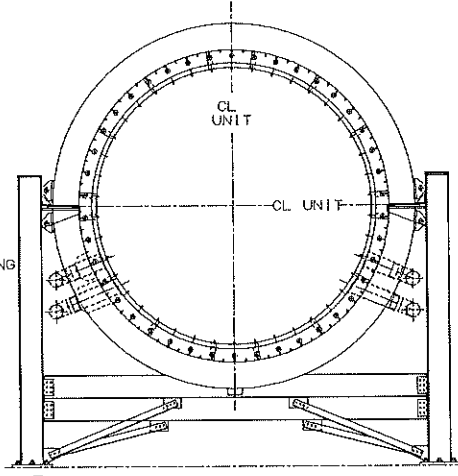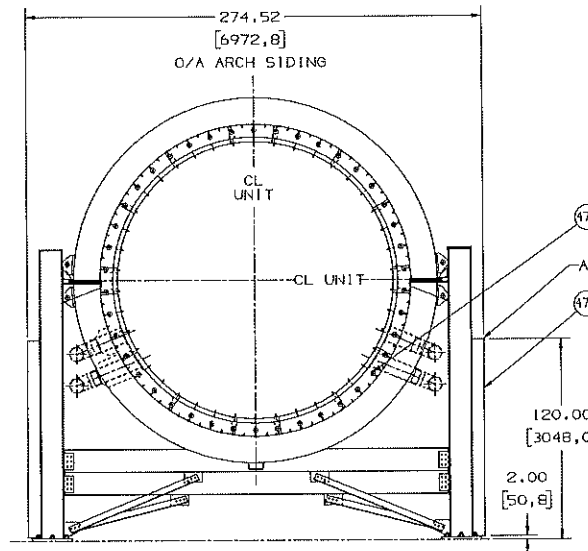

(G1) ARCHITECTURAL SIDING  
(G2) ARCHITECTURAL SIDING


(G5) W/O ARCHITECTURAL SIDING OR BARRIER WALL  
(G6) W/O ARCHITECTURAL SIDING OR BARRIER WALL

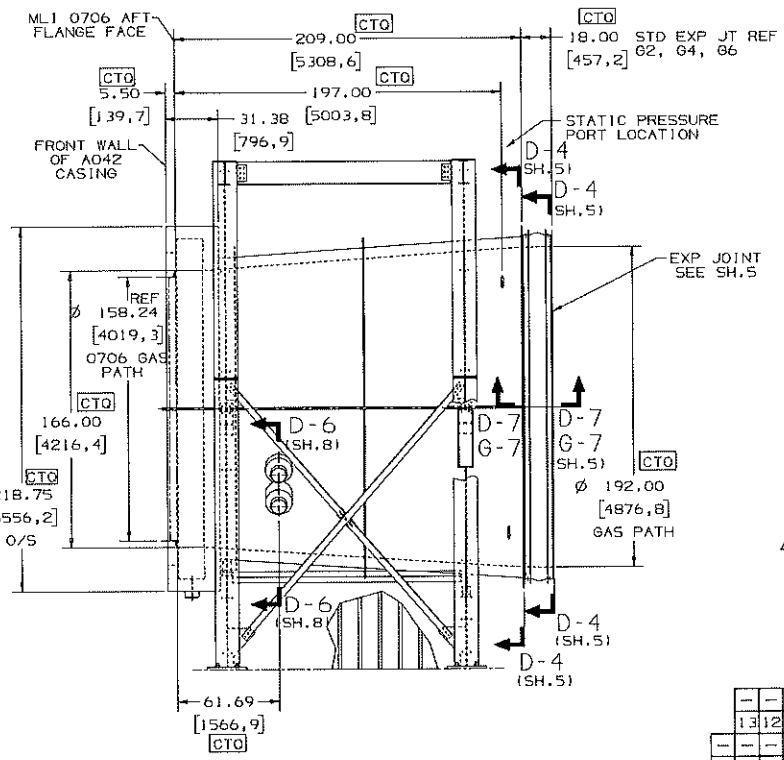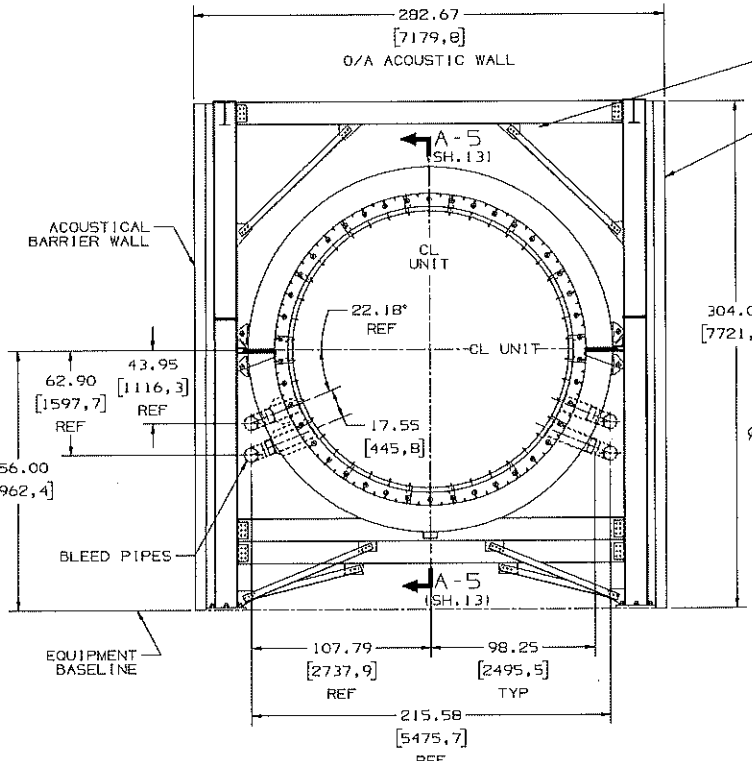

## PART NO. LIST

GROUP NO.	STD EXP JOINT	ARCH SIDING	ACOUSTIC WALL
G1		X	
G2	X	X	
G3			X
G4	X		X
G5			
G6	X		
G7	X		
G8			WALL COLOR TO BE COLONY GREEN, OWSA GROUP 4
G9			WALL COLOR TO BE DESERT TAN, OWSA GROUP 4
G10			WALL COLOR TO BE ASH GRAY, OWSA GROUP 4

G007 SUPERSEDES G006



DT-1N

(G3) ACOUSTICAL BARRIER WALL  
(G4) ACOUSTICAL BARRIER WALL

© COPYRIGHT 2005 GENERAL ELECTRIC COMPANY  
PROPRIETARY INFORMATION - THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF GENERAL ELECTRIC COMPANY AND MAY NOT BE USED OR DISCLOSED TO OTHERS, EXCEPT WITH THE WRITTEN PERMISSION OF GENERAL ELECTRIC COMPANY.

SIGNATURES		DATE	
DAVID BALAKIAN	K	05-01-17	
DAVID LARRY D KENNEDY		05-01-21	
DAVID TOM ALBERT		05-02-22	
DAVID LARRY D KENNEDY		05-02-24	
DAVID JOHN C COLE		05-02-23	

UNLESS OTHERWISE SPECIFIED  
DIMENSIONS ARE IN INCHES (MM)  
TOLERANCES ARE:  
2 PL DECIMALS ± .010  
3 PL DECIMALS ± .005  
FRACTIONS ± .001

APPLIED PRACTICES 348A9200

GE Power Generation

EXHAUST SYSTEM ARRANGEMENT

FIRST MADE FOR ML-7A1WFA1-9 A042














131E4039

586E1427

1

REV	DESCRIPTION	DATE	APPROVED
1	REVISED ON CAD ONLY		
2	UG PART: 131E4039P001		
3	(SPEC: 131E4039SH1-6)		

REVISED ON CAD ONLY  
UG PART: 131E4039P001  
(SPEC: 131E4039SH1-6)

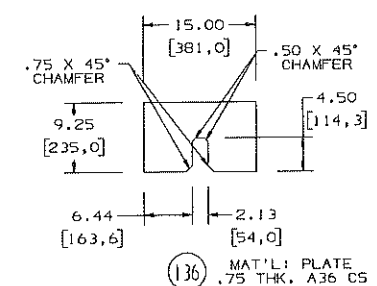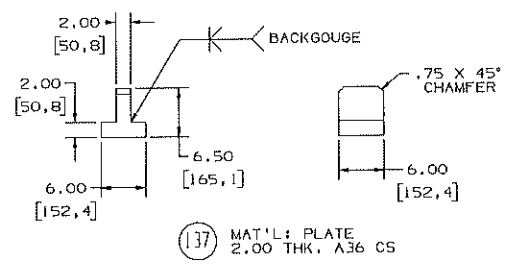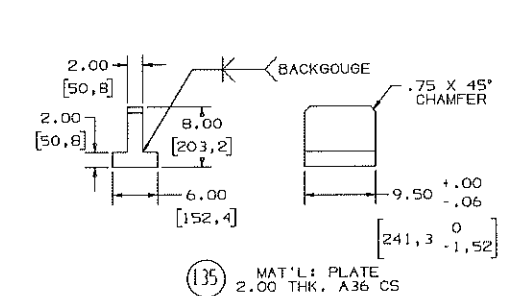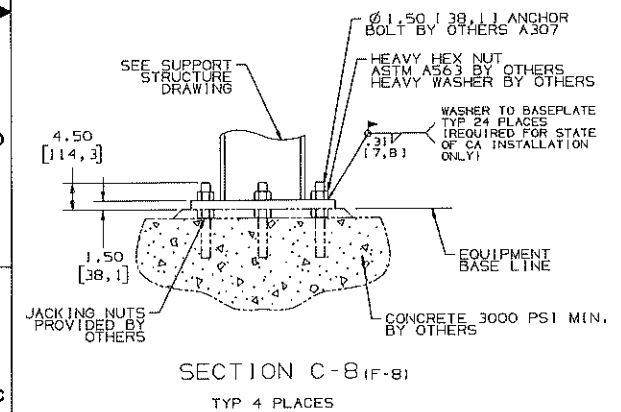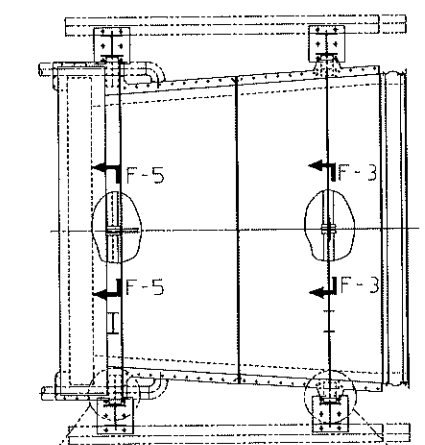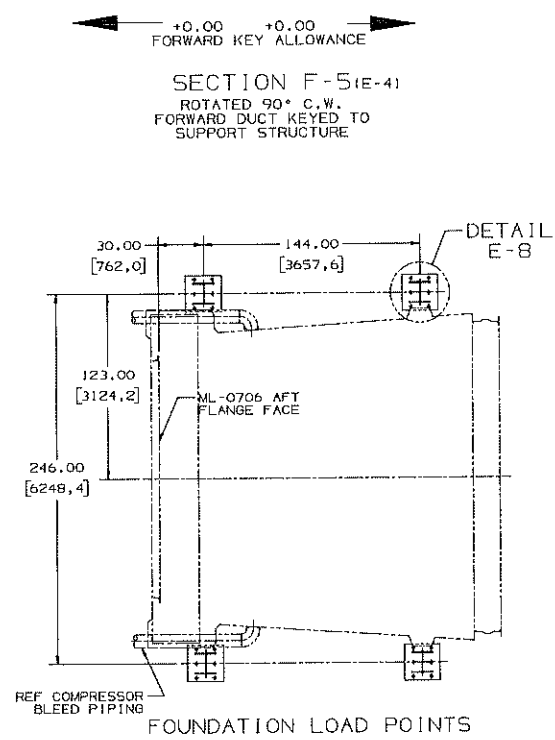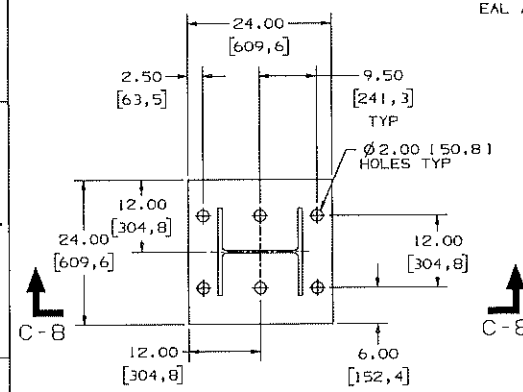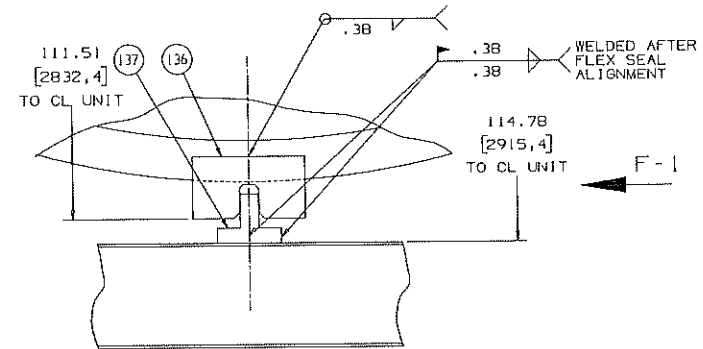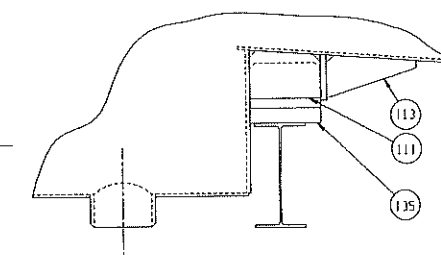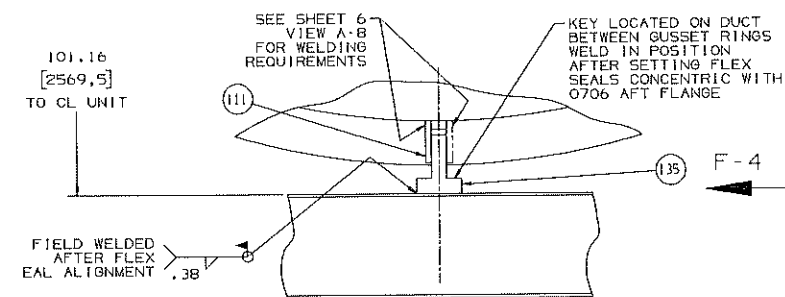

© COPYRIGHT 2005 GENERAL ELECTRIC COMPANY

PROPRIETARY INFORMATION-THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF GENERAL ELECTRIC COMPANY AND MAY NOT BE USED OR DISCLOSED TO OTHERS, EXCEPT WITH THE WRITTEN PERMISSION OF GENERAL ELECTRIC COMPANY.

REV	DESCRIPTION	DATE	APPROVED
1	REVISED ON CAD ONLY		
2	UG PART: 131E4039P001		
3	(SPEC: 131E4039SH1-6)		

131E4039

2

8

7

6

5

4

3

2

1

FORMAT: PIZAND 2.1.1.1

REV	DESCRIPTION	DATE	APPROVED
1	131E4039		

REVISE ON CAD ONLY  
UG PART: 131E4039P001  
( SPEC: 131E4039SH1-6 )

## FIELD AND FACTORY INSTALLED INSULATION


- WHENEVER POSSIBLE AVOID SPLICING INSULATION. USE FULL LENGTH PIECES OF INSULATION.
- IF INSULATION SPLICING IS REQUIRED, IN THE FACTORY OR FIELD, STAGGER SPLICE AS SHOWN BELOW

ELECTRODES AND/OR FILLER METAL		
A	E7018	CARBON STEEL-CARBON STEEL
B	309	304-409, 321, 304-CARBON STEEL
C	308	304-304
D	308L	304L-304L
E	309L	304L-CARBON STEEL
H	347	347-347 347-321 321-321
J	INCO 82 OR 182*	409-409, 409- CARBON STEEL

- \* WRAP ALL APPLICABLE ENDS
- \*\* BLEED PIPES ONLY OTHERWISE 309




### NOTES:

- AFTER LINER PARTS HAVE BEEN ASSEMBLED LUBRICATE THE STUD AND NUT WITH ANTI-SEIZE THEN TORQUE TIGHTEN .75-10 304 SS RETAINER NUTS "CLOCKWISE" TO A RANGE OF 50-55 FT/LBS (68-75 NEWTON METERS) OF TORQUE USING A CALIBRATED TORQUE WRENCH. DO NOT EXCEED 55 FT/LBS (75 NEWTON METERS) OF TORQUE IN TIGHTENING.
- BACK-OFF OR LOOSEN THE LINER RETAINER NUT EXACTLY ONE QUARTER TURN (90°) COUNTER-CLOCKWISE (SEE SHEETS 4 AND 5 FOR ADDITIONAL NOTES)



LINER RETENTION NUTS



- TACK WELD AS SHOWN BELOW.

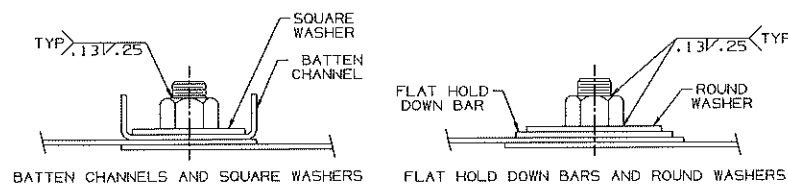

WELDING DETAIL - STUDS & NUTS


- TORQUE ALL EXTERNAL FLANGE HARDWARE TO 325 FT/LBS TACK WELD AS INDICATED IN DETAIL B-5 AND SECTION B-2.

CTO NO GAPS OR VOIDS IN INSULATION

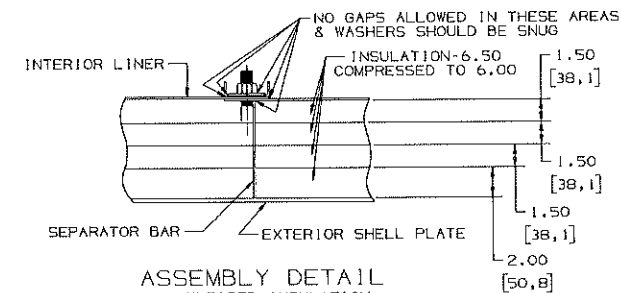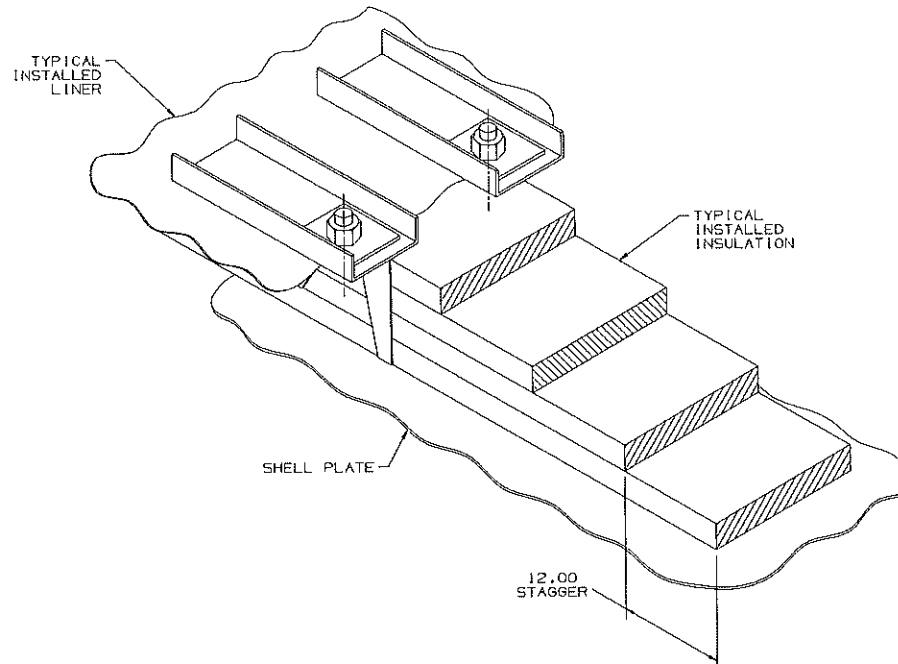


ASSEMBLY DETAIL  
NO EXPOSED INSULATION

ALL EXPOSED INSULATION  
SHALL BE SUITABLY  
PROTECTED FOR SHIPMENT

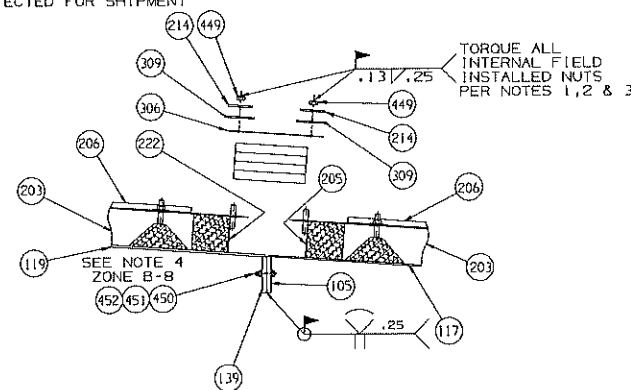

DETAIL B-5 (B-5, SH.131)

CIRCUMFERENTIAL FIELD-SPLICE FLANGE ASSEMBLY

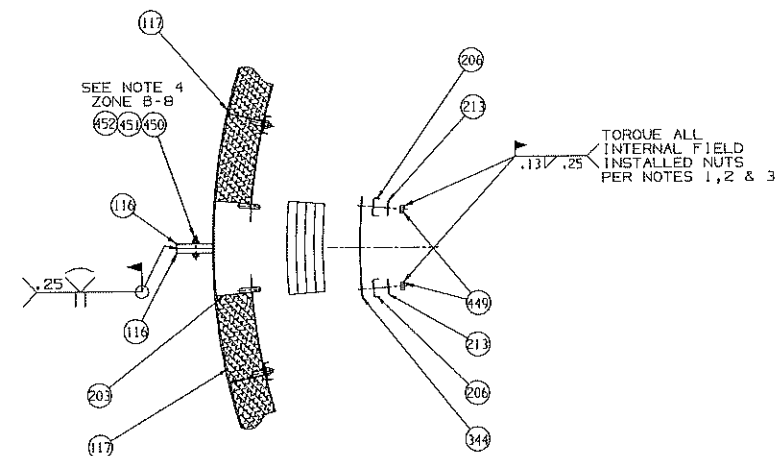

SECTION B-2 (E-4, SH.131)  
HORIZONTAL FIELD SPLICE TYP

© COPYRIGHT 2005 GENERAL ELECTRIC COMPANY

PROPRIETARY INFORMATION-THIS DOCUMENT CONTAINS  
PROPRIETARY INFORMATION OF GENERAL ELECTRIC  
COMPANY AND MAY NOT BE USED OR DISCLOSED TO  
OTHERS, EXCEPT WITH THE WRITTEN PERMISSION OF  
GENERAL ELECTRIC COMPANY.


REVISION	DATE	APPROVED
1	131E4039	

131E4039


3



REVISE ON CAD ONLY  
UG PART: 131E4039P001  
SPEC: 131E4039SH1-6.1

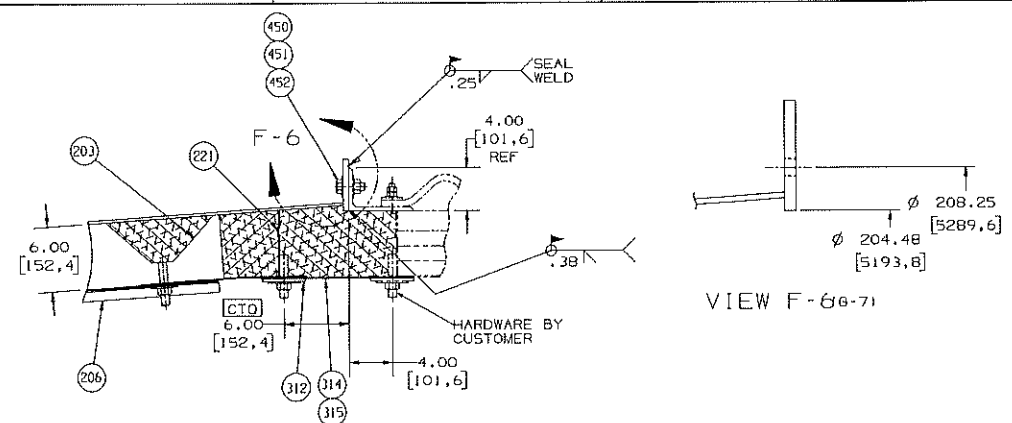


SECTION G-7 (C-3, SH.1)  
CUSTOMER SUPPLIED EXPANSION JOINT  
CTQ: SEE NOTE 22

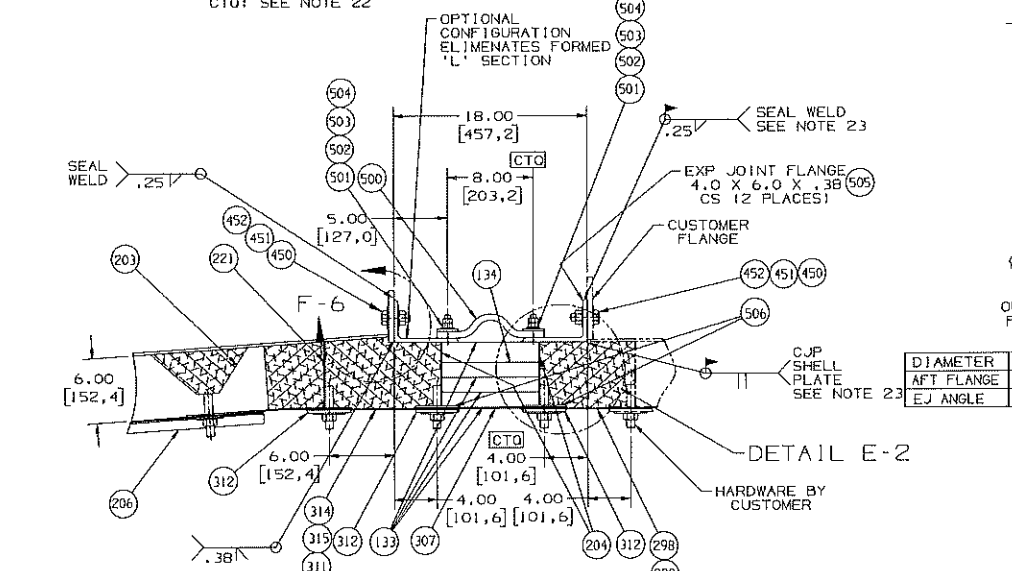


SECTION D-7 (C-3, SH.1)  
G.E. SUPPLIED EXPANSION JOINT  
CTQ: SEE NOTE 22

- NOTE:
1. AFTER LINER PARTS HAVE BEEN ASSEMBLED LUBRICATE THE STUD AND NUT WITH ANTI-SEIZE THEN TORQUE TIGHTEN 75-10 304 SS RETAINER NUTS "CLOCKWISE" TO A RANGE OF 30-35 FT/LBS (41-48 NEWTON METERS) USING A CALIBRATED TORQUE WRENCH. DO NOT EXCEED 35 FT/LBS (48 NEWTON METERS).
  2. EXPANSION JOINT BELT NUTS TORQUE INSTRUCTIONS: TORQUE FIRST NUTS TO 50 TO 55 FT-LBS. USE A WRENCH TO HOLD FIRST NUT AND PREVENT IT FROM ROTATING. INSTALL AND TORQUE SECOND NUT TO 35 FT-LBS.
- BACK OFF OR LOOSEN THE LINER RETENTION NUT EXACTLY ONE FULL TURN (360°) COUNTER-CLOCKWISE AND WELD PER DETAIL E-2

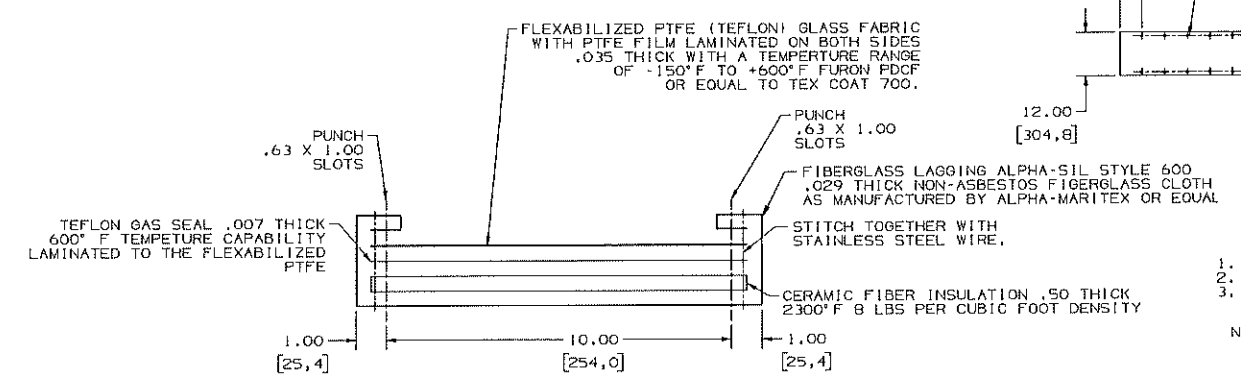


NOTE: FIBERGLASS CLOTH TO BE LAMINATED TO PTFE FABRIC AND TO .50 THICK CERAMIC INSULATION

BELT MATERIAL DETAIL

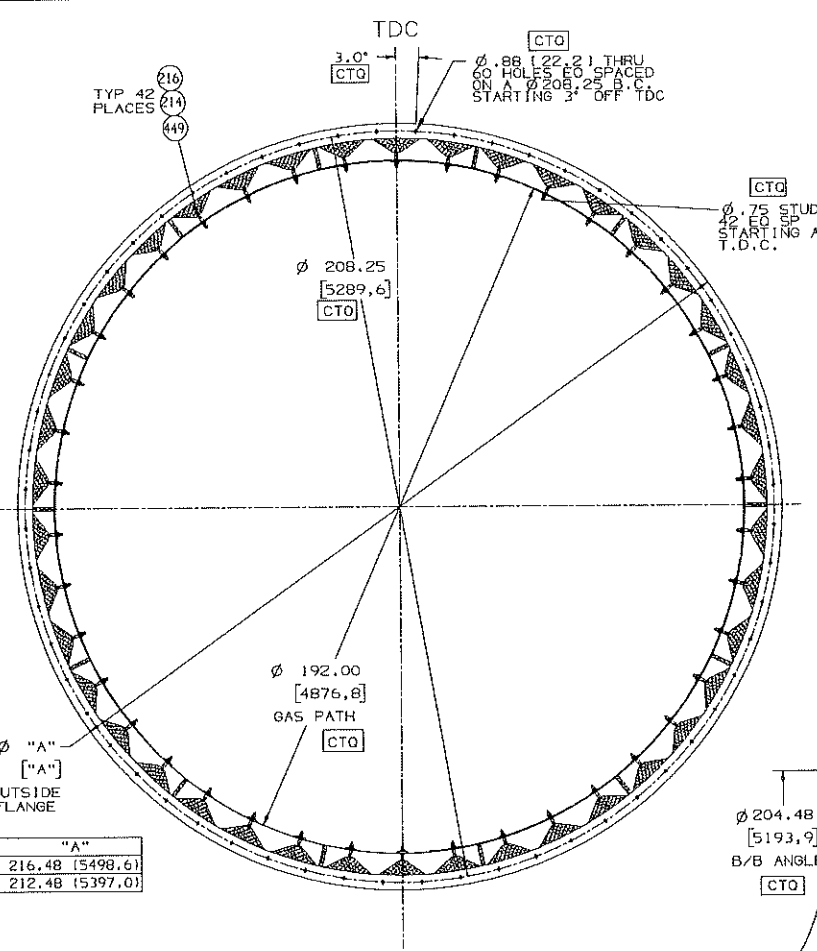


VIEW D-4 (D-3, SH.1)


NOTE: BOLT HOLES AND STUD PATTERN FOR BOTH EXPANSION JOINT AND FLANGES, ON AFT END OF DIFFUSER TO BE IDENTICAL.  
CDO: SEE NOTE 22  
PREASSEMBLE TWO HALVES, WITH SHIPPING BRACES, COVER ENDS.

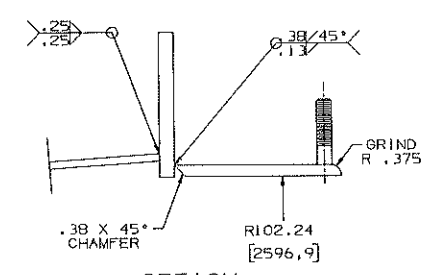

OPTION  
INTEGRATED EXP JOINT FLANGE  
OTHERWISE SAME AS SECTION D-7

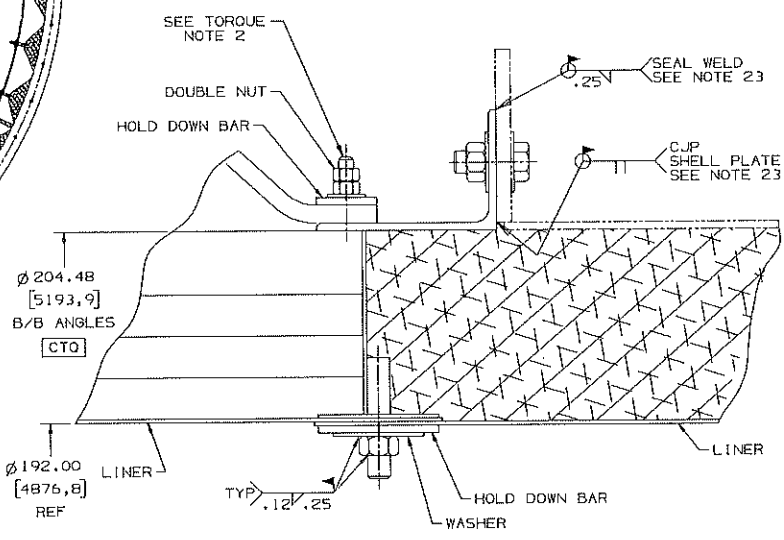

TYPICAL WELDING DETAIL E-2  
STUDS & NUTS ON AFT EXPANSION JOINT

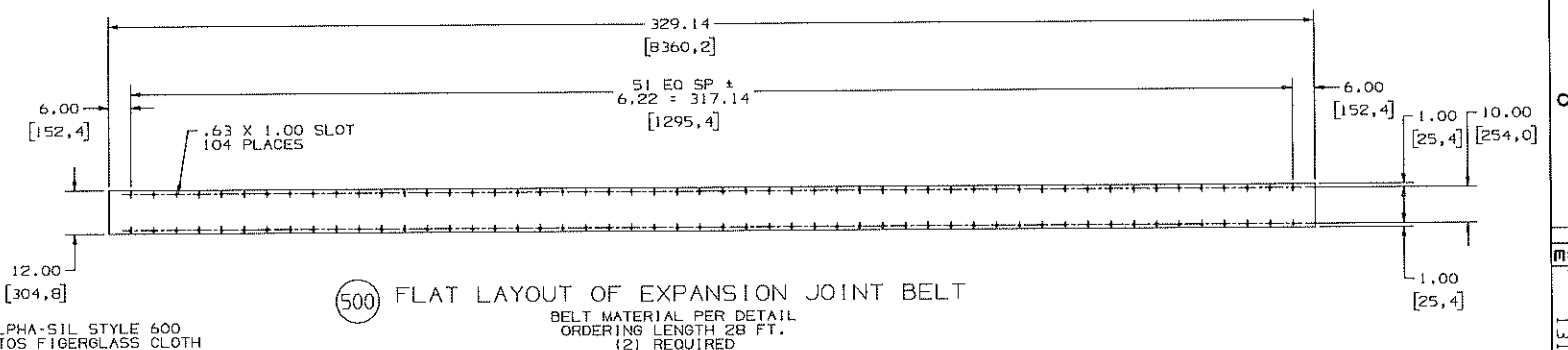


500 FLAT LAYOUT OF EXPANSION JOINT BELT  
BELT MATERIAL PER DETAIL  
ORDERING LENGTH 28 FT.  
(21) REQUIRED

EXPANSION JOINT SPLICING INSTRUCTIONS


1. CLEAN BOTH SURFACES TO BE BONDED WITH SEA BREEZE ASTRINGENT OR LIGHTLY ROUGH WITH EMERY CLOTH.
  2. PLACE 2.00 INCH FEP FILM BETWEEN SURFACES. PLACE SRC-10 TRANSFER CLOTH ON THE TOP SURFACE.
  3. APPLY SEALING IRON ± 750°F. FOR 3-8 MINUTES UNTIL MATERIAL IS BONDED.
- NOTE: THE BACK OF SPLICE NEEDS TO BE SUPPORTED AND FLAT AS MUCH PRESSURE AS POSSIBLE SHOULD BE APPLIED ON THE SEALING IRON.

NOTES:


- CTQ 1. DIFFUSER DUCT CASING MUST BE BUILT IN A FIXTURE SO THAT QUARTER SECTIONS ARE INTERCHANGEABLE. MATCH MARKED PARTS ARE NOT ACCEPTABLE.
- CTQ 2. STIFFENERS AND FLANGES PARTS 101, 104, 105, 107, 107, 133 & 135 MUST BE CUT AND NOT ROLLED. SPLICES OPTIONAL AS SHOWN.
- CTQ 3. ALL LIFTING LUGS TO BE MAGNETIC PARTICLE INSPECTED PER G.E. SPEC. PA-3A-G1.

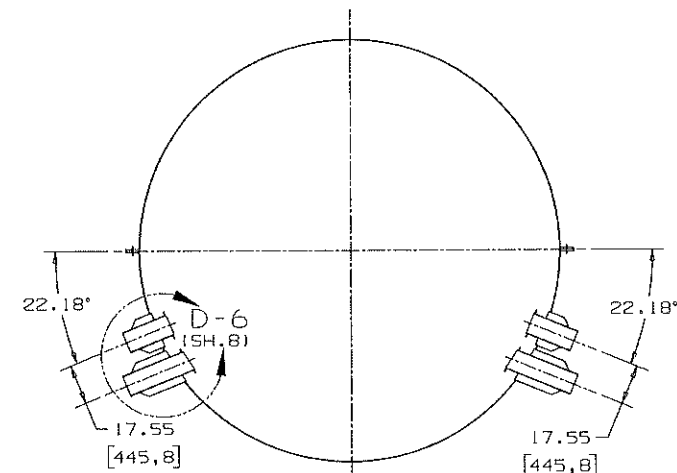


SECTION E-7(E-5)  
COMPRESSOR BLEED PIPING

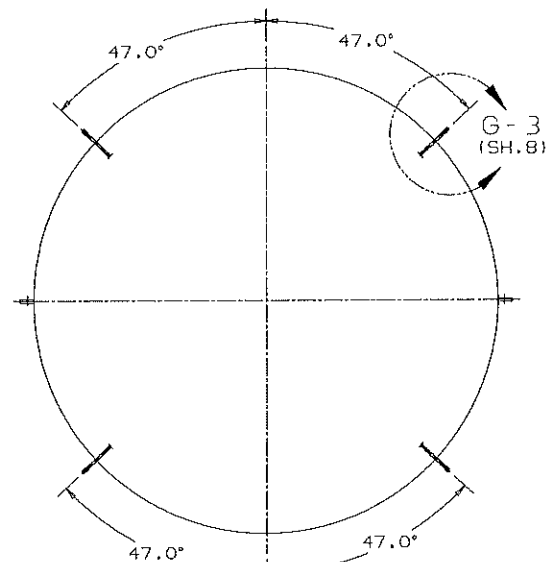



SECTION B-7E-5)  
STATIC PRESSURE PORTS

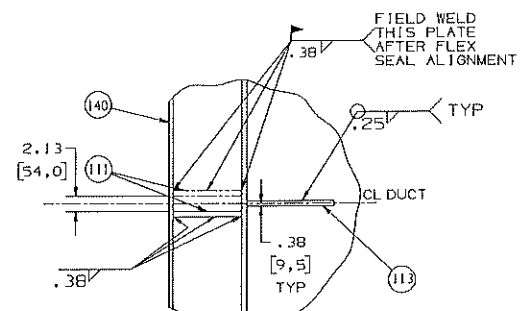


VIEW A-8

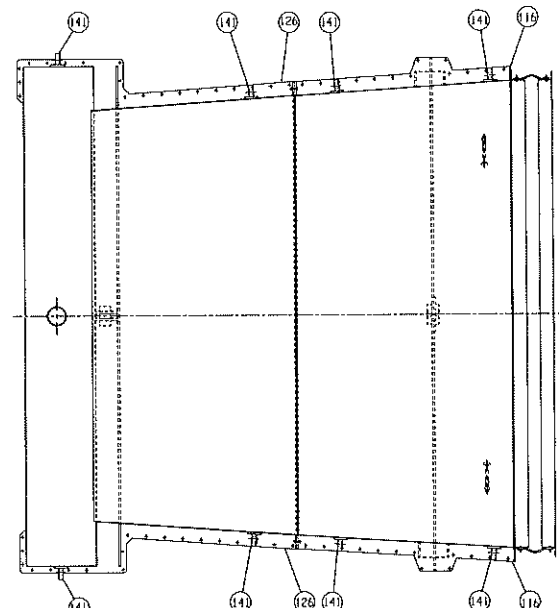

SECTION E-5 (D-5)

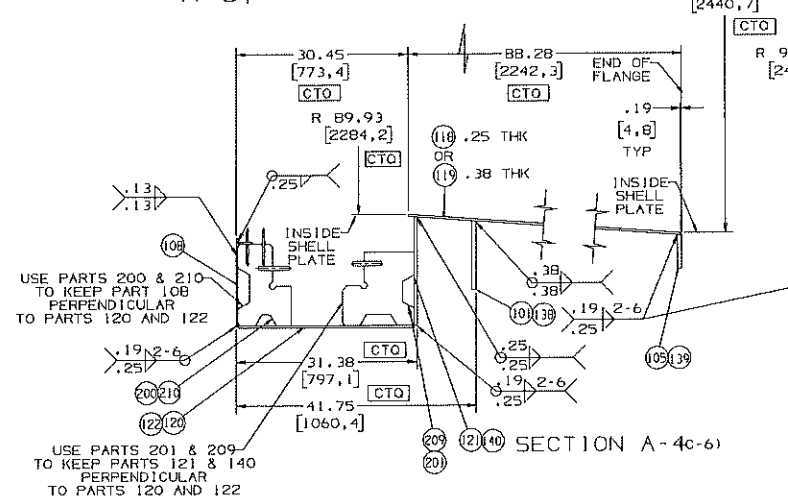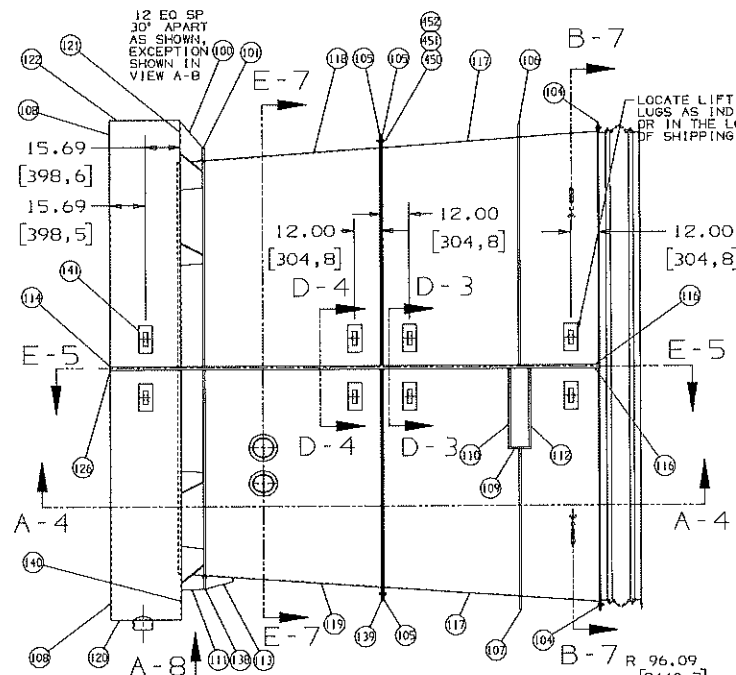


SECTION A-4c-6

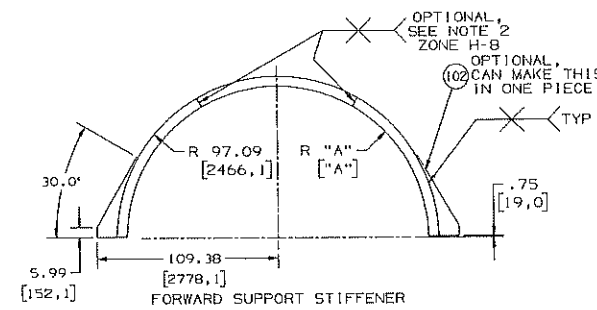


FORWARD SUPPORT STIFFENER


PT. NO.	R "A"
101	R 90.97 (2310.6)
138	R 91.09 (2313.7)

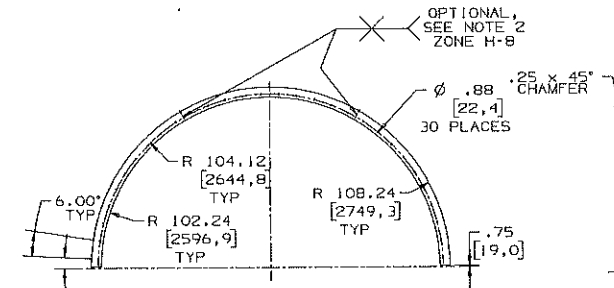



AFT FLANGE  
 MAT'L: PLATE  
 (104) .50 THK  
 A36 CS




SECTION D-4 (D-5)



SECTION D-3 (D-5)

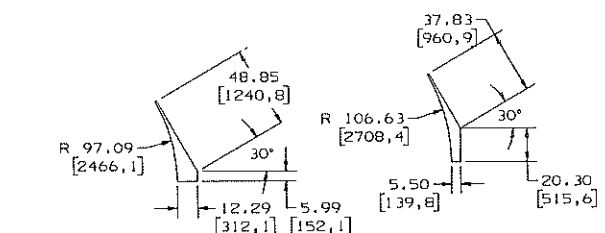
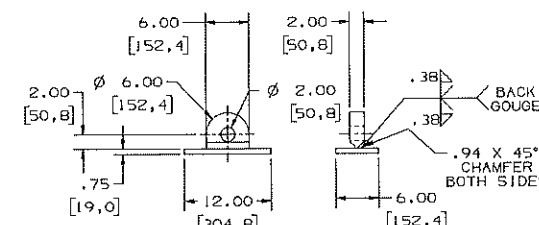


102 MAT'L: PLATE  
.75 THK.  
A36 CS

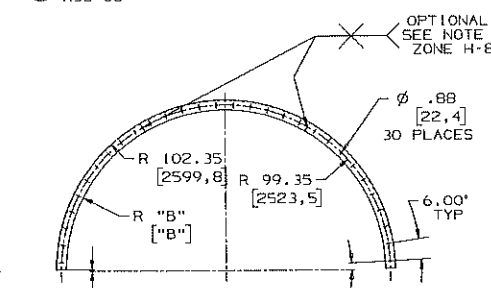


CENTER FLANGE

PT. NO.	R "B"
105	R 96.35 (2447.3)
139	R 96.48 (2450.6)

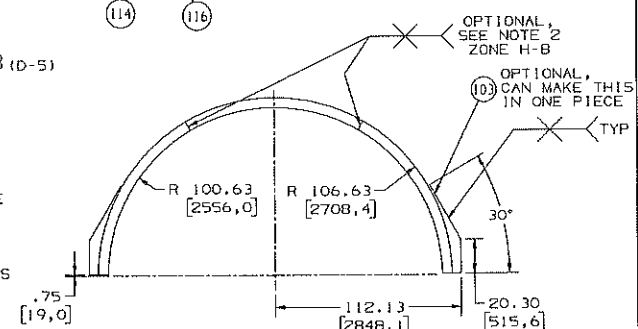

AFT SUPPORT UPPER STIFFENER

106 MAT'L; PLATE  
.75 THK.  
A36 CS

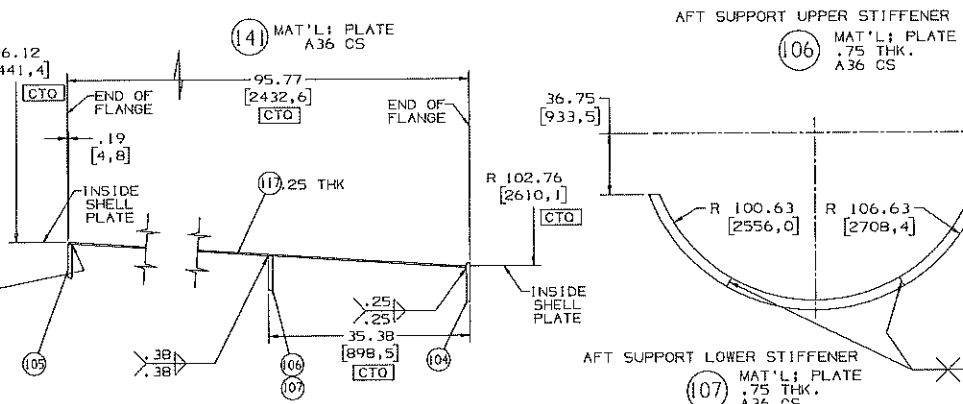


AFT SUPPORT LOWER STIFFENER


(107) MAT'L; PLATE  
.75 THK.  
A36 CS


© COPYRIGHT 2005 GENERAL ELECTRIC COMPANY


PROPRIETARY INFORMATION-THIS DOCUMENT CONTAINS  
PROPRIETARY INFORMATION OF GENERAL ELECTRIC  
COMPANY AND MAY NOT BE USED OR DISCLOSED TO  
OTHERS, EXCEPT WITH THE WRITTEN PERMISSION OF  
GENERAL ELECTRIC COMPANY.

 FEDERAL ELECTRIC COMPANY 438 TOLSONE BOSTON 17, MA	SIZE	CAGE CODE	QWG NO
	E		131E4039
DE Power Generation Inc. DRYAN LAGUNAR M Q5-01-17 UNLESS LABELS O.K. KELLEY	SCALE NONE	SHEET 6	



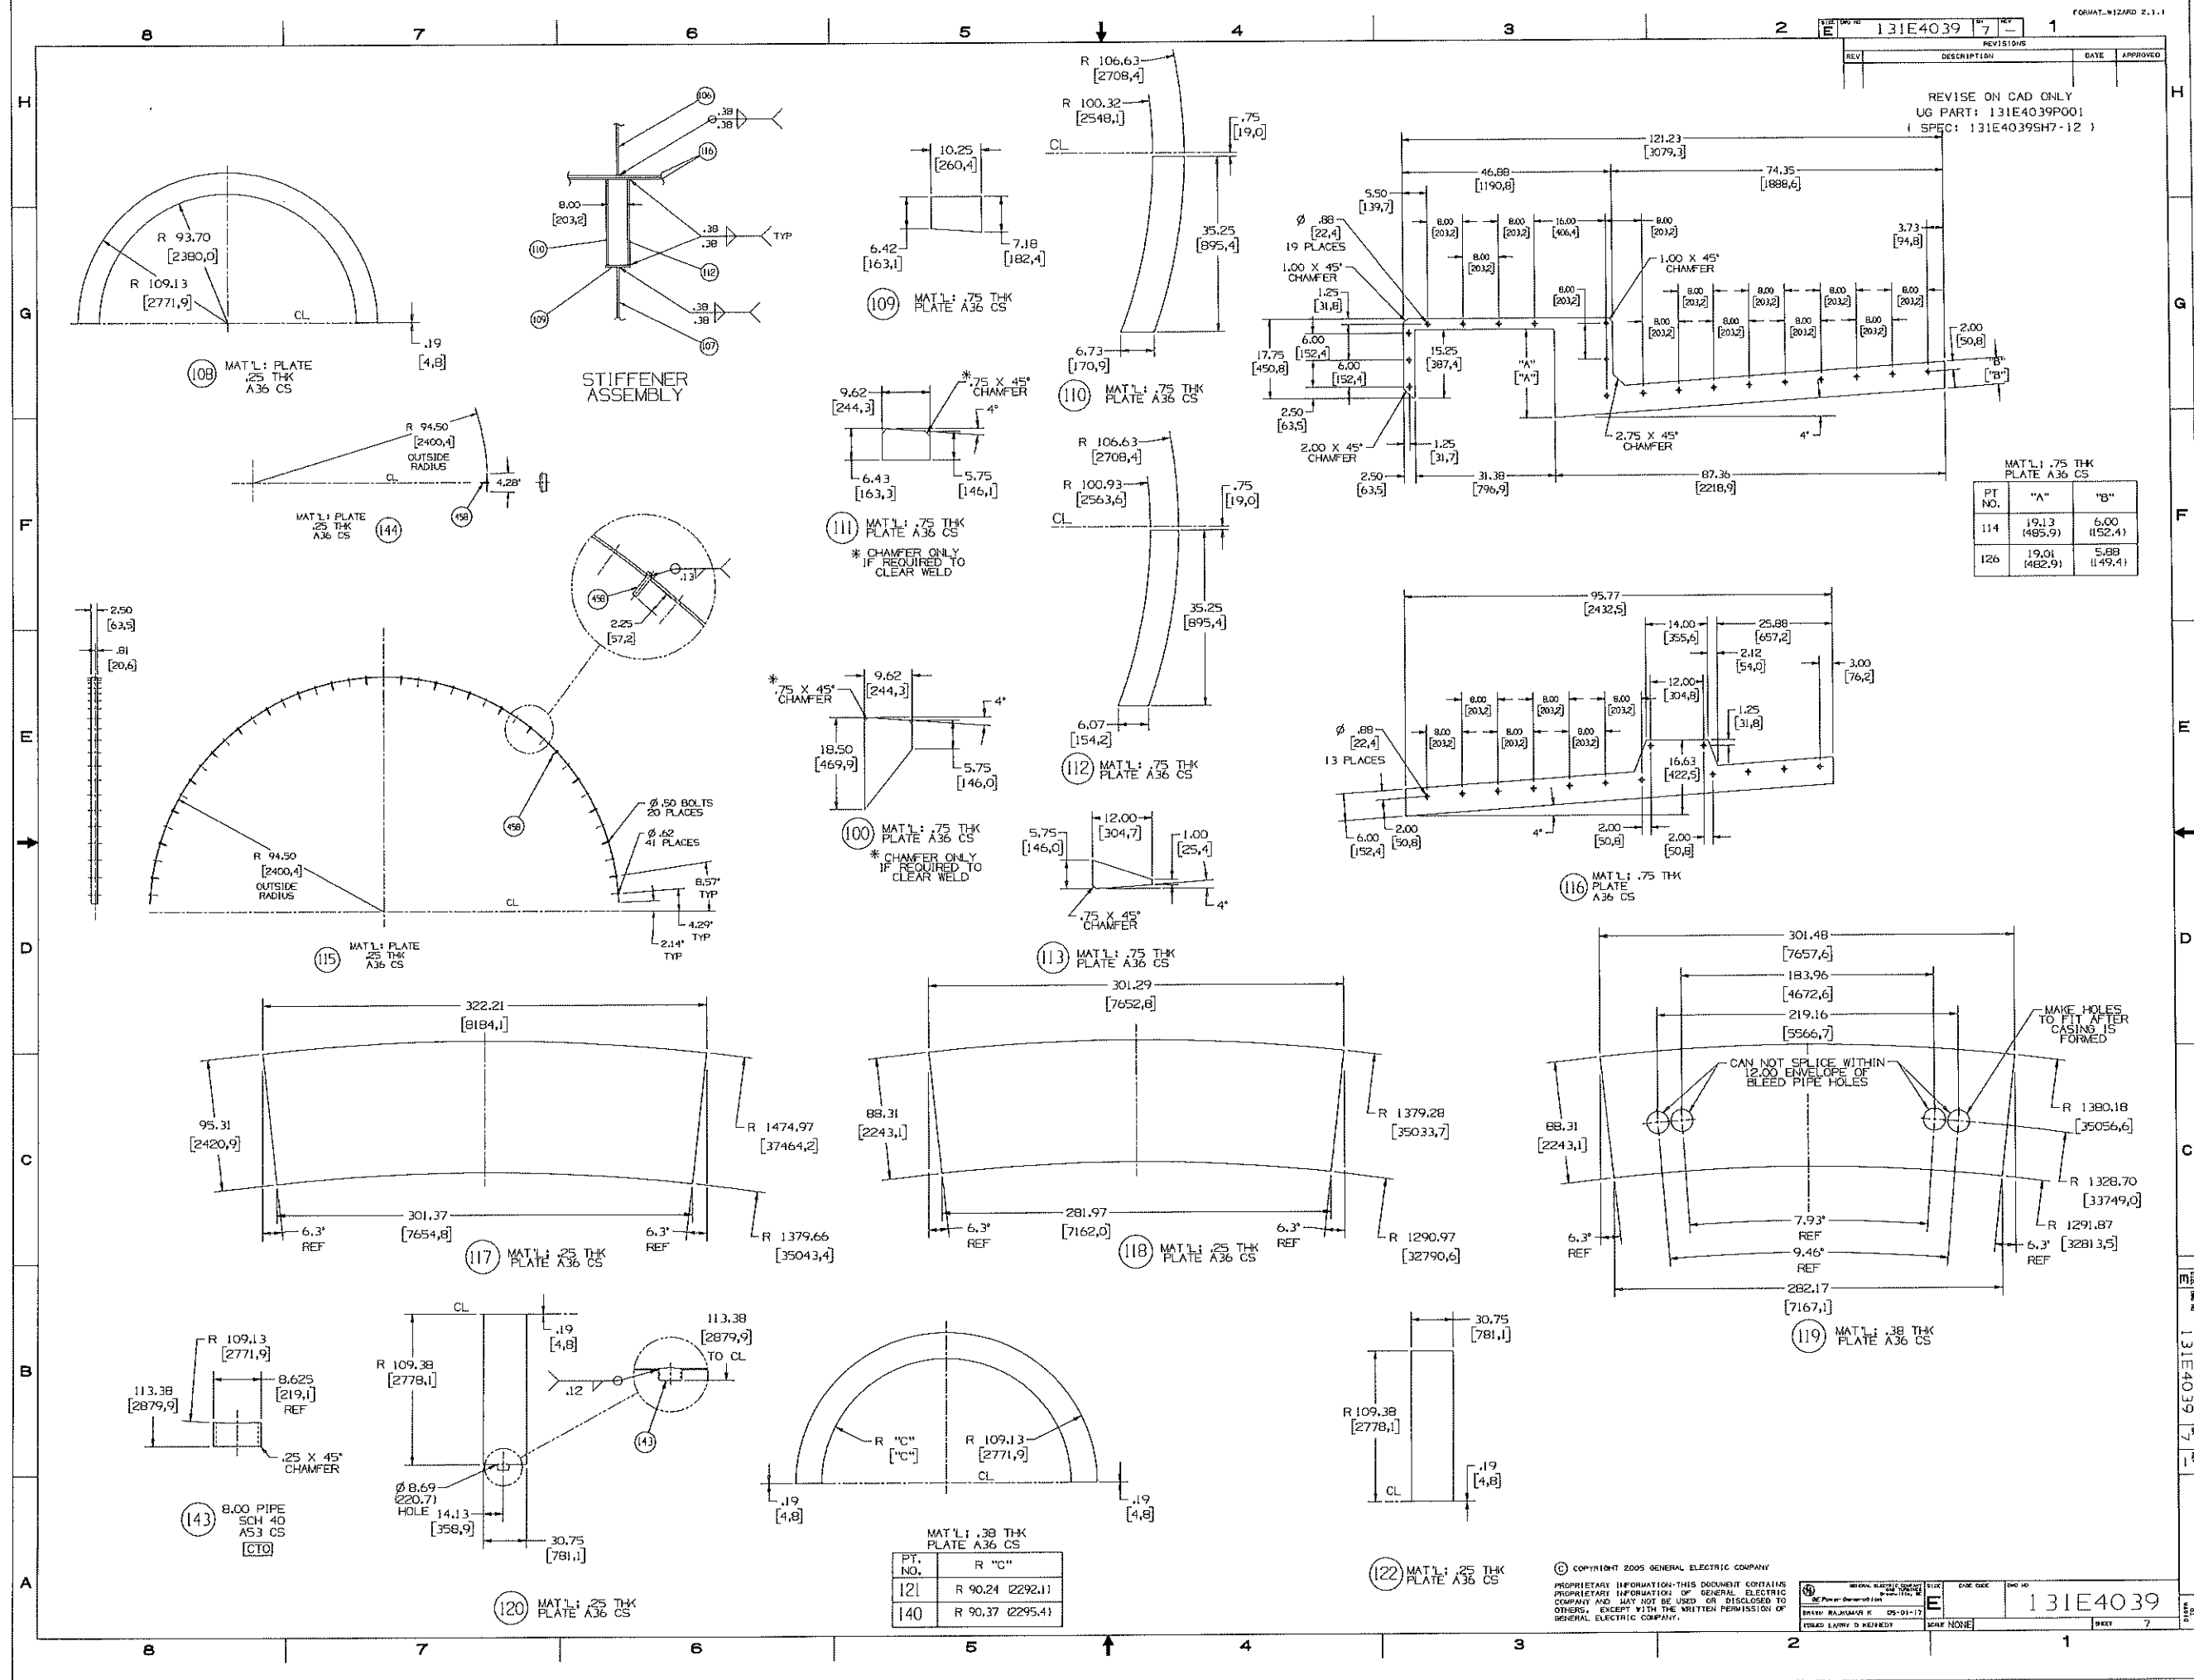

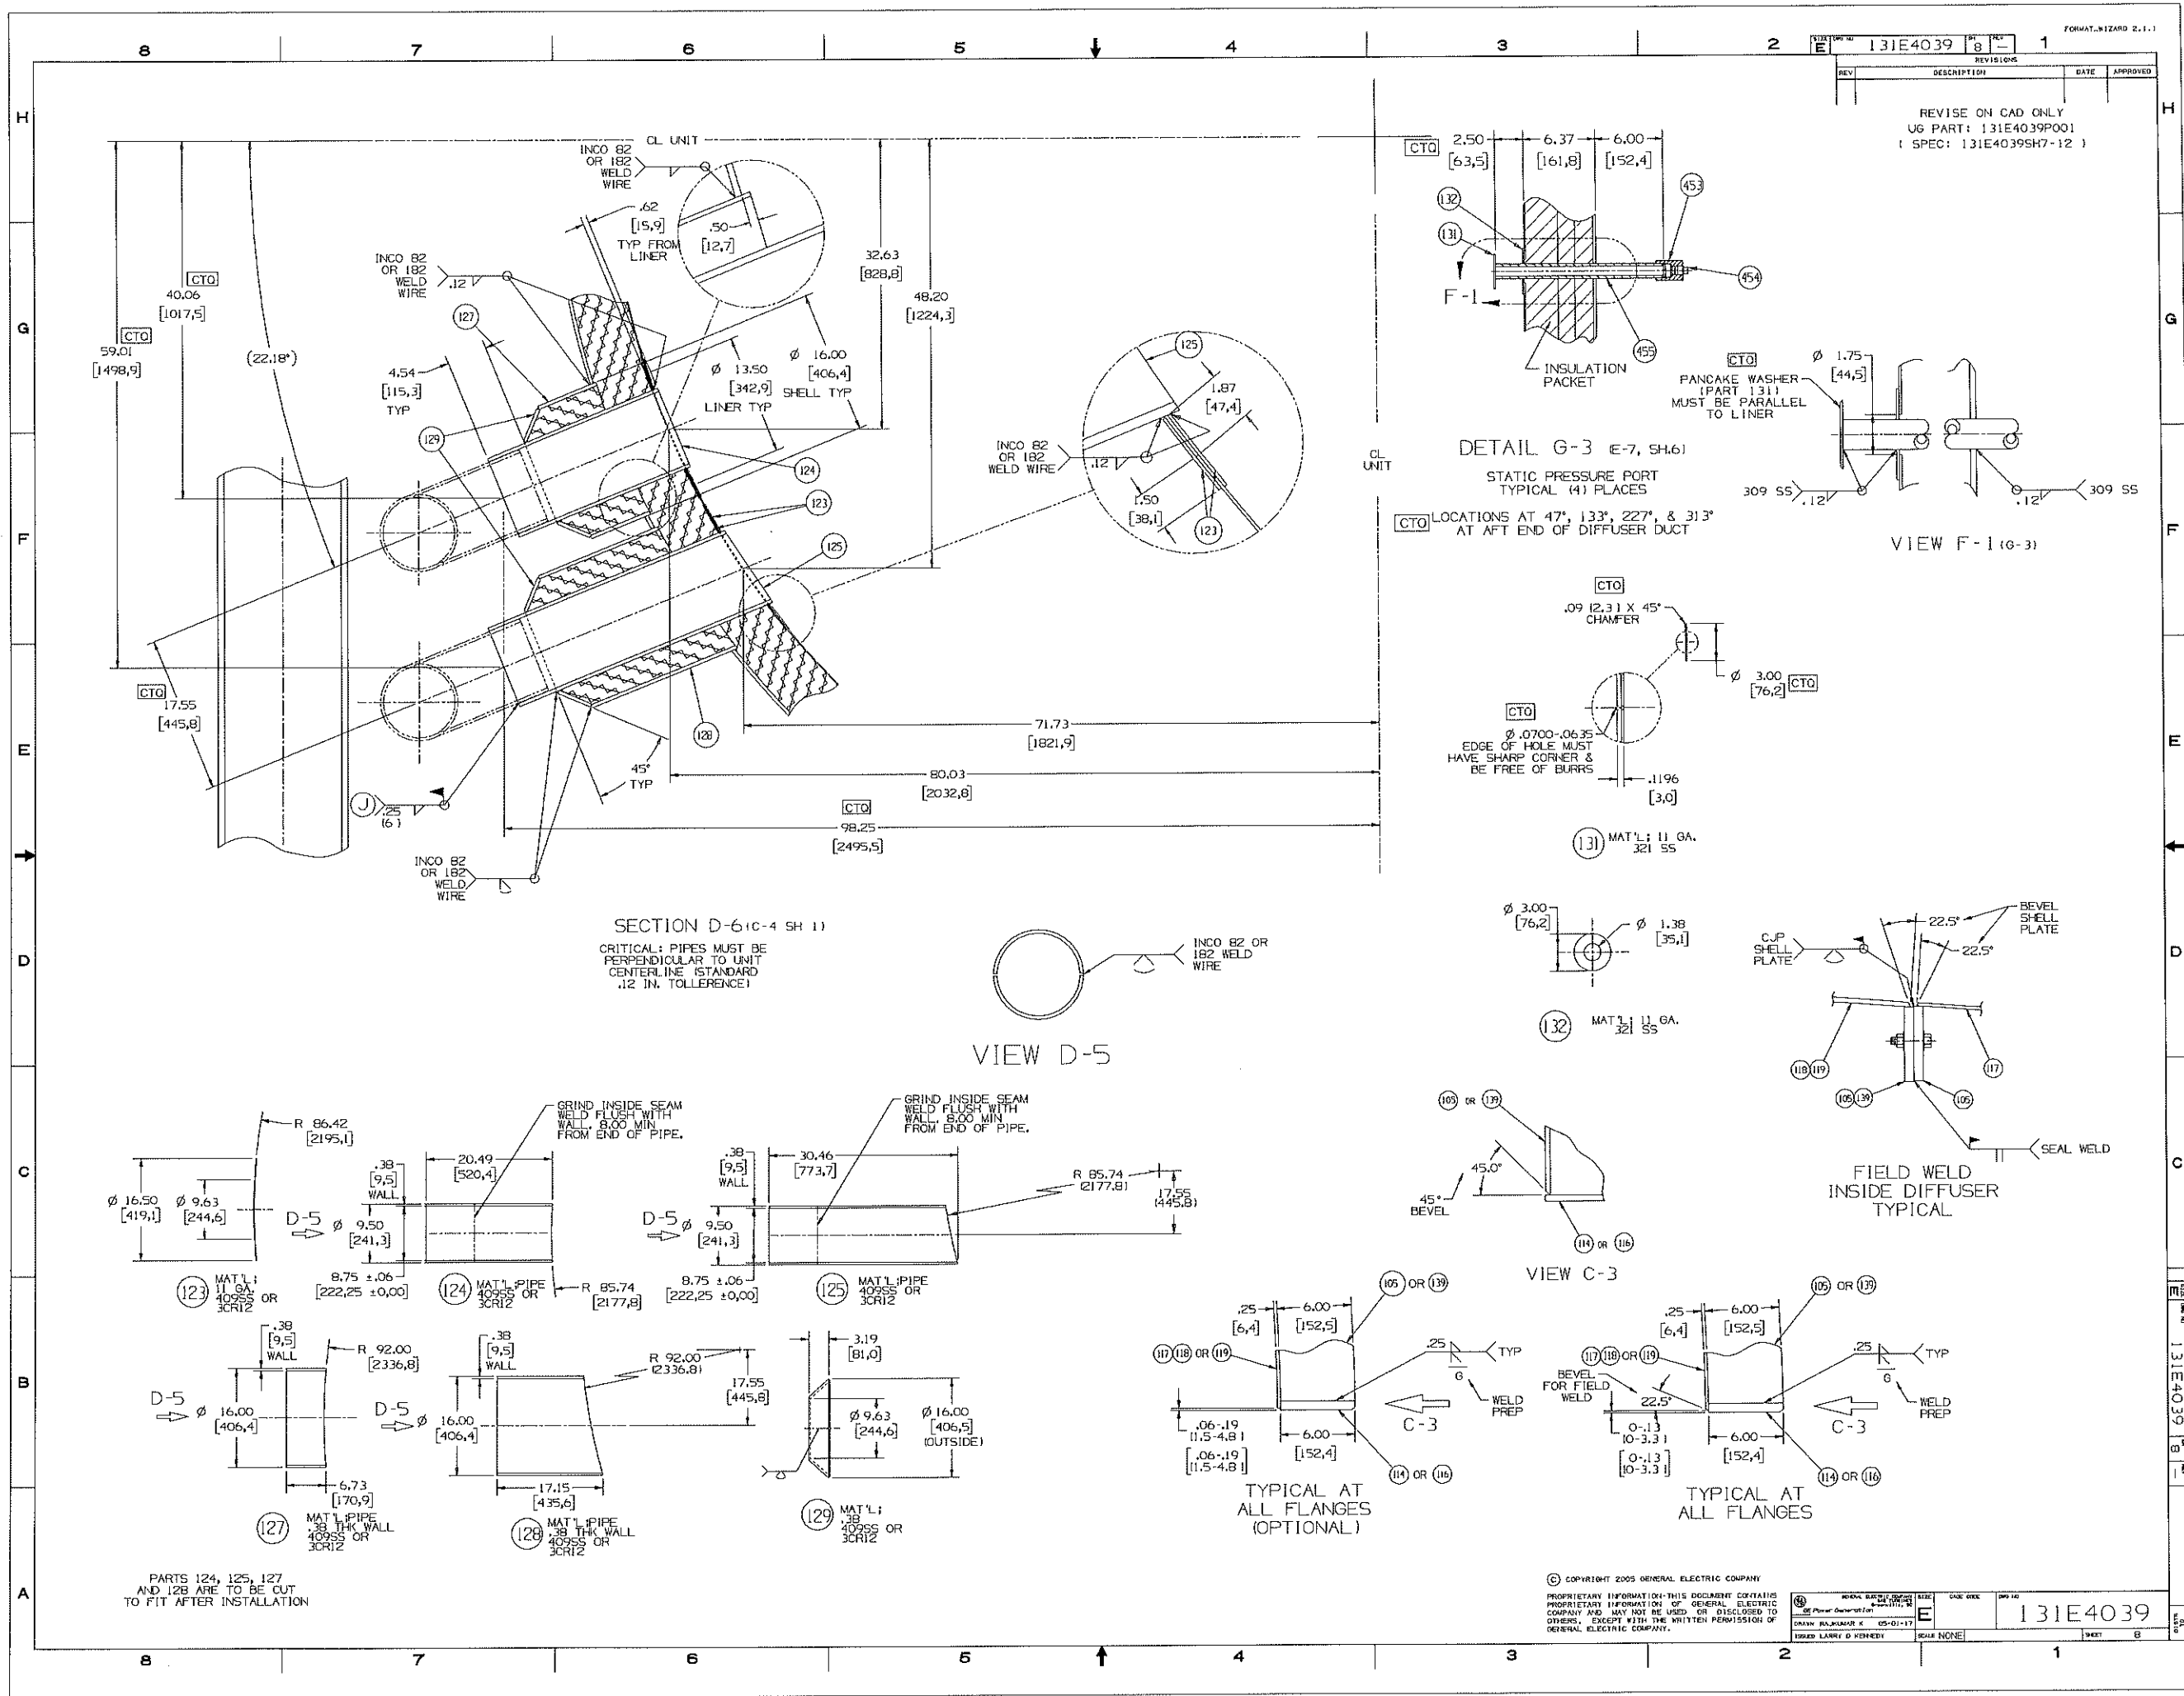

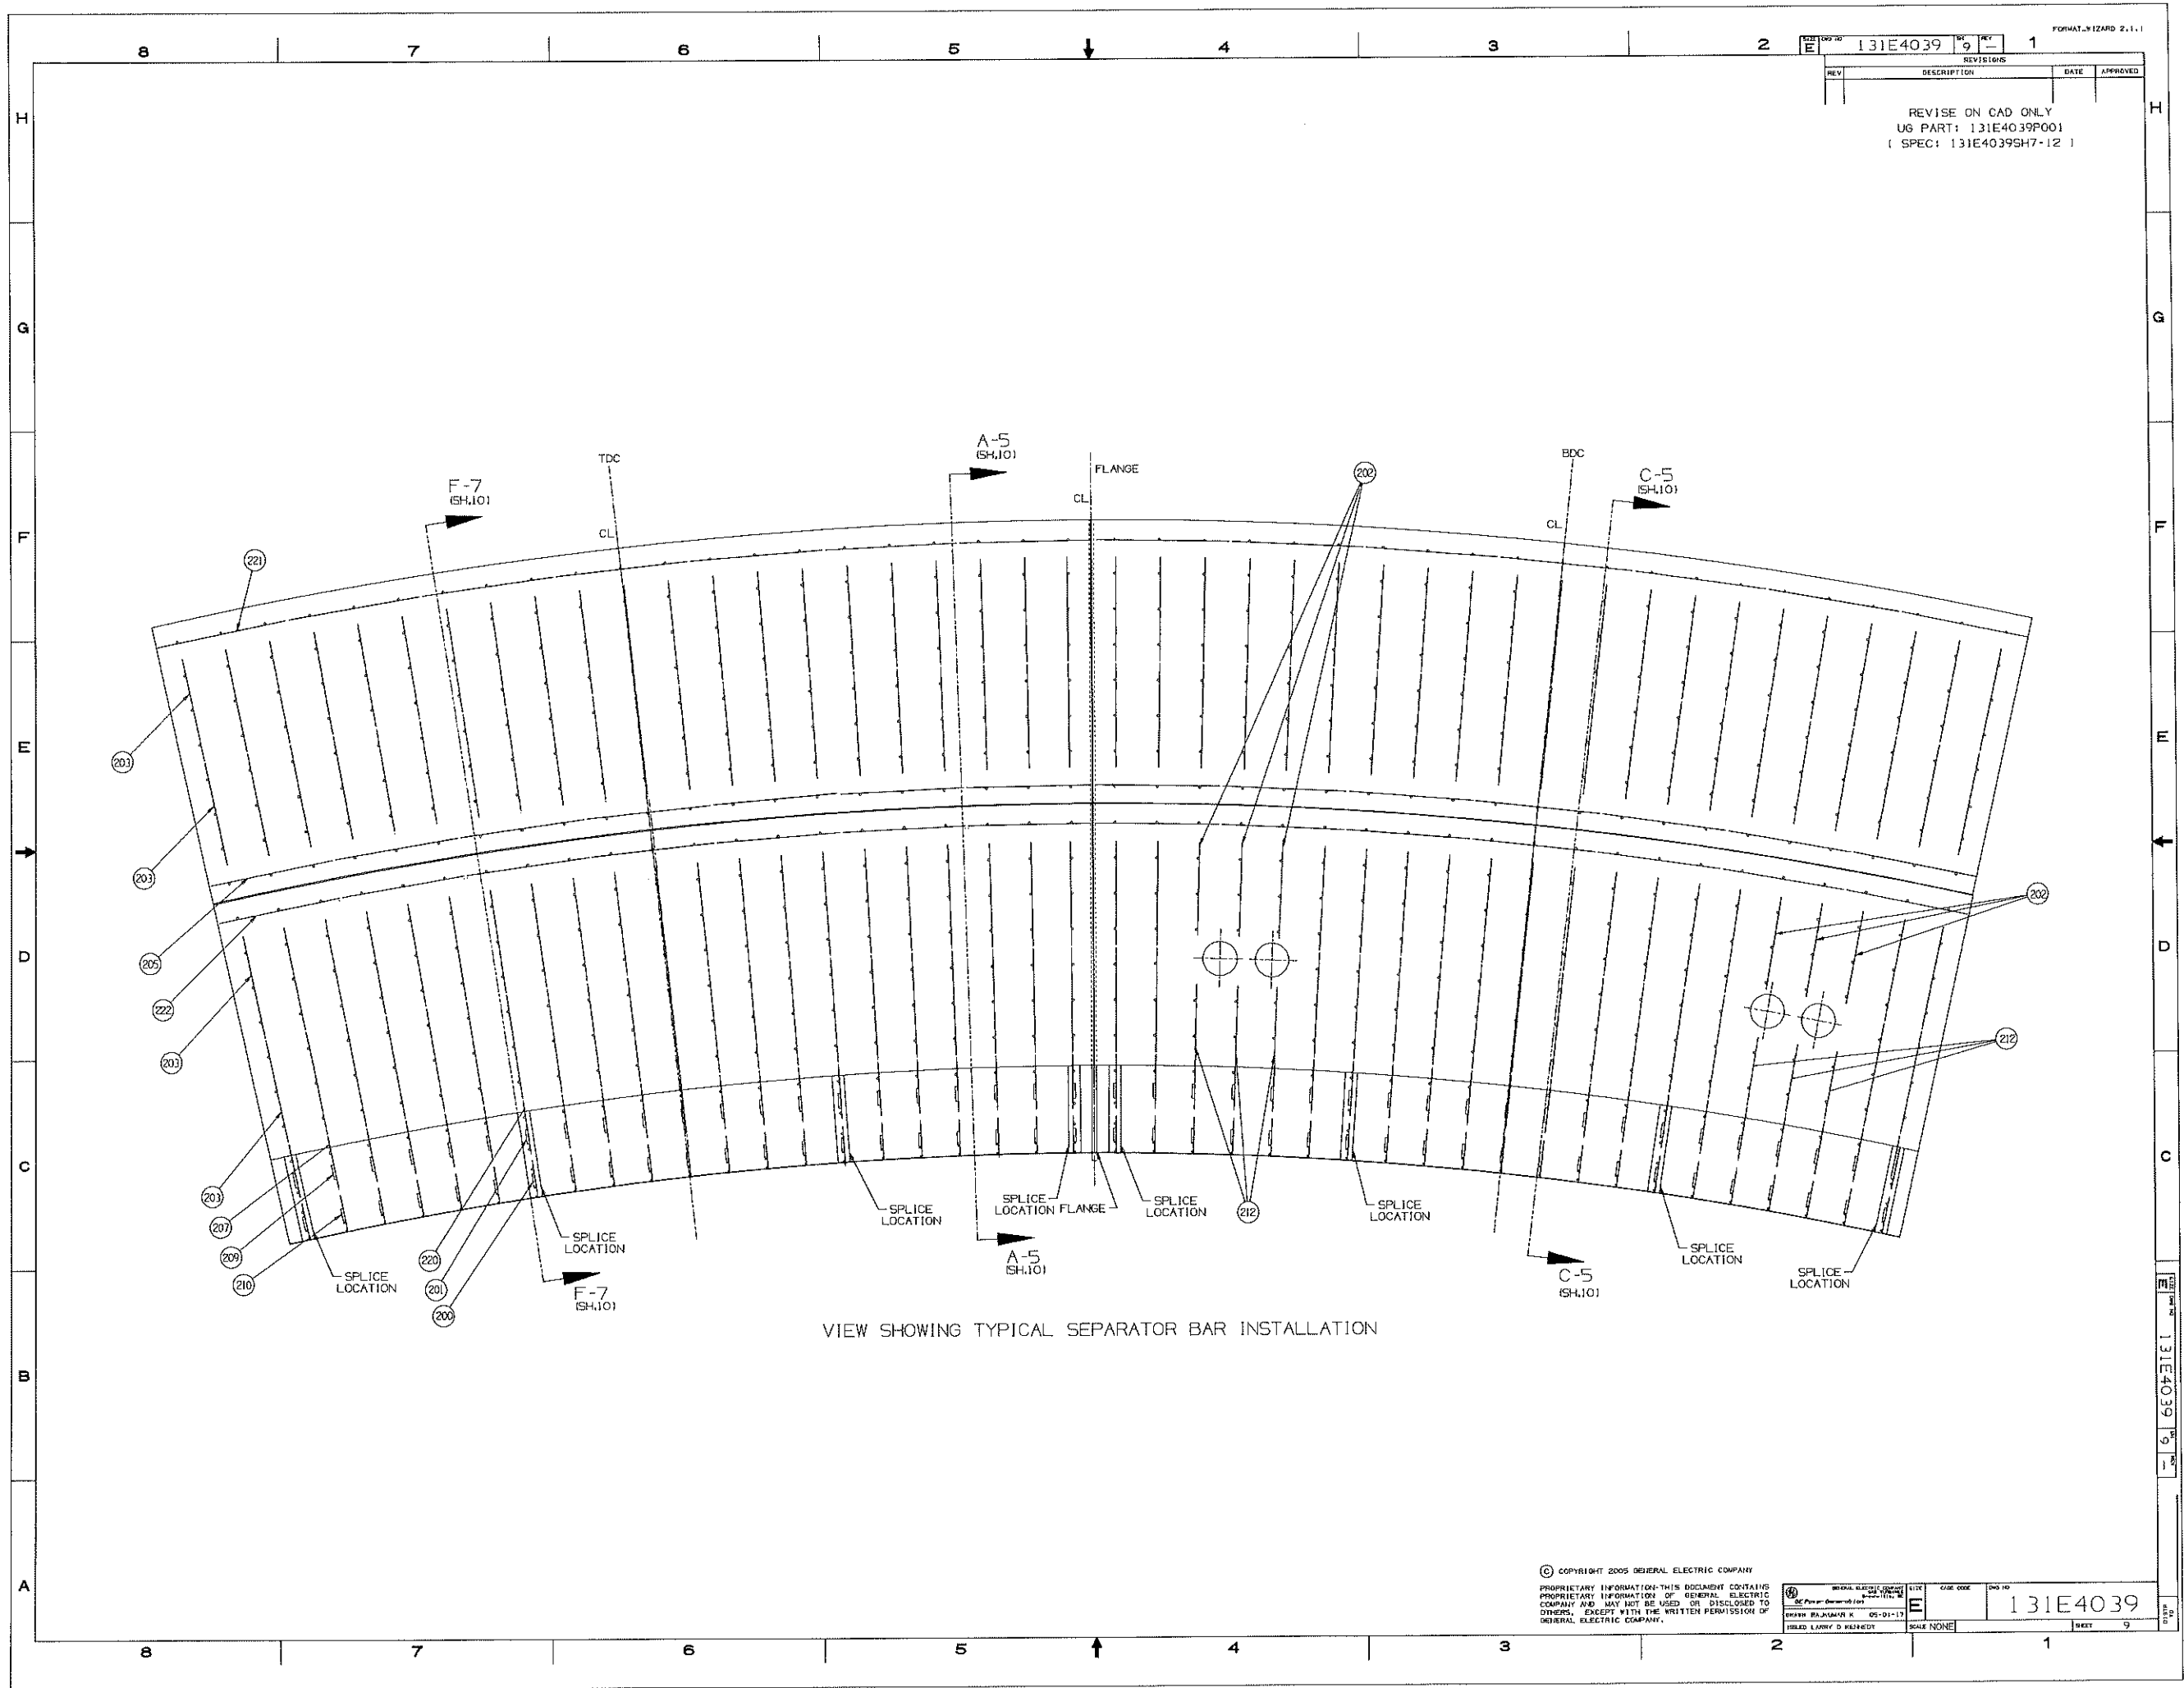

SECTION F-7 (C-7, SH.9)  
TYPICAL SEPARATOR BAR AND STUD SPACING  
AT SPLICES (TYP 8 PLACES)


GENERAL CIRCUMFERENTIAL  
SCALLOP BAR LOCATIONS


SECTION C-5 (F-3, SH.9)  
TYPICAL SEPARATOR BAR AND STUD SPACING


SECTION A-5 (F-5, SH.9)  
TYPICAL INSULATION INSTALLATION SHOWING  
CORNER DETAILS AND LAYERING

- NOTES:
1. CERAMIC FIBER PER G.E. SPEC ASD12 B4
  2. STAGGER CORNERS AS SHOWN
  3. USE FULL LENGTH PIECES OF INSULATION TO MINIMIZE STAGGERS
  4. WIDTH OF INSULATION TO BE .50 INCH WIDER THAN SPACING FOR SPACES OF 12.00 INCHES OR LESS.  
WIDTH OF INSULATION TO BE 1.00 INCH WIDER THAN SPACING FOR SPACES GREATER THAN 12.00 INCHES.




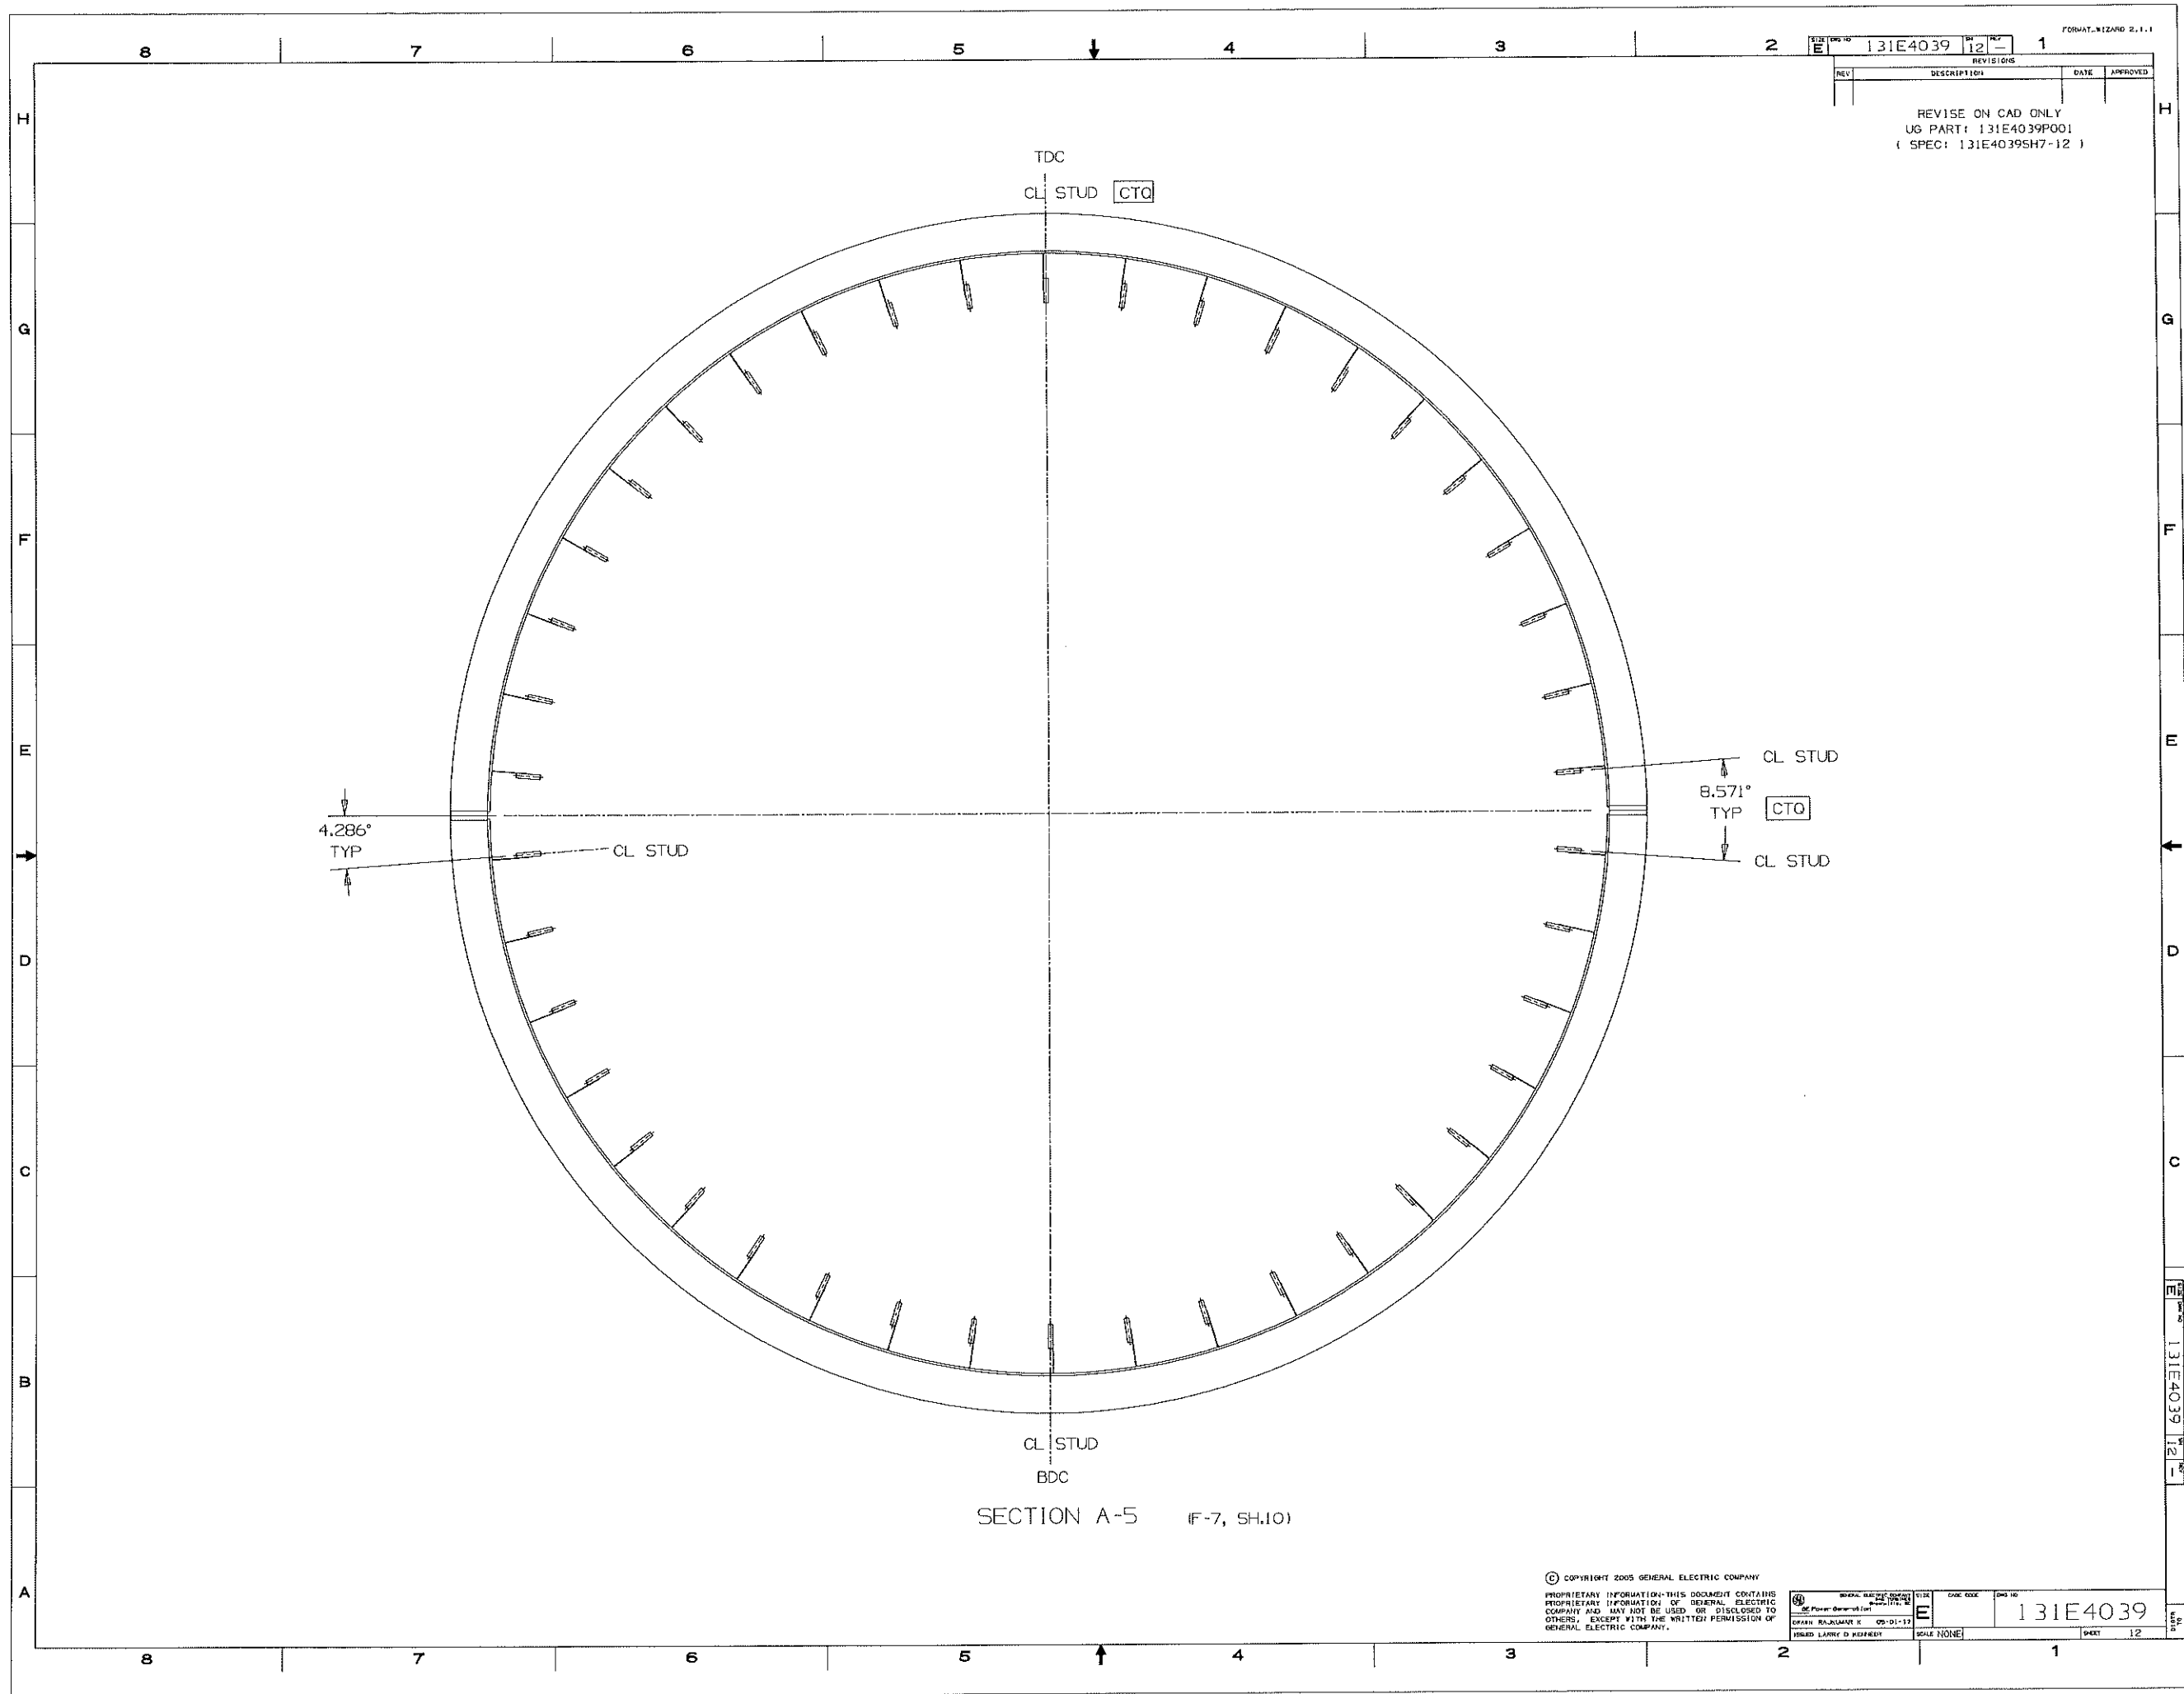


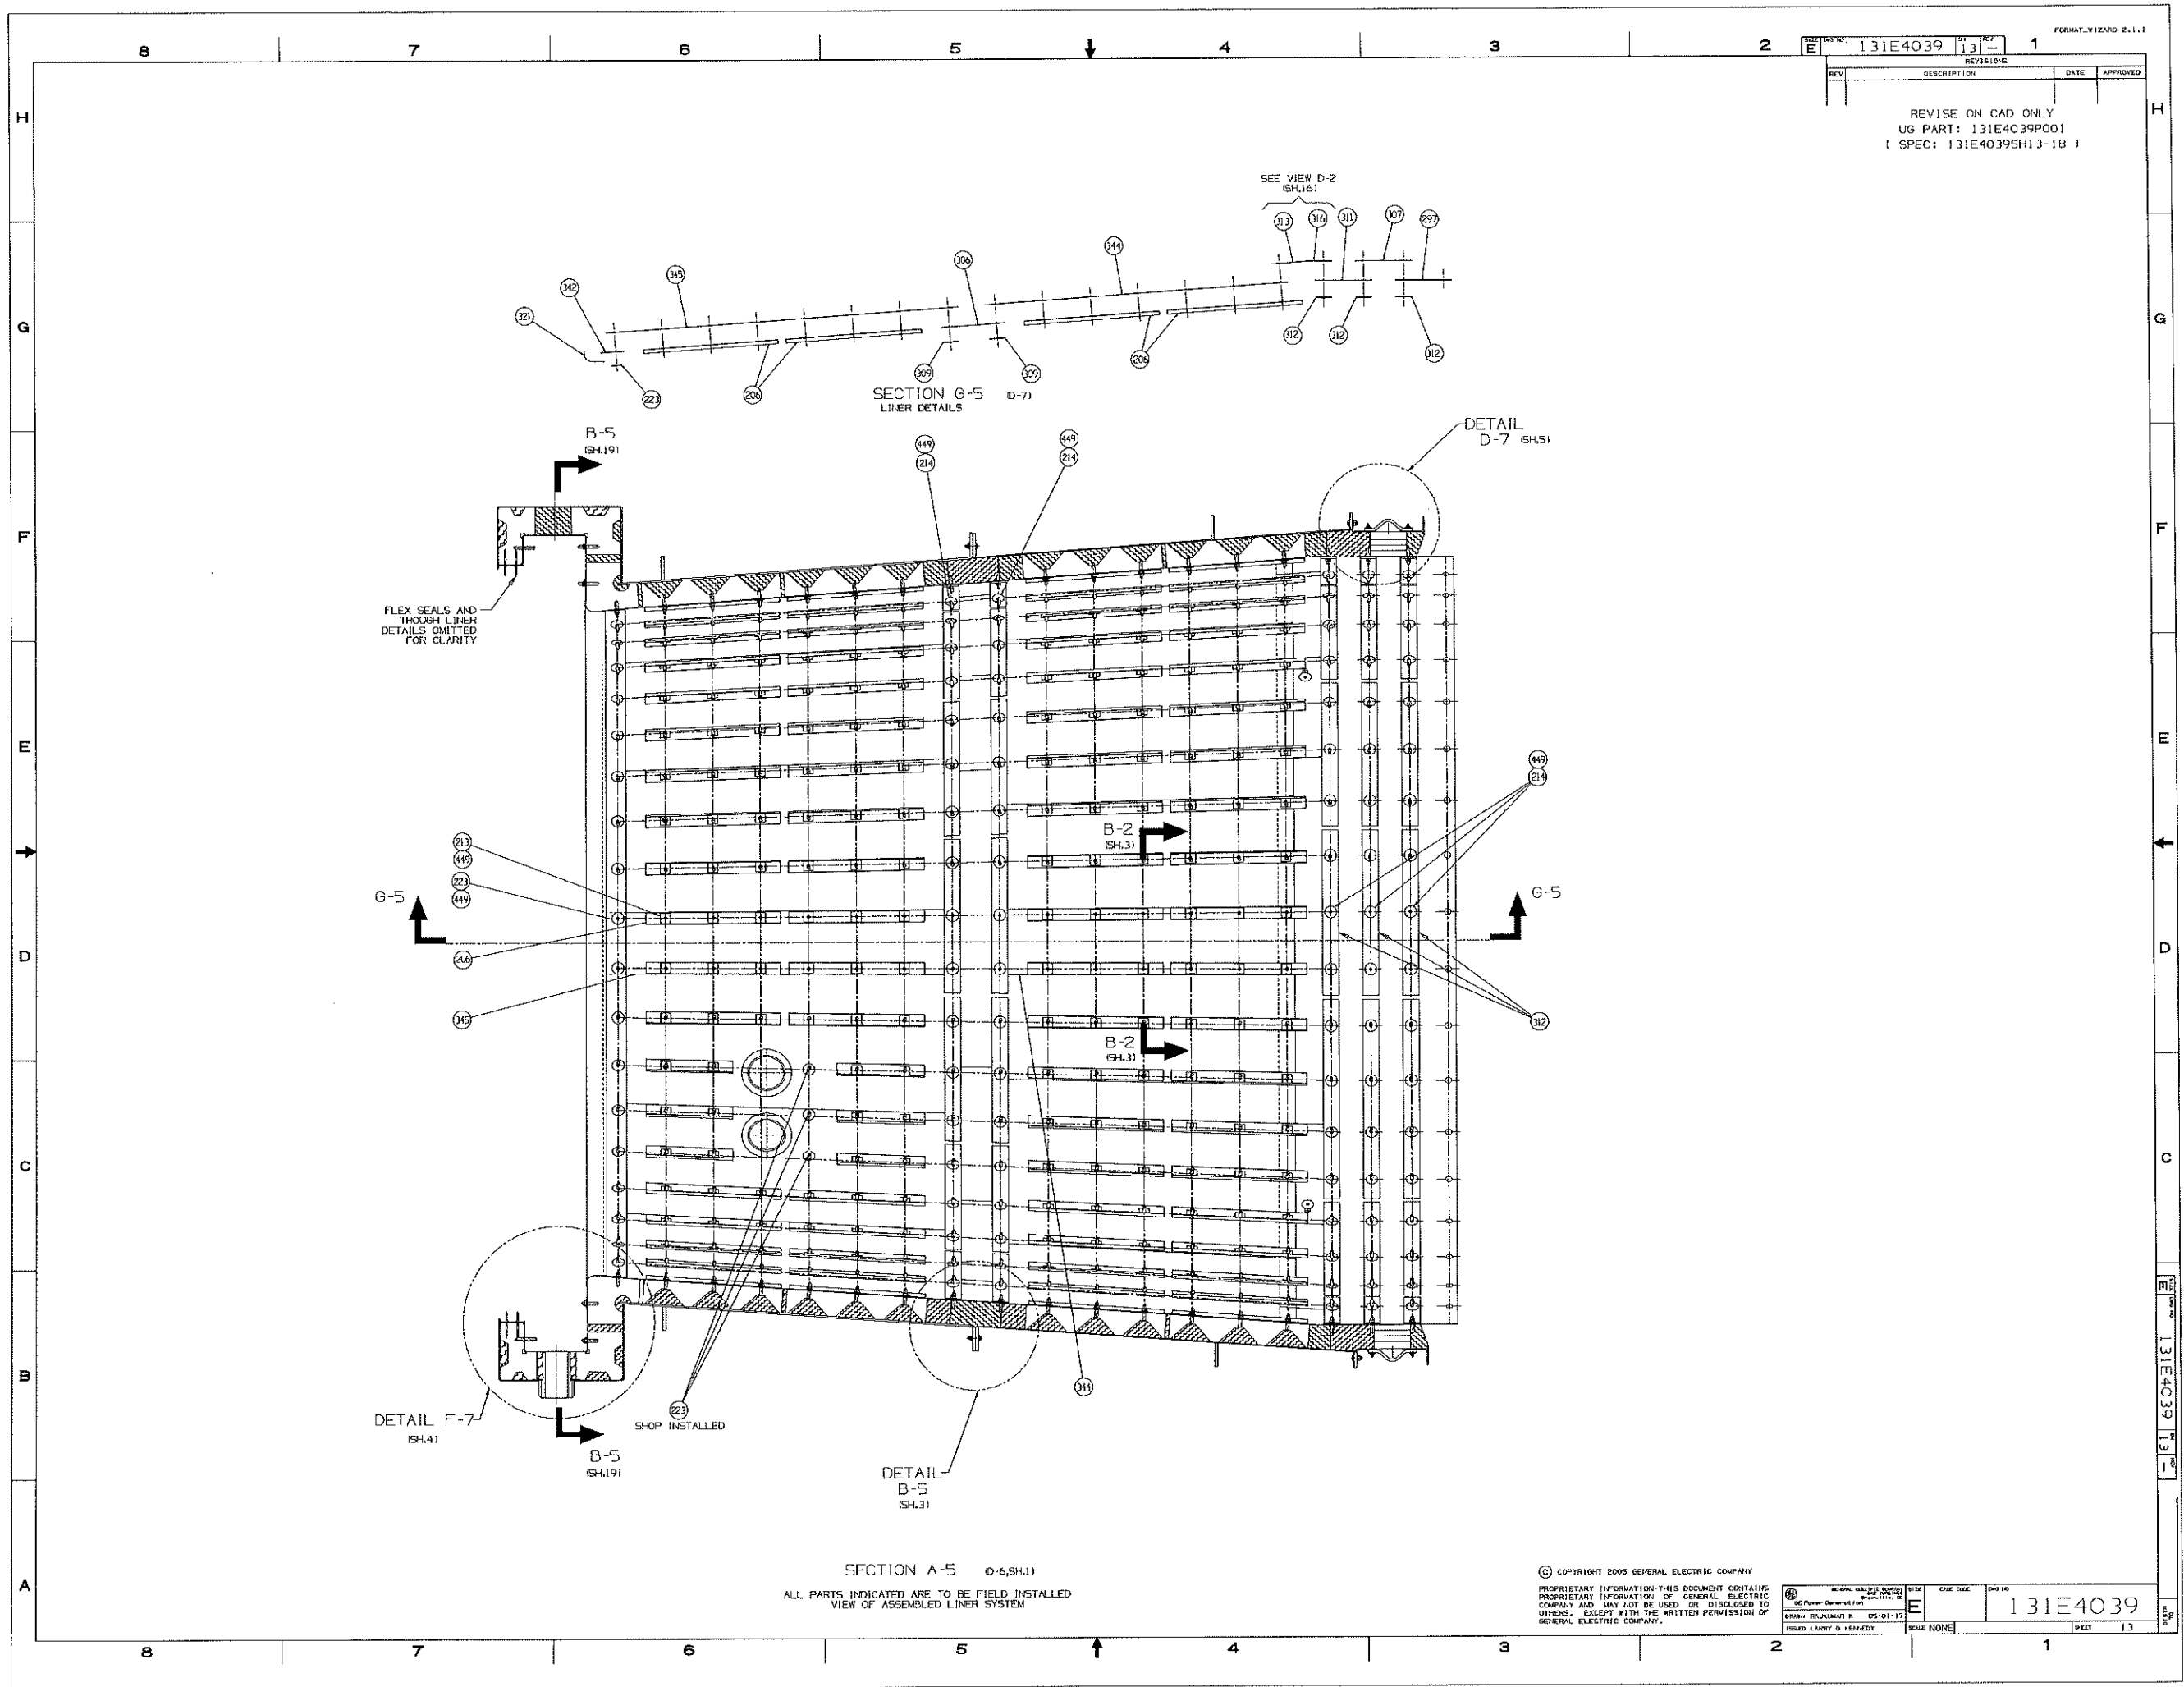

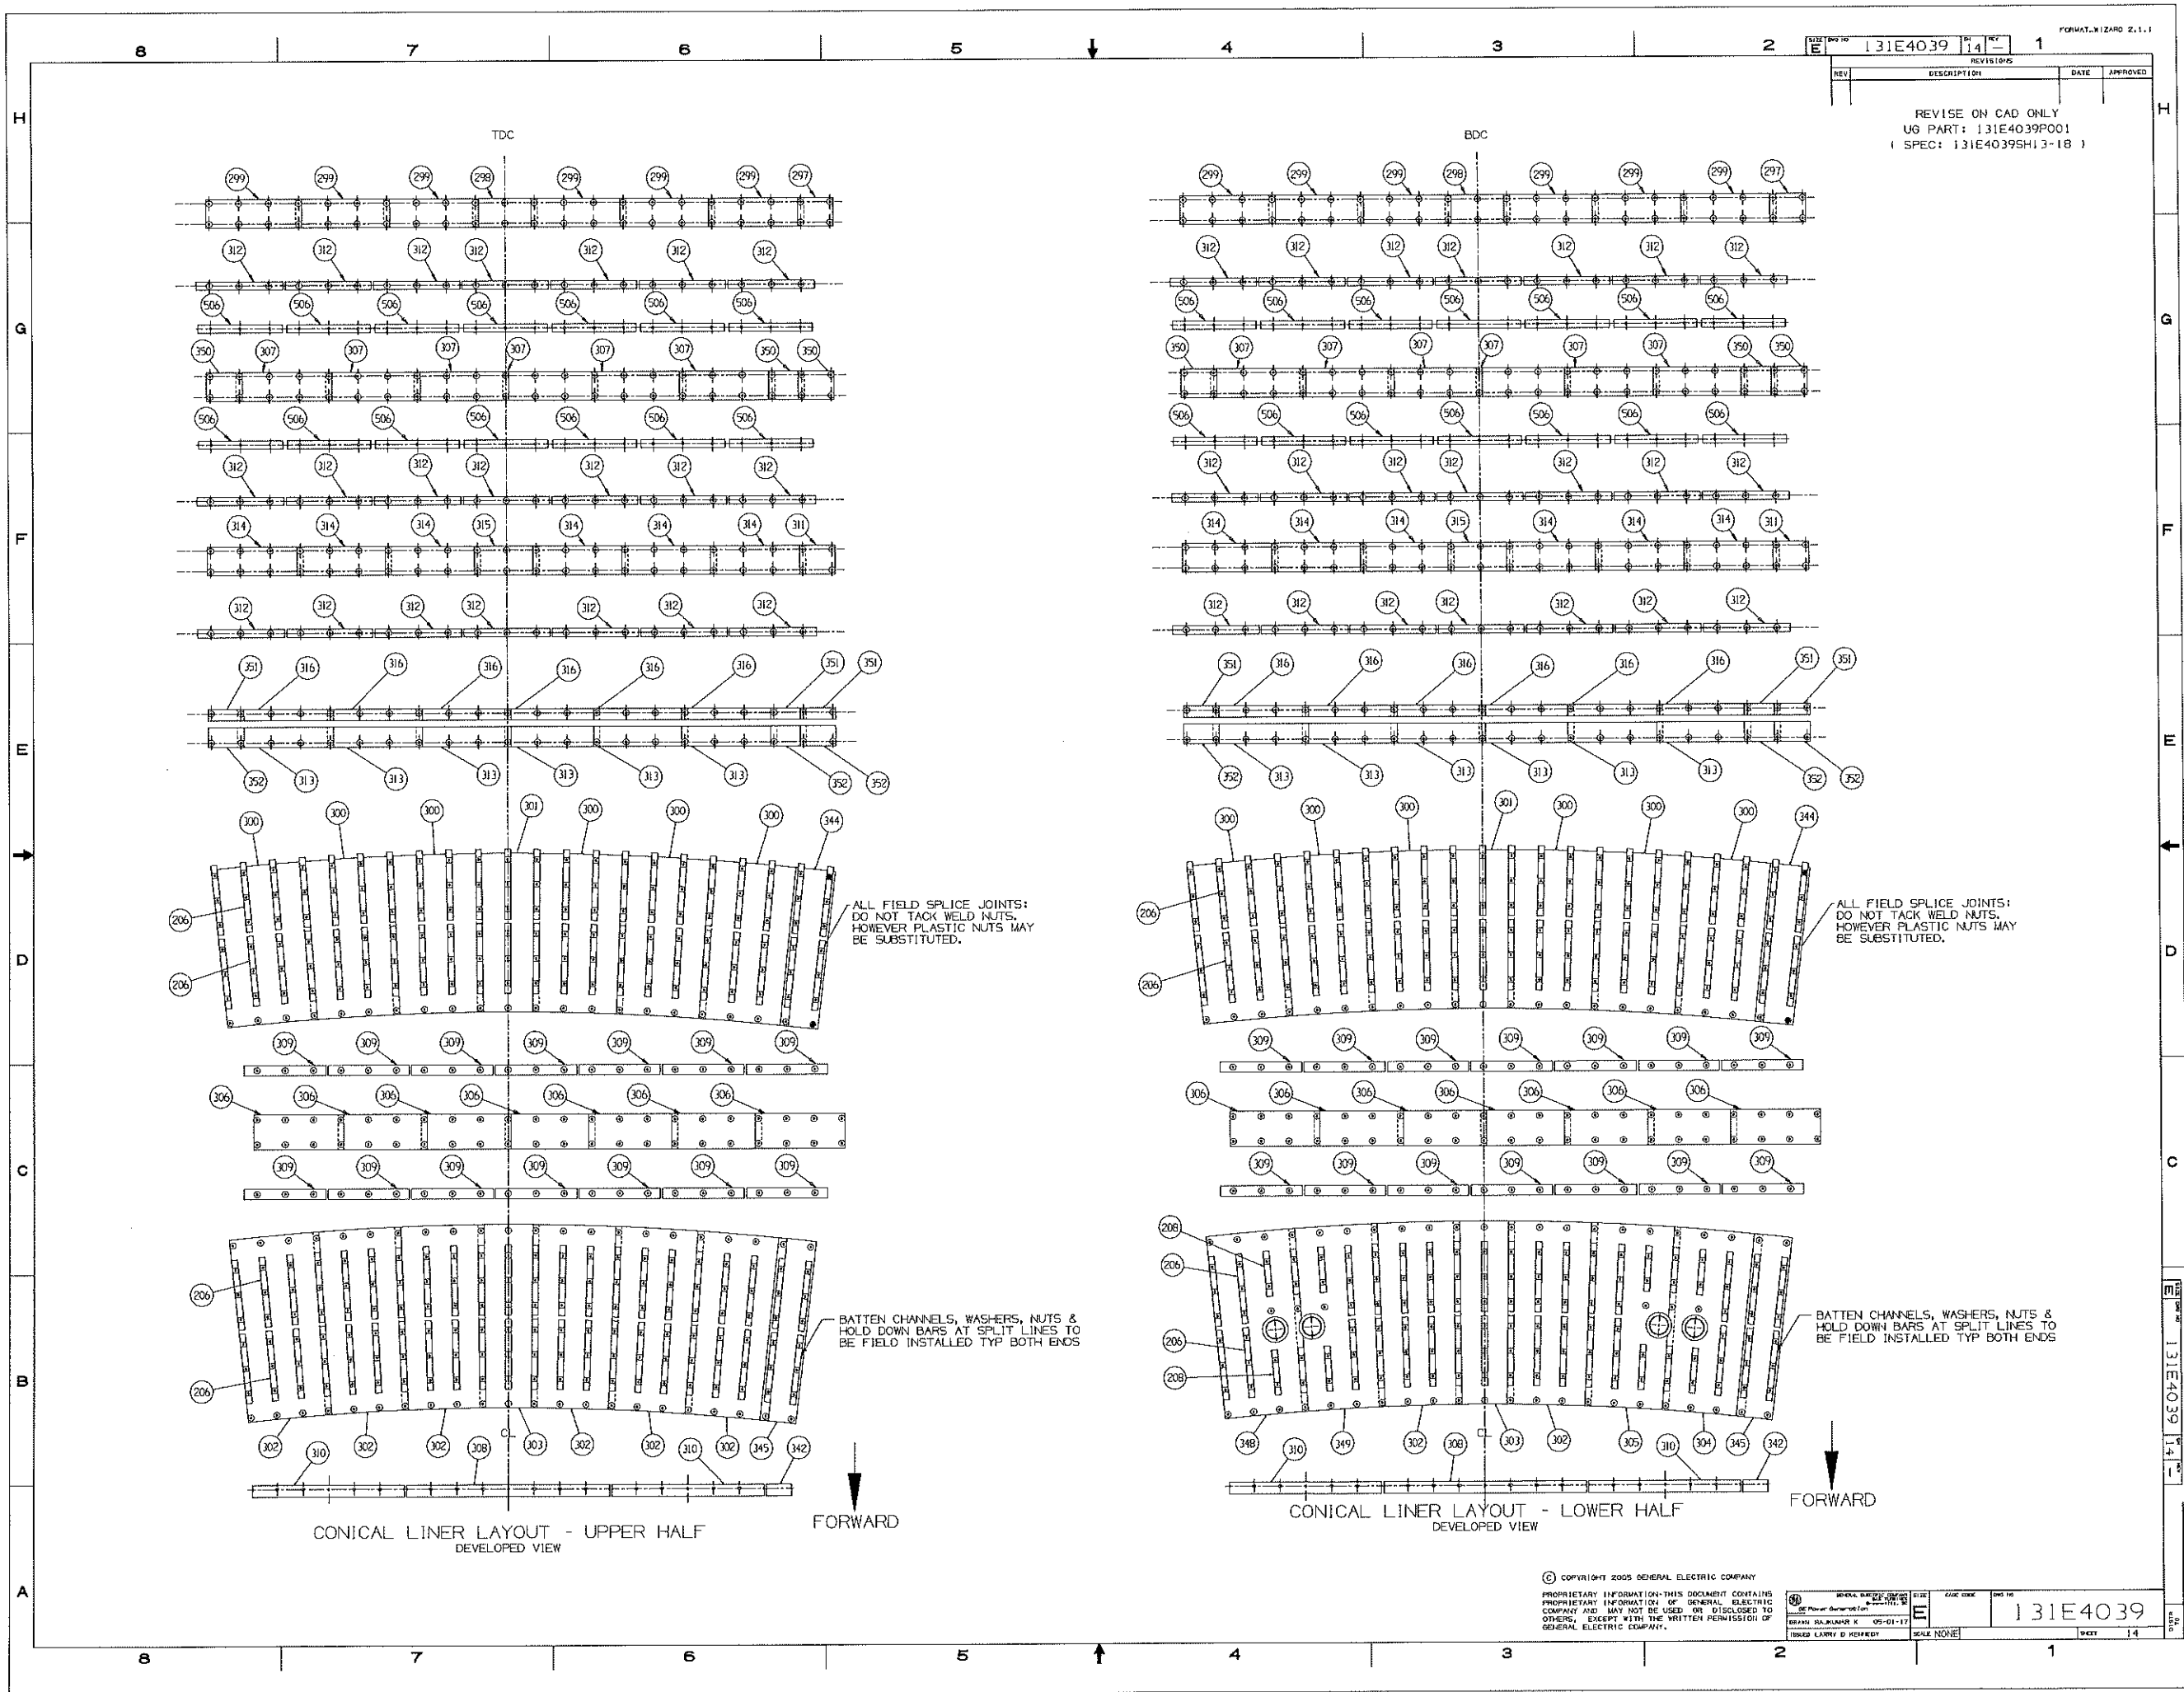



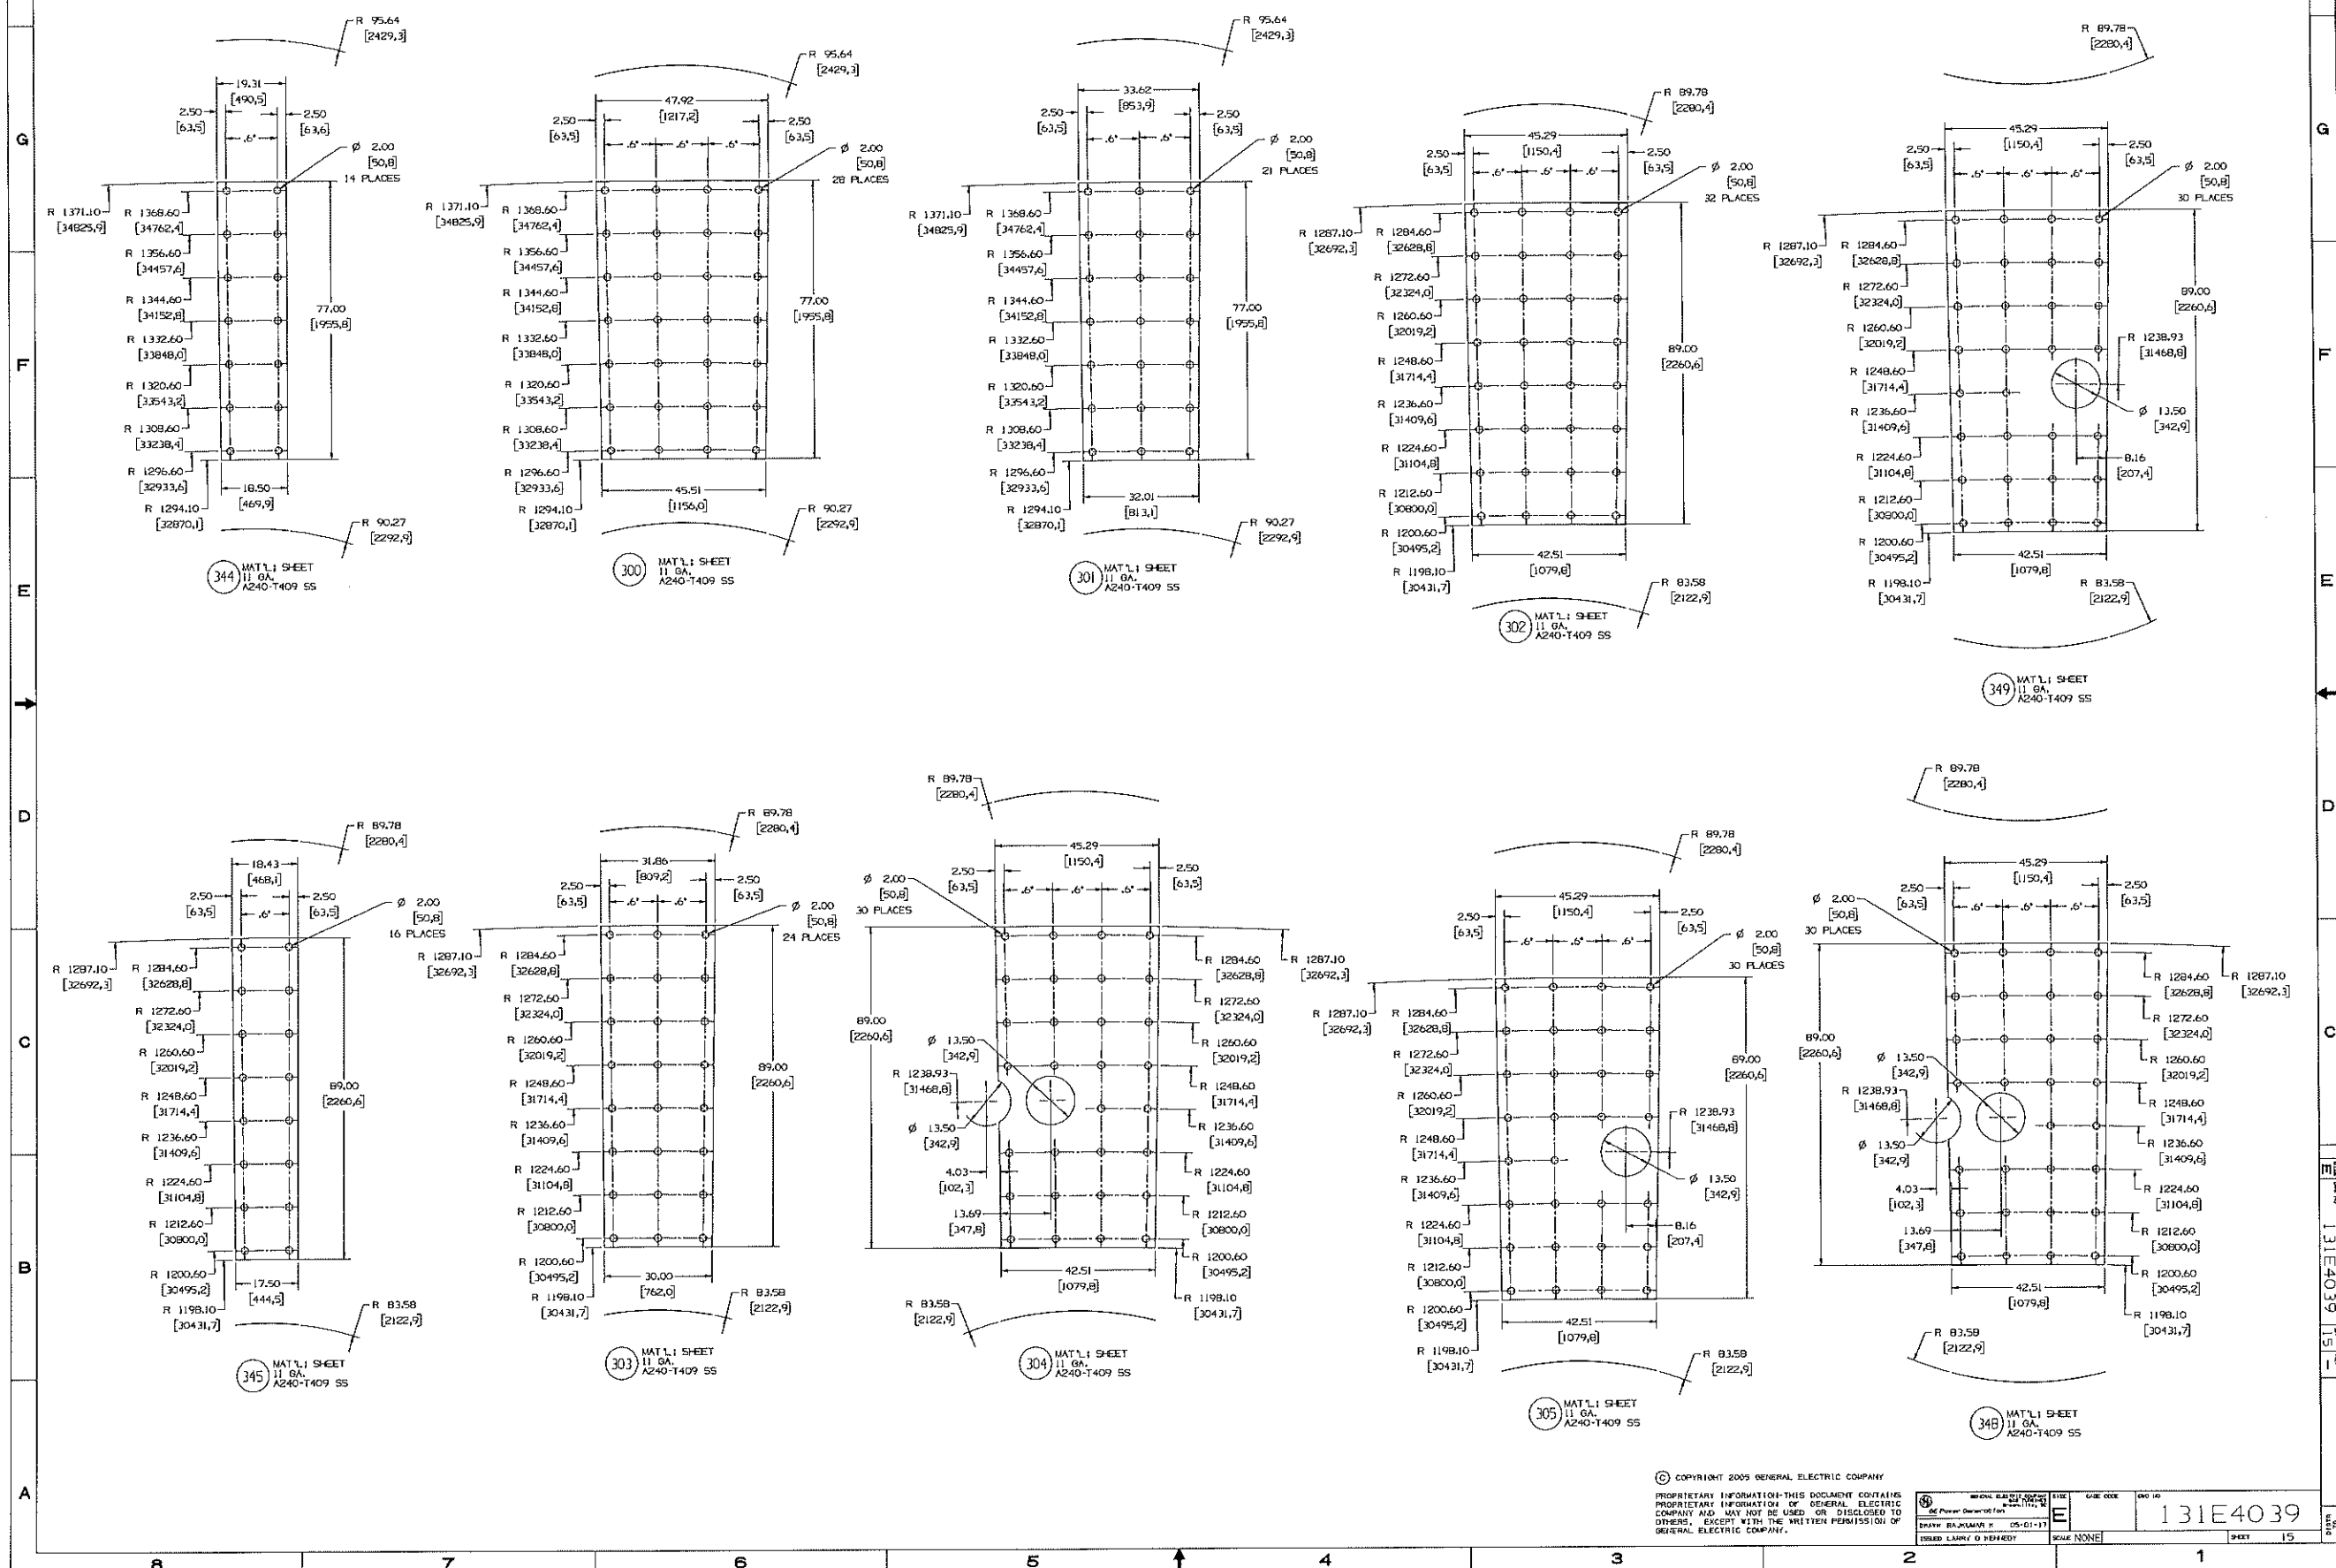

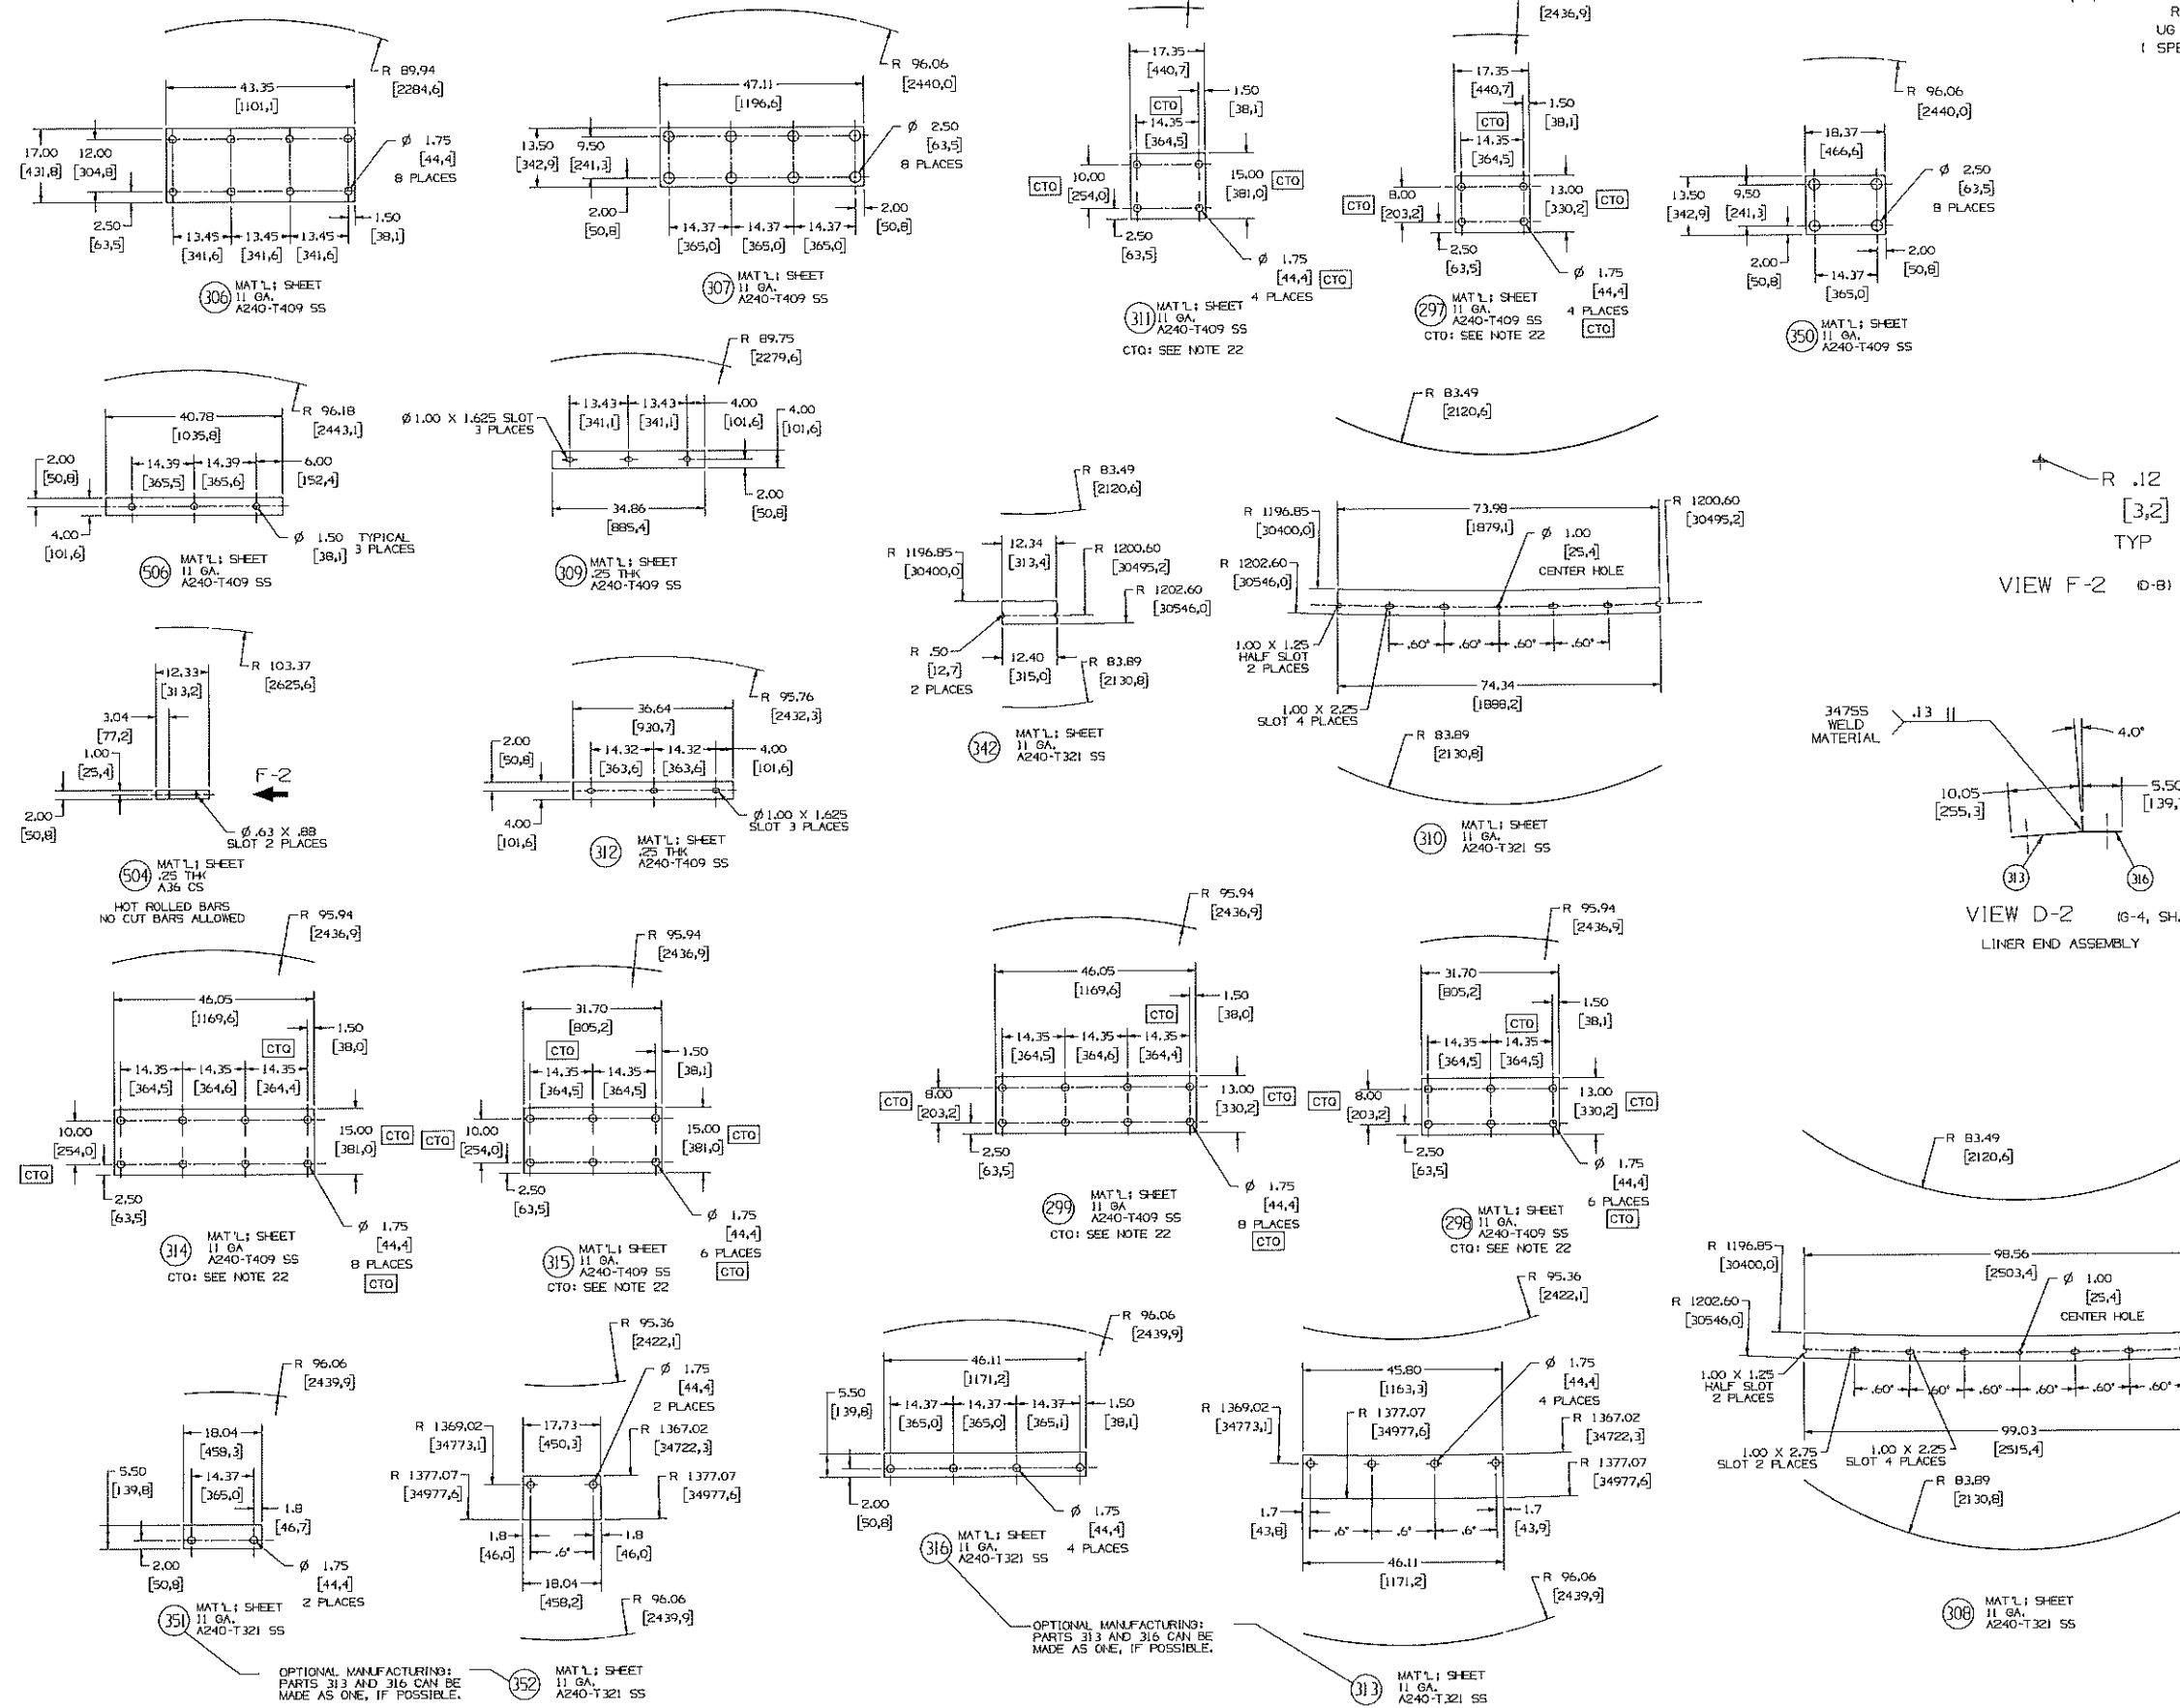
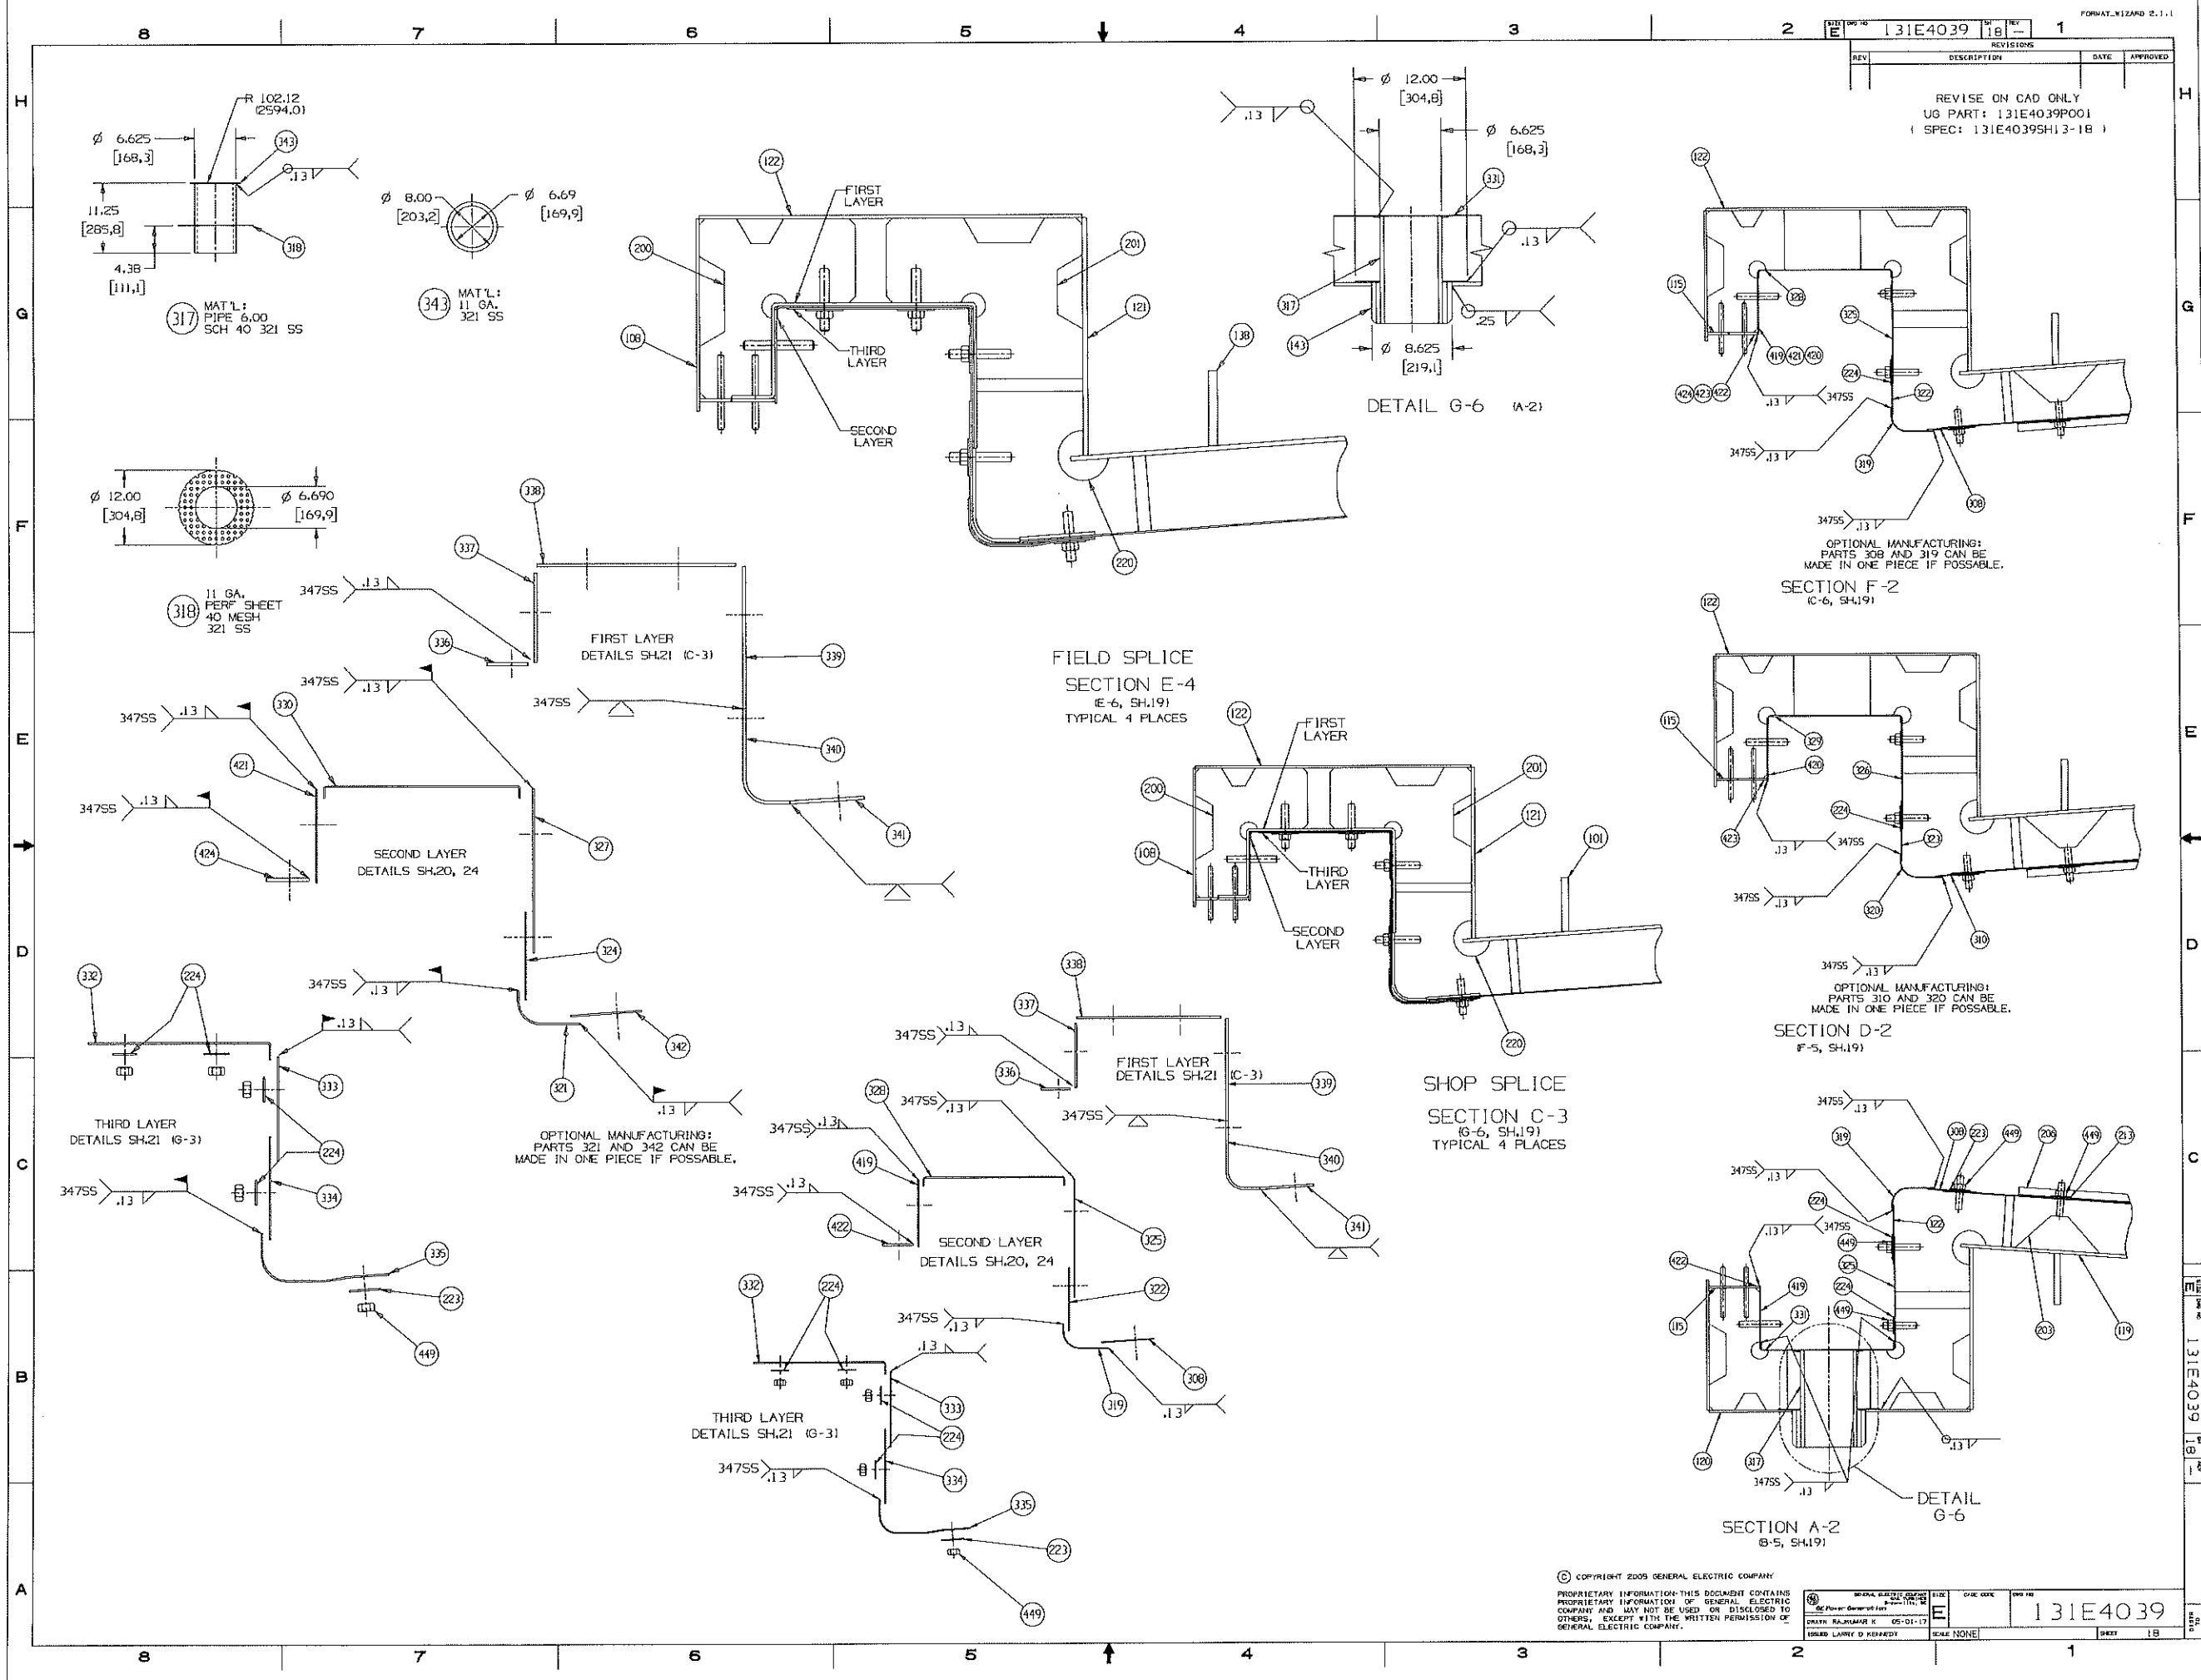


© COPYRIGHT 2005 GENERAL ELECTRIC COMPANY

PROPRIETARY INFORMATION-THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF GENERAL ELECTRIC COMPANY AND MAY NOT BE USED OR DISCLOSED TO OTHERS, EXCEPT WITH THE WRITTEN PERMISSION OF GENERAL ELECTRIC COMPANY.

INSTRUMENT TO OF	 FEDERAL BUREAU OF INVESTIGATION DEPARTMENT OF JUSTICE WASHINGTON, DC 20535	SIZE <b>E</b>	CASE CODE 131E4039	DWG NO 16	FILED 16
	ME Floor Security for 05-01-17	ISSUED BY LARRY D KENNEDY	SCALE NONE	SHEET 16	






REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
1	REVISE ON CAD ONLY UG PART: 131E4039P001 (SPEC: 131E40395H13-1B)		


© COPYRIGHT 2005 GENERAL ELECTRIC COMPANY

PROPRIETARY INFORMATION-THIS DOCUMENT CONTAINS  
PROPRIETARY INFORMATION OF GENERAL ELECTRIC  
COMPANY AND MAY NOT BE USED OR DISCLOSED TO  
OTHERS, EXCEPT WITH THE WRITTEN PERMISSION OF  
GENERAL ELECTRIC COMPANY.


131E4039	18	1
131E4039	18	1
131E4039	18	1

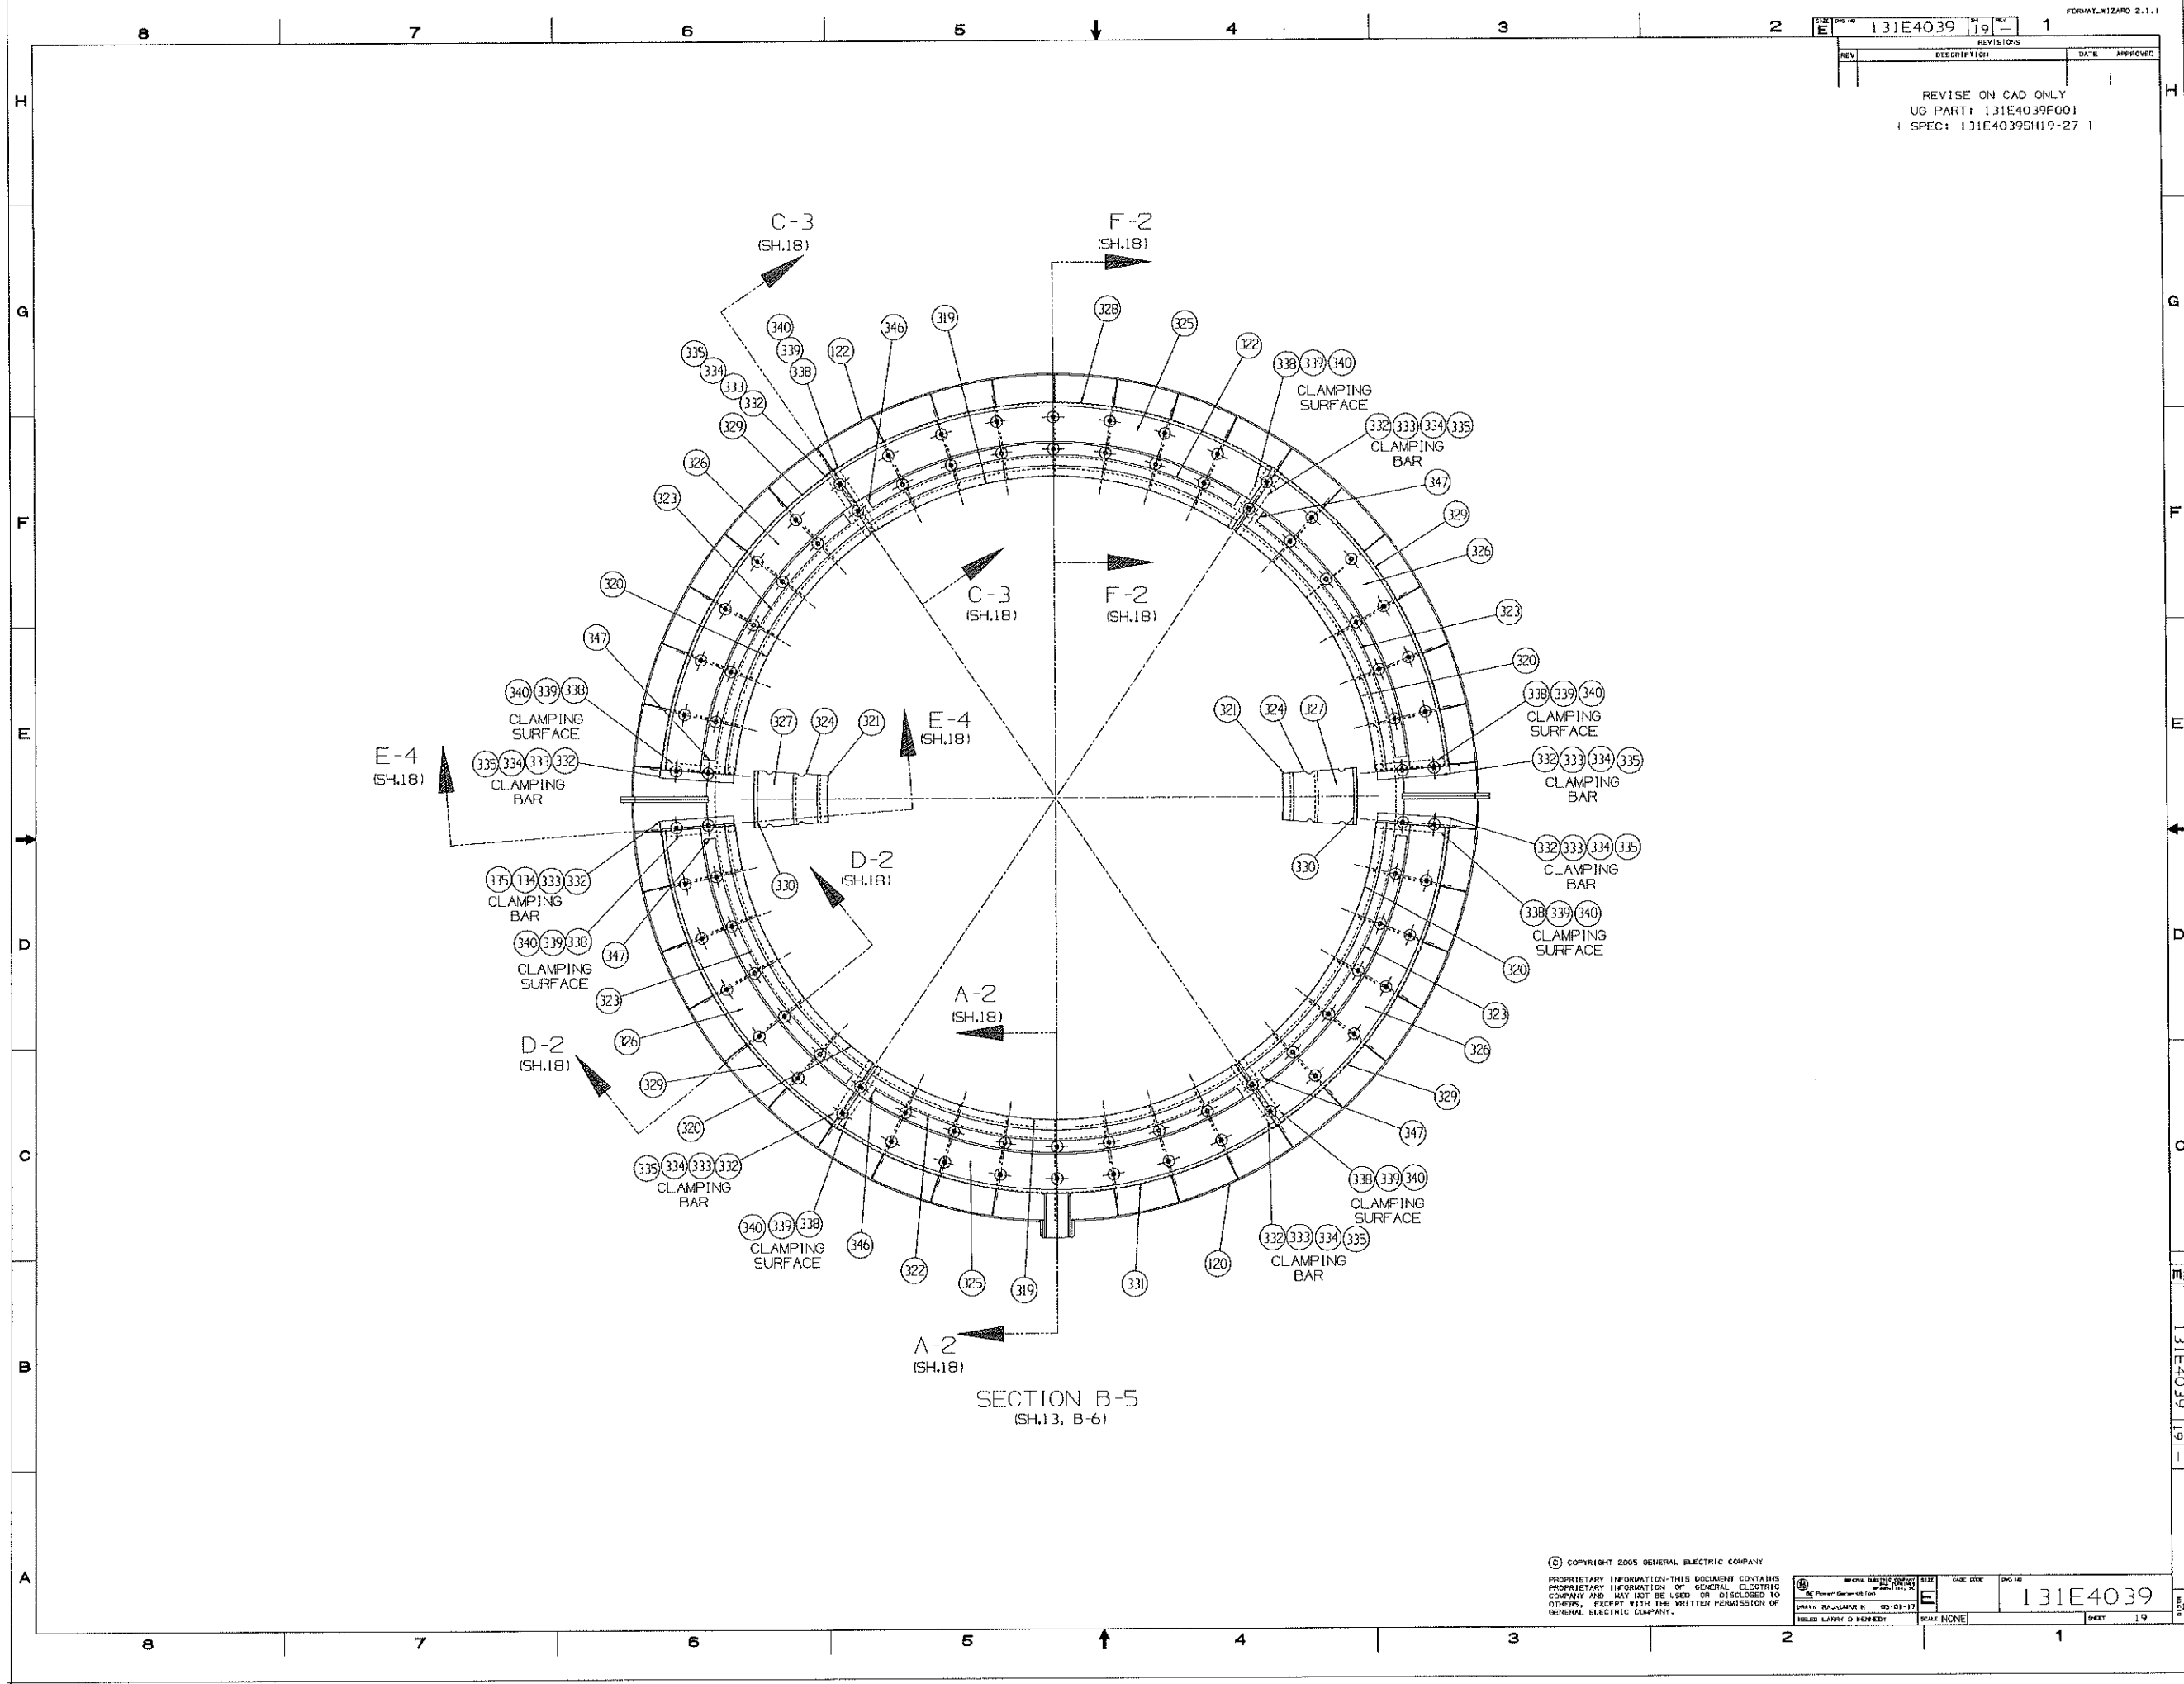

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
1	REVISE ON CAD ONLY UG PART: 131E4039P001 SPEC: 131E4039SH19-27		

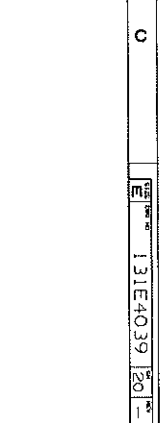

VIEW A-5 (C-7,C-5,B-3,B-2)

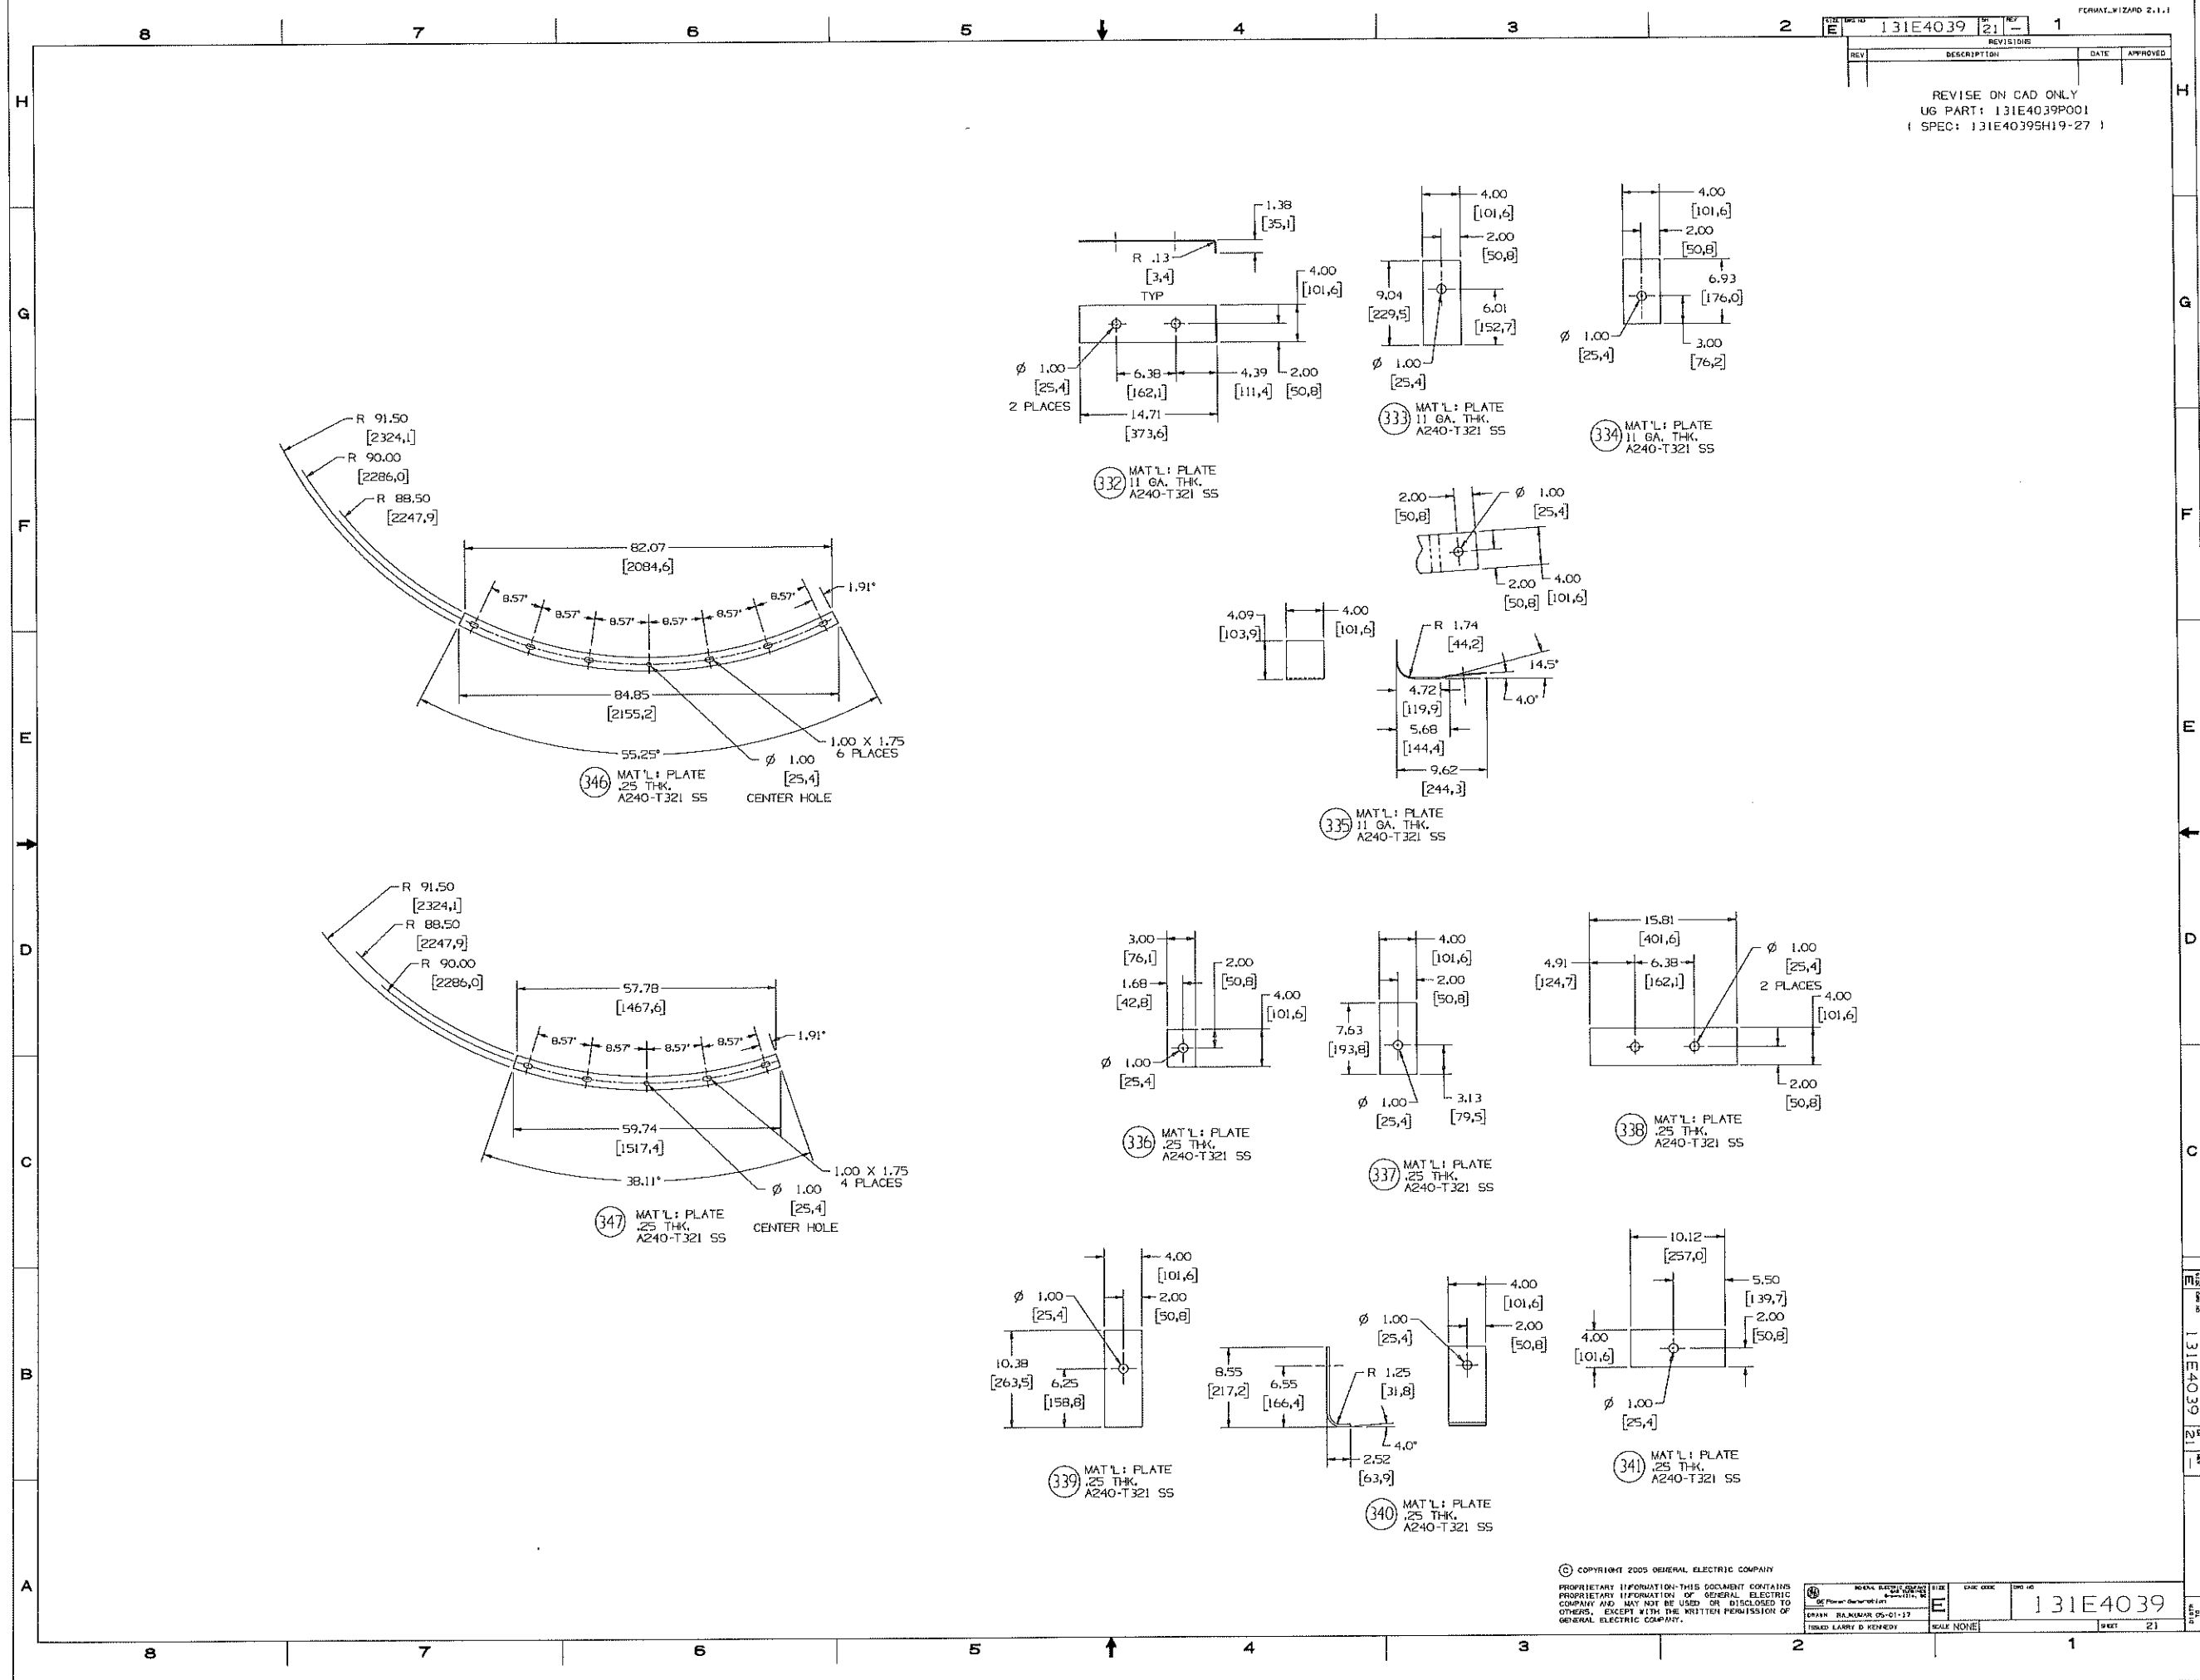

REVISE ON CAD ONLY  
UG PART: 131E4039P001  
( SPEC: 131E40395H19-27 )

© COPYRIGHT 2005 GENERAL ELECTRIC COMPANY  
PROPRIETARY INFORMATION-THIS DOCUMENT CONTAINS  
PROPRIETARY INFORMATION OF GENERAL ELECTRIC  
COMPANY AND MAY NOT BE USED OR DISCLOSED TO  
OTHERS, EXCEPT WITH THE WRITTEN PERMISSION OF  
GENERAL ELECTRIC COMPANY.

131E4039	21	1
REV	DESCRIPTION	DATE
1	131E4039	05-01-17
2	131E4039	05-01-17
3	131E4039	05-01-17
4	131E4039	05-01-17
5	131E4039	05-01-17
6	131E4039	05-01-17
7	131E4039	05-01-17
8	131E4039	05-01-17

8

7

6

5

4

3


2

1

REV	DESCRIPTION	DATE	APPROVED
1	131E4039	22	

REVISIONS  
REVISE ON CAD ONLY  
UG PART: 131E4039P001  
SPEC: 131E4039SH19-27

1. ALL THERMAL GAP DIMENSIONS ARE FOR REFERENCE ONLY.  
GAPS WERE CALCULATED USING CLAMP BAR OUTSIDE RADII.

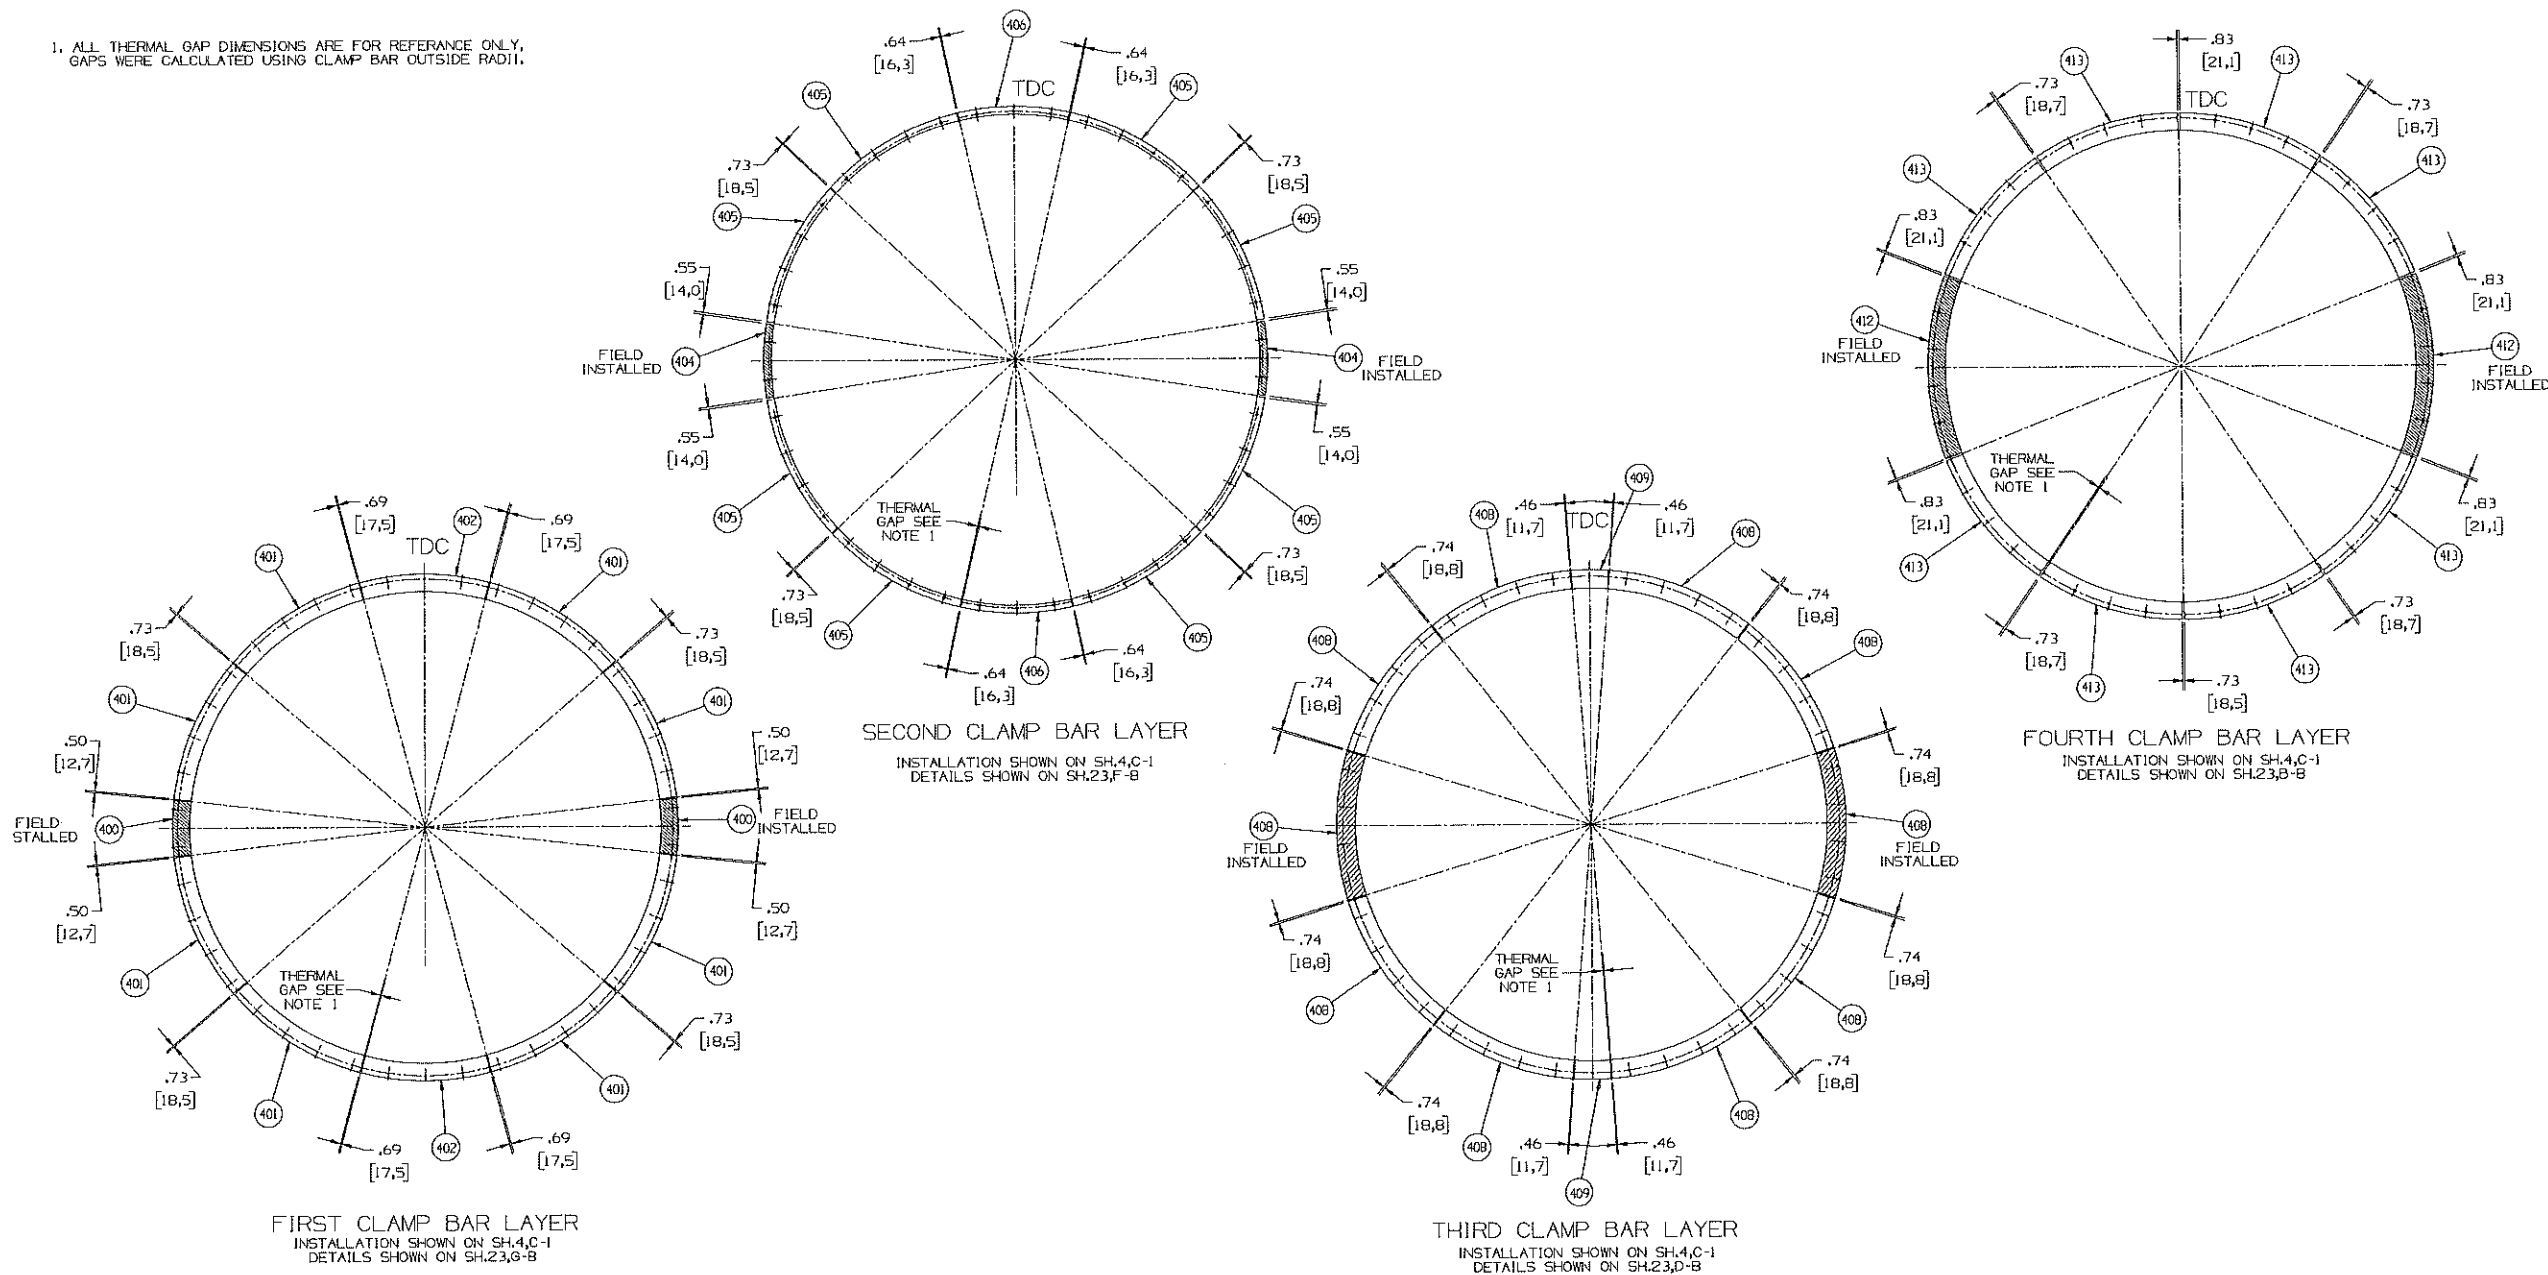

© COPYRIGHT 2005 GENERAL ELECTRIC COMPANY

PROPRIETARY INFORMATION-THIS DOCUMENT CONTAINS  
PROPRIETARY INFORMATION OF GENERAL ELECTRIC  
COMPANY AND MAY NOT BE USED OR DISCLOSED TO  
OTHERS, EXCEPT WITH THE WRITTEN PERMISSION OF  
GENERAL ELECTRIC COMPANY.

131E4039	22	1
----------	----	---




REV	DESCRIPTION	DATE	APPROVED
1	REVISIONS		

REVISE ON CAD ONLY  
UG PART: 131E4039P001  
SPEC: 131E4039SH19-27


NOTES:

1. NO ROUGH EDGES THAT WOULD AFFECT FITUP ALLOWED ON PARTS FOUND ON THIS SHEET.
2. ALL PARTS ON THIS PAGE TO HAVE A FLATNESS REQUIREMENT OF .003


INSIDE CLAMP BAR ARRANGEMENT  
SEE SH.22 - ZONE B-7

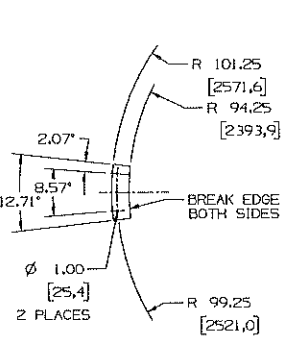

400 MAT'L: PLATE  
.38 THK  
A240-T321 SS

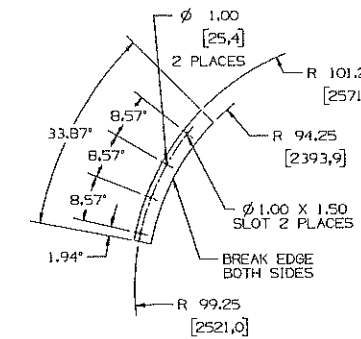


401 MAT'L: PLATE  
.38 THK  
A240-T321 SS

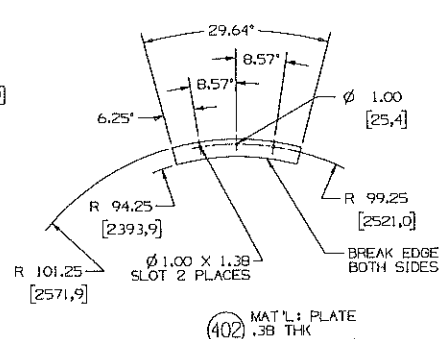


402 MAT'L: PLATE  
.38 THK  
A240-T321 SS


SPACER ARRANGEMENT  
SEE SH.22 - ZONE D-5

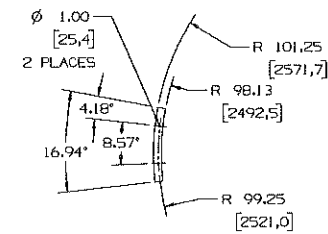

404 MAT'L: PLATE  
.19 THK  
A240-T321 SS

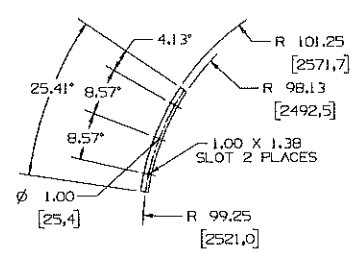


406 MAT'L: PLATE  
.19 THK  
A240-T321 SS

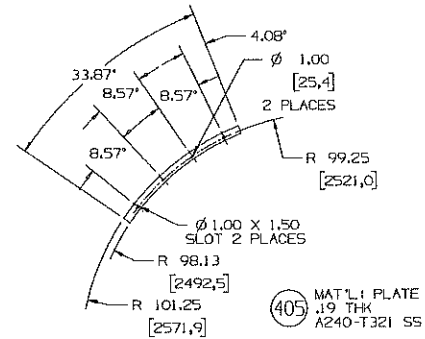


405 MAT'L: PLATE  
.19 THK  
A240-T321 SS

MIDDLE CLAMP BAR ARRANGEMENT  
SEE SH.22 - ZONE B-4




409 MAT'L: PLATE  
11 GA  
A240-T321 SS

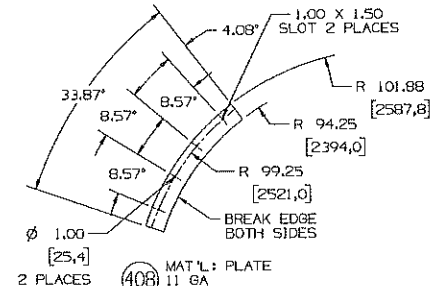


408 MAT'L: PLATE  
11 GA  
A240-T321 SS

OUTSIDE CLAMP BAR ARRANGEMENT  
SEE SH.22 - ZONE D-2

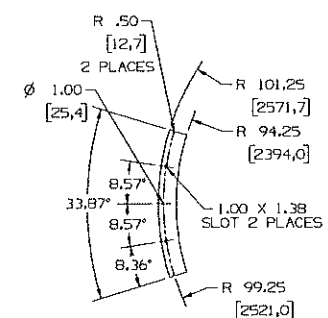


413 MAT'L: PLATE  
.38 THK  
A240-T321 SS

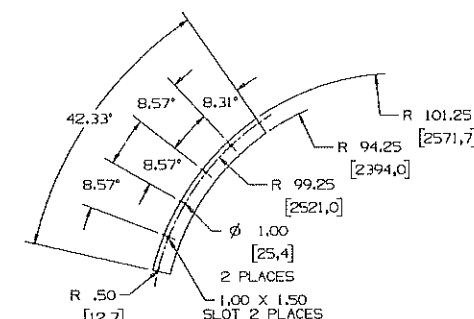

412 MAT'L: PLATE  
.38 THK  
A240-T321 SS





8

7

6

5

4

3

2

FORMAT: WIZARD 2.1.1

131E4039 26 1

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

REVISE ON CAD ONLY  
UG PART: 131E4039P001  
( SPEC: 131E4039SH19-27 )

7FA EXHAUST DIFFUSER CTO  
VERIFICATION CHECKLIST  
GE PO#  
LINE ITEM:

INTERFACE CTO5

P.O. Number:

GRO Number: GRO \_\_\_\_\_

THIS SPREAD SHEET SHALL BE COMPLETED BY THE  
SUPPLIER FOR EACH UNIT MANUFACTURED ACCORDING  
TO THE CTO FREQUENCY

REVISION 1.0 12/11/2000

THIS SPREAD SHEET IS FOR THE \_\_\_\_\_ UNIT PRODUCED AT \_\_\_\_\_

THE SHEET NUMBERS AND DRAWING ZONES CORRESPOND TO G.E. DRAWING 131E4039 LATEST REVISION UNLESS OTHERWISE STATED.

CTO	SHEET	DWG. ZONE	DESCRIPTION	DIMENSION ENGLISH	TOLERANCE		UNITS	DIMENSION SI	TOLERANCE		UNITS	FREQUENCY # OF MEAS.	FREQ.	REPORTED VALUE 1	2	3	4
					+	-			+	-							
			INTERFACE 18 A042 TO D706														
1	*	-	FLEX SEAL BOLT HOLE PATTERN RADIUS	81.00	.0625	.0625	INCHES	2057.40	1.59	1.59	MM	8	1				
2	*	-	ANGLE BETWEEN FLEX SEAL HOLES	4.80	0.01	0.01	DEGREES	4.80	0.01	0.01	DEGREES	1	1				
3	*	-	INNER FLEX SEAL RADIUS	80.00	.0625	.0625	INCHES	2032.00	1.59	1.59	MM	25	1				
4	*	-	FLEX SEAL HOLE SIZE (DIAMETER)	0.75	.014	.005	INCHES	19.05	0.36	0.13	MM	75	1				
			INTERFACE 19 A042 TO EXP. JT. TP A096 (HRS6)														
5	5	E-4	AFT GAS PATH DIAMETER	192.00	.125	.125	INCHES	4876.80	3.18	3.18	MM	4	1				
6	5	E-7	AFT EXPANSION JOINT FLANGE TO AFT EXPANSION JOINT LINER STUD	4.00	.125	.125	INCHES	101.60	3.18	3.18	MM	4	1				
7	5	G-3	NUMBER OF FLOW PATH STUDS	42	-	-	QUANTITY	42	-	-	QUANTITY	1	1				
8	5	G-3	FLOW PATH STUD OFFSET FROM TDC	0.00	0.02	0.02	DEGREES	0.00	0.02	0.02	DEGREES	1	1				
9	5	G-3	DIAMETER OF FLOW PATH STUDS	0.75	0.00	0.00	INCHES	19.05	0.00	0.00	MM	4	1				
10	5	G-4	BOLT HOLE PATTERN DIAMETER FOR A042/EXP. JT./HRS6 FLANGE	208.25	.125	.125	INCHES	5289.55	3.18	3.18	MM	4	1				
11	5	G-8	INTERFACES AFT CIRCUMFERENTIAL STUD SET-BACK FROM AFT A042 FLANGE	6.00	.125	.125	INCHES	152.40	3.18	3.18	MM	4	1				
12	5	H-4	NO. OF HOLES FOR A042/EXP. JT./HRS6 FLANGE	60	-	-	QUANTITY	60	-	-	QUANTITY	1	1				
13	5	H-4	HOLE DIAMETER	0.875	.014	.005	INCHES	22.23	0.36	0.13	MM	4	1				
14	5	H-4	BOLT HOLE PATTERN OFFSET FROM TDC FOR A042/EXP. JT./HRS6 INTERFACE FLANGES	3.00	0.01	0.01	DEGREES	3.00	0.01	0.01	DEGREES	1	1				
15	16	B-7, B-6	A042 TO EXP. JT. FIELD TRIM AXIAL LENGTH	15.00	.125	.125	INCHES	381.00	3.18	3.18	MM	2	1				
16	16	B-7, B-6	A042 TO EXP. JT. FIELD TRIM HOLE DIAMETER	1.50	**	**	INCHES	38.10	**	**	MM	2	1				
17	16	B-8, B-6	A042 TO EXP. JT. FIELD TRIM CIRCUMFERENTIAL DISTANCE BTWN HOLES	14.35	.125	.125	INCHES	364.49	3.18	3.18	MM	2	1				
18	16	B-8, B-7	A042 TO EXP. JT. FIELD TRIM AXIAL LENGTH BTWN STUDS	10.00	.125	.125	INCHES	254.00	3.18	3.18	MM	2	1				
19	16	G-4	A042 TO EXP. JT. SPLICE FIELD TRIM AXIAL LENGTH	15.00	.125	.125	INCHES	381.00	3.18	3.18	MM	2	1				
20	16	G-4	A042 TO EXP. JT. SPLICE FIELD TRIM HOLE DIAMETER	1.50	**	**	INCHES	38.10	**	**	MM	2	1				
21	16	G-4	A042 TO EXP. JT. SPLICE FIELD TRIM CIRCUMFERENTIAL DISTANCE BTWN HOLES	14.35	.125	.125	INCHES	364.49	3.18	3.18	MM	2	1				
22	16	G-4	A042 TO EXP. JT. SPLICE FIELD TRIM AXIAL LENGTH BTWN STUDS	10.00	.125	.125	INCHES	254.00	3.18	3.18	MM	2	1				
23	16	C-4, C-3	EXP. JT. TO HRS6 FIELD TRIM HOLE DIAMETER	1.50	**	**	INCHES	38.10	**	**	MM	2	1				
24	16	D-4, D-3	EXP. JT. TO HRS6 FIELD TRIM AXIAL LENGTH	13.00	.125	.125	INCHES	330.20	3.18	3.18	MM	2	1				
25	16	D-5, D-4	EXP. JT. TO HRS6 FIELD TRIM AXIAL LENGTH BTWN STUDS	8.00	.125	.125	INCHES	203.20	3.18	3.18	MM	2	1				
26	16	D-5, D-4	EXP. JT. TO HRS6 FIELD TRIM CIRCUMFERENTIAL DISTANCE BTWN HOLES	14.35	.125	.125	INCHES	364.49	3.18	3.18	MM	2	1				
27	16	G-3	EXP. JT. TO HRS6 SPLICE FIELD TRIM HOLE DIAMETER	1.50	**	**	INCHES	38.10	**	**	MM	2	1				
28	16	G-3	EXP. JT. TO HRS6 SPLICE FIELD TRIM AXIAL LENGTH	13.00	.125	.125	INCHES	330.20	3.18	3.18	MM	2	1				
29	16	G-3	EXP. JT. TO HRS6 SPLICE FIELD TRIM AXIAL LENGTH BTWN STUDS	8.00	.125	.125	INCHES	203.20	3.18	3.18	MM	2	1				
30	16	G-3	EXP. JT. TO HRS6 SPLICE FIELD TRIM CIRCUMFERENTIAL DISTANCE BTWN HOLES	14.35	.125	.125	INCHES	364.49	3.18	3.18	MM	2	1				

\*G.E. DRAWING 32487582  
\*\*INDUSTRY STANDARD TOLERANCE

© COPYRIGHT 2005 GENERAL ELECTRIC COMPANY

PROPRIETARY INFORMATION-THIS DOCUMENT CONTAINS  
PROPRIETARY INFORMATION OF GENERAL ELECTRIC  
COMPANY AND MAY NOT BE USED OR DISCLOSED TO  
OTHERS, EXCEPT WITH THE WRITTEN PERMISSION OF  
GENERAL ELECTRIC COMPANY.

131E4039	26	1
131E4039	26	1

8

7

6

5

4

3

2

1

SIZE: 131E4039

REV: 27

DATE: 12/11/2000

APPROVED: [Signature]

REVISE ON CAD ONLY  
US PART: 131E4039P001  
I SPEC: 131E4039SH19-27 I7FA EXHAUST DIFFUSER CTO  
VERIFICATION CHECKLIST  
GE P04

INTERNAL CTO5

P.O. NUMBER:

GRO NUMBER:

REVISION 1.0 12/11/2000

THIS SPREAD SHEET SHALL BE COMPLETED BY THE SUPPLIER FOR EACH UNIT MANUFACTURED ACCORDING TO THE CTO FREQUENCY.

THIS SPREAD SHEET IS FOR THE \_\_\_\_\_ UNIT PRODUCED AT \_\_\_\_\_

THE SHEET NUMBERS AND DRAWING ZONES CORRESPOND TO G.E. DRAWING 131E4039 LATEST REVISION UNLESS OTHERWISE STATED.

CTO NO.	SHEET	DWG. ZONE	DESCRIPTION	DIMENSION ENGLISH	TOLERANCE	UNITS	DIMENSION SI	TOLERANCE	UNITS	FREQUENCY # OF MEAS.	FREQ.***	REPORTED VALUE	2	3	4
31	1	B-4	CASING												
32	1	D-3	DUCT LENGTH W/O EXP. JT. (209 + 5.5)	218.75	.125	INCHES	5556.3	3.18	MM	4	1				
33	1	D-3	DUCT LENGTH W/ EXP. JT. (209 + 5.5 + 1)	214.50	.125	INCHES	5448.3	3.18	MM	4	1				
34	4	F-7	AXIAL DIST. FROM FRONT A042 TO CENTER OF DRAIN PIPE	18.00	.125	INCHES	457.2	3.18	MM	4	1				
35	4	F-7	DRAIN PIPE A36 SCH 40	14.38	.125	INCHES	365.13	3.18	MM	4	1				
36	4	G-8	HORIZONTAL DISTANCE FROM DIFFUSER CL TO BOTTOM OF DRAIN PIPE	8.00	.125	INCHES	203.20	3.18	MM	4	1				
37	6	A-3	AXIAL DISTANCE FROM AFT FLANGE A042 TO FORWARD EDGE OF AFT STIFFENER	113.38	.125	INCHES	2879.73	3.18	MM	4	1				
38	6	A-5	TROUGH AXIAL LENGTH	35.38	.125	INCHES	898.5	3.18	MM	4	1				
39	6	A-5	AXIAL DISTANCE FROM FRONT A042 TO AFT EDGE OF FORWARD STIFFENER	31.38	.125	INCHES	796.9	3.18	MM	4	1				
40	6	B-3	AFT HALF AXIAL LENGTH	41.75	.125	INCHES	1060.5	3.18	MM	4	1				
41	6	B-3	AFT CASING SHELL AFT ROLLED RADIUS	95.77	.125	INCHES	2432.6	3.18	MM	4	1				
42	6	B-4	AFT CASING SHELL FORWARD ROLLED RADIUS	102.79	.125	INCHES	2610.9	3.18	MM	4	1				
43	6	B-5	FORWARD CASING SHELL FORWARD ROLLED RADIUS	96.12	.125	INCHES	2441.4	3.18	MM	4	1				
44	6	B-5	FRONT HALF AXIAL LENGTH (88.28+30.45)	89.93	.125	INCHES	2284.2	3.18	MM	4	1				
45	6	C-4	FORWARD CASING SHELL AFT ROLLED RADIUS	118.73	.125	INCHES	3015.7	3.18	MM	4	1				
46	4	B-5	TROUGH/FLEX SEAL AREA	96.09	.125	INCHES	2440.7	3.18	MM	4	1				
47	4	C-6	GAP BETWEEN INNER AND MIDDLE CLAMP BAR	0.19	.200 MAX, .110 MIN	INCHES	4.8	5.08 MAX, 2.79 MIN	MM	2	1				
48	10	E-7	CLAMP BAR STUD TO BOTTOM TROUGH LINER	2.75	.125	INCHES	69.9	3.18	MM	4	1				
49	10	E-8	AFT TROUGH OUTER STUD DIAMETER (218.75-2*(.25-10.875))	196.50	.125	INCHES	4991.1	3.18	MM	4	1				
50	10	E-8	RADIUS FROM CL TO FLEX SEAL CLAMP BAR STUDS (218.75/2-.25-9.875)	198.50	.125	INCHES	5041.9	3.18	MM	4	1				
51	11	D-2	AFT TROUGH INNER STUD DIAMETER (218.75-2*(.25-19.125))	180.00	.125	INCHES	4572.0	3.18	MM	4	1				
52	24	F-6	FLEX SEAL CLAMP BAR STUD SIZE, 34755	0.75	.002	INCHES	.002	.002	MM	4	1				
53	24	F-6	TADPOLE CLAMP BAR FORWARD STUD INTERVAL (360/84)	4.29	0.02	DEGREES	4.29	0.02	DEGREES	4	1				
54	24	H-7	TADPOLE CLAMP AFT BAR STUD INTERVAL (360/42)	8.57	0.02	DEGREES	8.57	0.02	DEGREES	4	1				
55	4	-	TADPOLE CLAMP BAR STUDS (FOR AND AFT) OFFSET FROM TDC	0.00	.01	DEGREES	0.0	0.01	DEGREES	2	1				
56	1	B-4	FLEX SEAL OUTER RADIUS	96.20	.031	INCHES	2443.5	0.79	MM	4	1				
57	8	B-4	BLEED PIPES												
58	8	B-4	AXIAL BLEED PIPE LOCATION FROM FACE OF A042 (61.69 + 5.5)	67.19	.125	INCHES	1706.63	3.18	MM	4	1				
59	8	B-8	UPPER BLEED PIPE VERTICAL DISTANCE FROM DIFFUSER CL TO CENTER OF BLEED PIPE SLEEVE END	40.06	.125	INCHES	1017.52	3.18	MM	2	1				
60	8	B-8	LOWER BLEED PIPE VERTICAL DISTANCE FROM DIFFUSER CL TO CENTER OF BLEED PIPE SLEEVE END	59.01	.125	INCHES	1498.85	3.18	MM	2	1				
61	8	E-5	HORIZONTAL DIST. FROM DIFFUSER CL TO END OF UPPER AND LOWER BLEED PIPE SLEEVE CL	98.25	.125	INCHES	2495.55	3.18	MM	4	1				
62	8	E-8	PARALLEL DISTANCE BETWEEN BLEED PIPE SLEEVES	17.55	.125	INCHES	445.77	3.18	MM	4	1				
63	1	B-3	LINER SYSTEM (AFT OF TROUGH)												
64	1	C-4	AFT GAS PATH DIAMETER AT EXP. JT. OR AFT END A042	192.00	.125	INCHES	4876.8	3.18	MM	4	1				
65	10	D-4	FORWARD GAS PATH DIAMETER (AT NOSE SCALLOP BAR LOCATION)	166.00	.125	INCHES	4216.4	3.18	MM	4	1				
66	10	D-4	AFT SECTION AFT AXIAL SCALLOP BAR AFT STUD DISTANCE FROM CENTER FLANGE	78.00	.125	INCHES	1981.2	3.18	MM	4	1				
67	10	D-4	AFT SECTION AFT AXIAL SCALLOP BAR FWD STUD DISTANCE FROM CENTER FLANGE	54.00	.125	INCHES	1371.6	3.18	MM	4	1				
68	10	D-5	FWD. SECTION AFT AXIAL SCALLOP BAR AFT STUD DISTANCE FROM CENTER FLANGE	18.00	.125	INCHES	457.2	3.18	MM	4	1				
69	10	D-6	NOSE SCALLOP BAR FLOW PATH STUD DISTANCE FROM CENTER FLANGE	90.00	.125	INCHES	2286.0	3.18	MM	4	1				
70	10	D-6	FWD. SECTION FWD. AXIAL SCALLOP BAR AFT STUD DISTANCE FROM CENTER FLANGE	54.00	.125	INCHES	1371.6	3.18	MM	4	1				
71	10	E-4	DISTANCE BETWEEN STUDS AXIALLY X 14 STARTING AT NOSE SCALLOP BAR	12.00	.125	INCHES	304.8	3.18	MM	4	1				
72	10	E-5	CENTER CIRCUMFERENTIAL SCALLOP BARS SET BACK FROM CENTER FLANGE (X 12)	6.00	.125	INCHES	152.4	3.18	MM	4	1				
73	10	E-5	AFT SECTION FWD AXIAL SCALLOP BAR FWD STUD DISTANCE FROM CENTER FLANGE	18.00	.125	INCHES	457.2	3.18	MM	4	1				
74	12	E-2	STUD CIRCUMFERENTIAL INTERVALS	8.57	0.02	DEGREES	8.57	0.02	DEGREES	4	1				
75	12	H-5	STUD OFFSET FROM TDC	0.00	0.01	DEGREES	0.00	0.01	DEGREES	4	1				
76	1	D-3	STATIC PRESSURE PROPS												
77	1	D-3	AXIAL DISTANCE FROM FRONT A042 (197 + 5.5)	202.50	.125	INCHES	5143.5	3.18	MM	4	1				
78	8	E-2	PANCAKE DIAMETER	3.00	.125	INCHES	76.2	3.18	MM	4	1				
79	8	F-3	OFFSET FROM TDC (X 2) AND BDC (X 2)	47.00	.01	DEGREES	45.0	0.01	DEGREES	4	1				
80	8	G-2	PERPENDICULAR TO FLOW PATH-LINER SHEET (PANCAKE WASHER PARALLEL TO LINER)	90.00	2.00	DEGREES	90.0	2.00	DEGREES	4	1				
81	8	H-3	PROBE PROTRUSION INTO GAS PATH	2.50	.125	INCHES	63.5	3.18	MM	4	1				
82	1	-	EXPANSION JOINT												
83	1	D-3	EXPANSION JOINT AXIAL LENGTH	18.00	.125	INCHES	457.2	3.18	MM	4	1				
84	5	E-7	AXIAL DISTANCE BTWN LINER STUDS (18-2+4)	10.00	.125	INCHES	254.0	3.18	MM	4	1				
85	5	F-7	AXIAL DISTANCE BETWEEN BELT STUDS	8.00	.125	INCHES	203.2	3.18	MM	4	1				

\* G.E. DRAWING 32487582

\*\* STANDARD INDUSTRY TOLERANCES

\*\*\* THESE CTO5 TO BE SUBMITTED FOR EVERY UNIT FOR THE FIRST TEN UNITS, THEN EVERY 10TH UNIT THEREAFTER

© COPYRIGHT 2005 GENERAL ELECTRIC COMPANY

PROPRIETARY INFORMATION-THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF GENERAL ELECTRIC COMPANY AND MAY NOT BE USED OR DISCLOSED TO OTHERS, EXCEPT WITH THE WRITTEN PERMISSION OF GENERAL ELECTRIC COMPANY.

GENERAL ELECTRIC COMPANY  
131E4039

131E4039


27



A

Uninsulated  
Access  
Ports



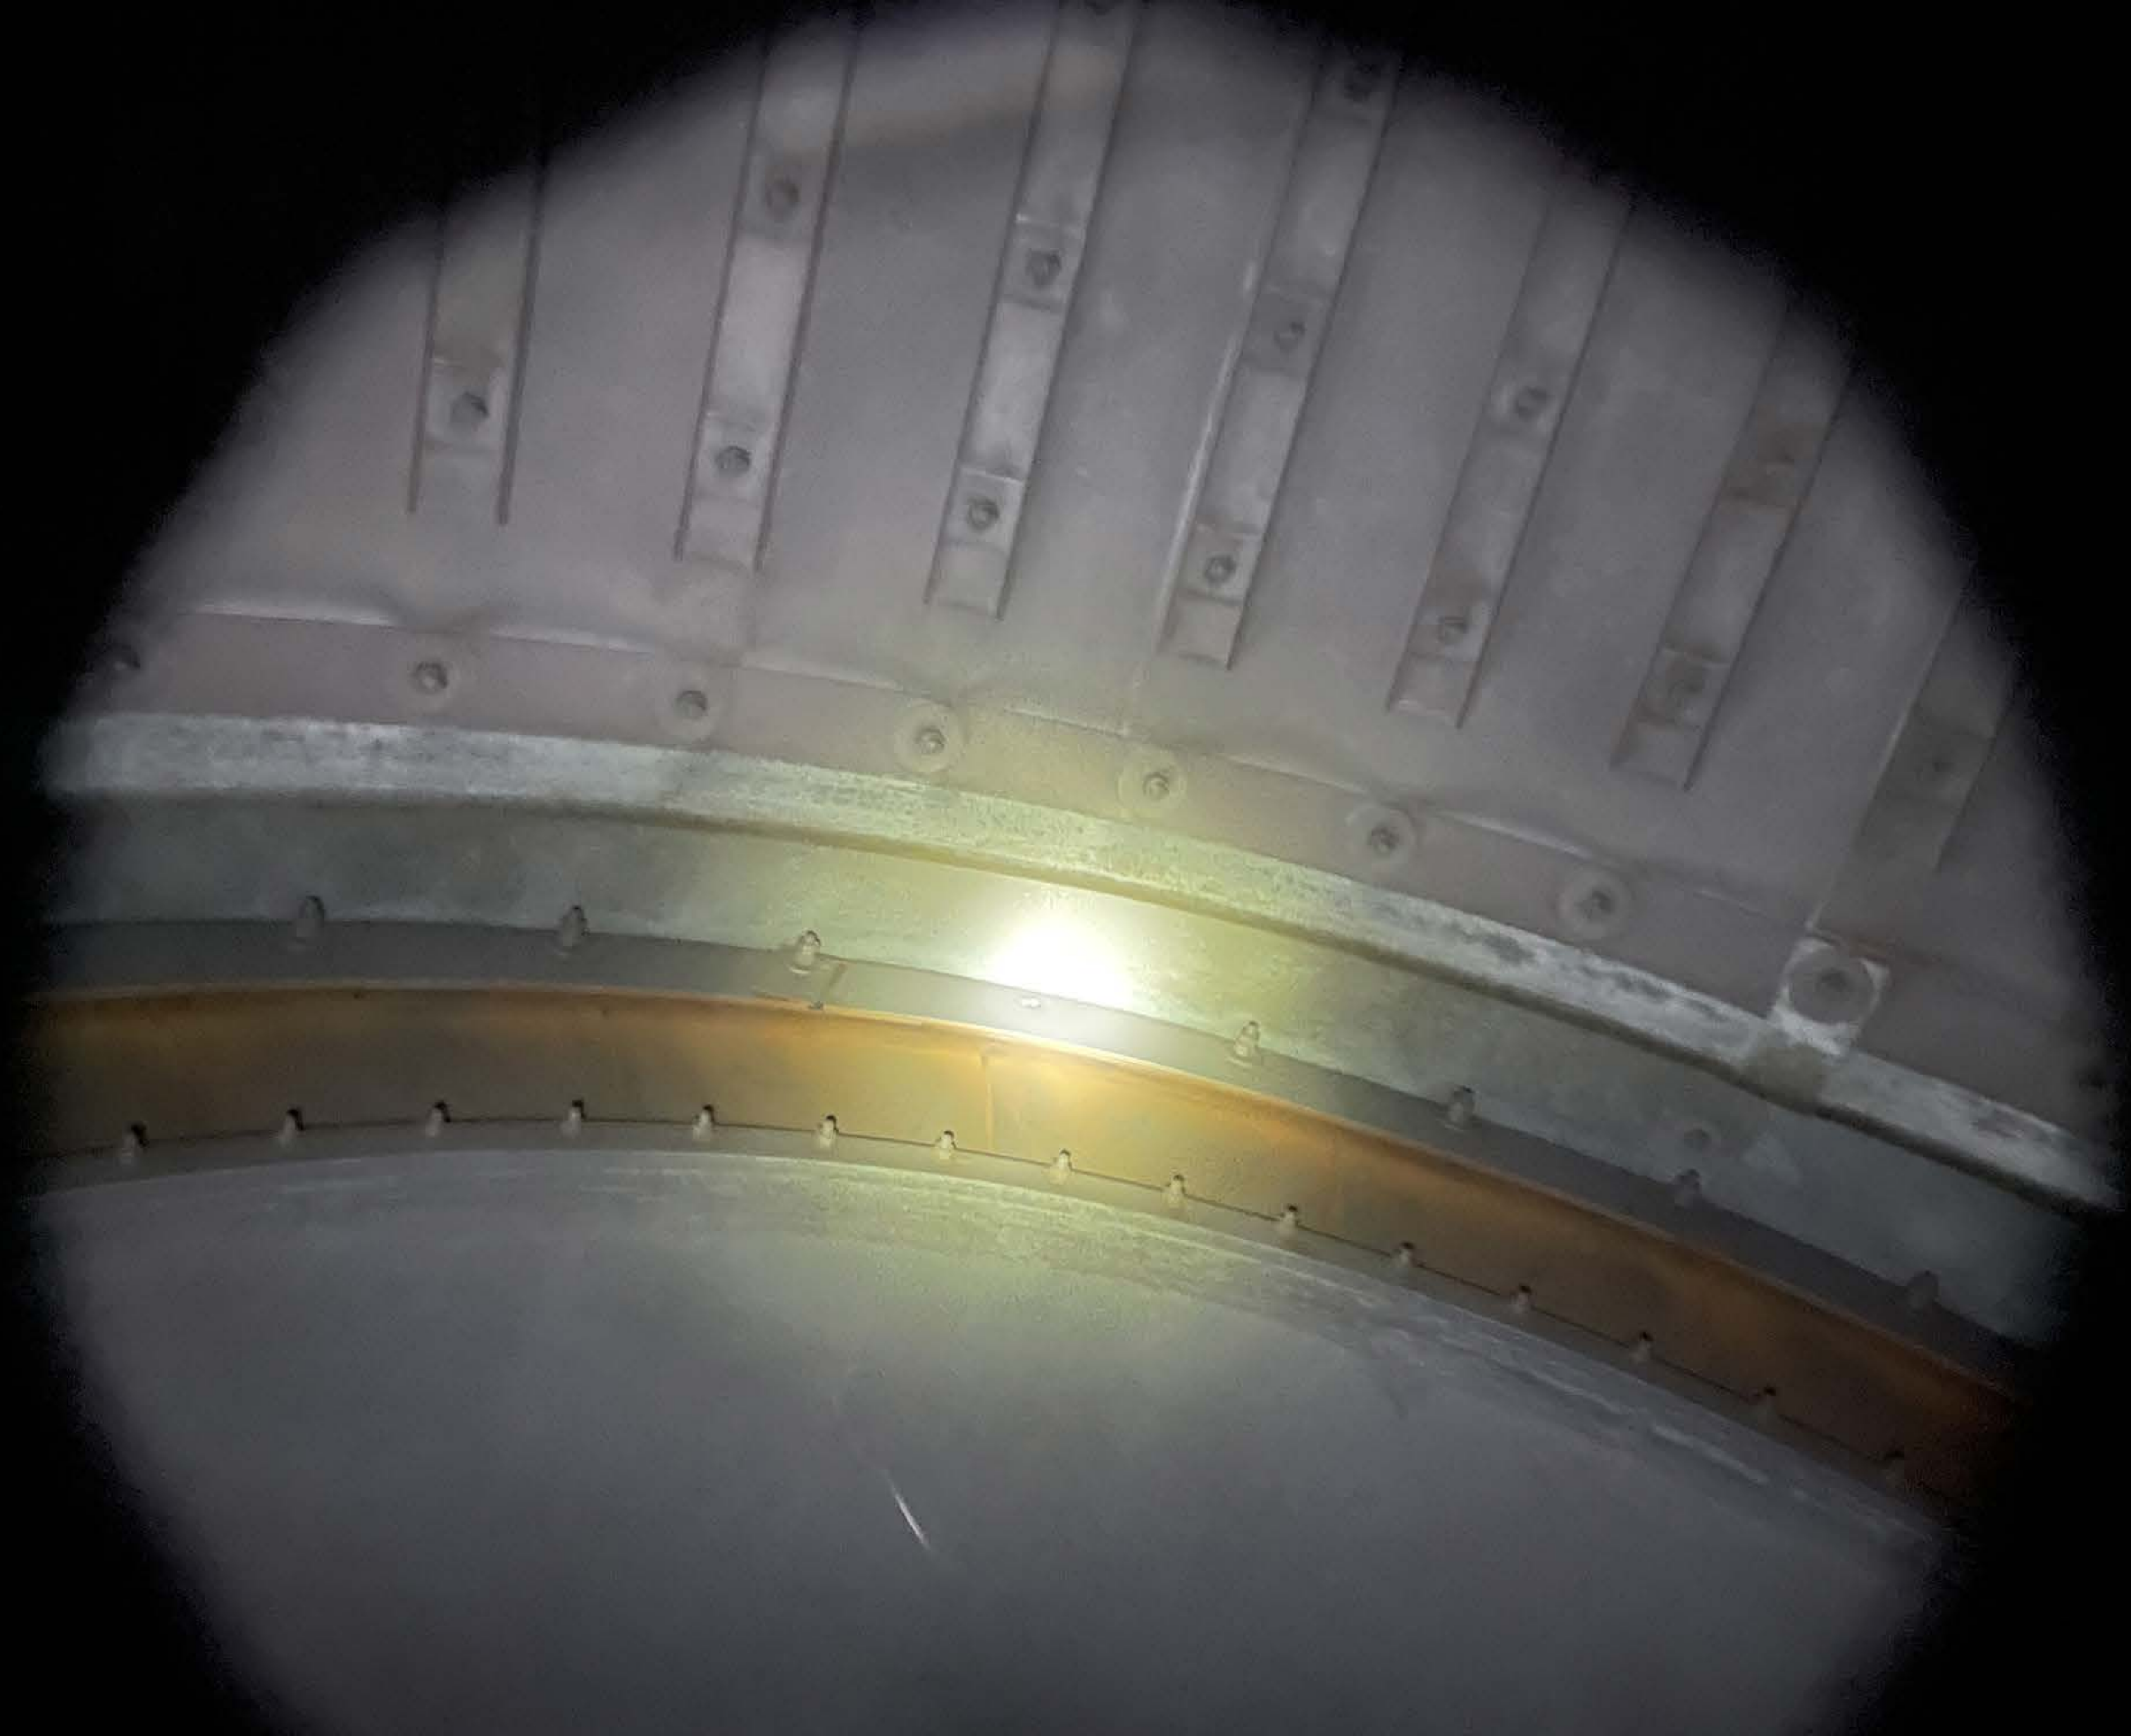







## **APPENDIX B**

### **SAMPLE AGREEMENT**

FLORIDA MUNICIPAL POWER AGENCY  
TERMS AND CONDITIONS FOR THE PURCHASE OF GOODS AND SERVICES  
(Form PO-101AR Rev 3.)

**Notice:** FMPA's purchase of goods and services from the Supplier is expressly conditioned on Supplier's assent to these Form PO-101AR terms and conditions (the "*Terms and Conditions*") which are binding on the Supplier. Any acceptance of FMPA's offer to purchase goods and services is expressly limited to acceptance of these Terms and Conditions, and FMPA expressly objects to any additional or different terms and conditions offered by the Supplier. Any order for goods and services fulfilled by the Supplier or the performance of work by Supplier shall constitute the Supplier's assent to these Terms and Conditions. These Terms and Conditions, however, do not apply to FMPA's purchase of engineering and other professional services; such purchase of engineering and other professional services shall be governed by terms and conditions separately set forth and agreed to between FMPA and the Supplier. This notice is a material part of these Terms and Conditions.

1. **Definitions.** As used in these Terms and Conditions, the terms below have the following definitions:

"**FMPA**" means the Florida Municipal Power Agency, a governmental separate legal entity created and existing under Florida Law.

"**Good(s)**" means the materials, supplies, items, and equipment covered by the purchase order and any pre-existing master agreement between FMPA and the Supplier.

"**Goods and Services**" means the Supplier's provisions of Good(s) or Services, or both, individually or together, and the Supplier's performance of the totality of its obligations as set forth in the Purchase Order.

"**Purchase Order**" means purchase order or agreement between FMPA and Supplier for the provision of Goods and Services and includes all exhibits, specifications, attachments, and these Terms and Conditions which are hereby deemed by the parties to be a material and essential part of the Purchase Order.

"**Supplier**" means a vendor, seller, supplier, materialman, outfitter, contractor, or other provider designated in the Purchase Order and includes the Supplier's employees, subcontractors, independent contractors and all other persons performing any type of work, directly or indirectly under the Supplier's direction or control, in contribution to the provision of the Goods and Services subject to the Purchase Order.

"**Services**" means the work to be performed or the services to be provided by the Supplier, or both, as described in the Purchase Order, including any technical description or proposal submitted to or issued by FMPA and related to the Purchase Order.

2. **Applicability.** The Supplier hereby agrees to sell and provide the Good(s) and perform the Services described in the Purchase Order in accordance with these Terms and Conditions and the requirements of the Purchase Order, including any specified scope of work or technical specification included in the Purchase Order.

3. **Acceptance.** The Supplier shall accept the Purchase Order in writing. If Supplier fails to accept the Purchase Order in writing, the Purchase Order and these Terms and Conditions are nonetheless applicable and binding upon the Supplier if the Supplier engages in any conduct which recognizes the existence of a contract pertaining to the subject matter hereof, including, without limitation, the shipment of Goods or commencing the performance of Services, which is deemed by the Supplier to constitute its acceptance of the Purchase Order. Any terms proposed in Supplier's acceptance of FMPA's offer that add to, vary from, or conflict with the Purchase Order and these Terms and Conditions is hereby objected to by FMPA and shall not apply. To the extent that the Purchase order might be treated as an acceptance of Supplier's prior offer, and if any of the terms of the Purchase Order are additional to or different from any terms of such offer, then the issuance of the Purchase Order by FMPA shall constitute an acceptance of such offer subject to the express condition that Supplier assent to these additional and different Terms and Conditions, which in all cases of conflict are controlling, and Supplier shall be deemed to have so assented. Any other preprinted terms and conditions affixed to any Goods or forms provided by the Supplier are hereby acknowledged and agreed to be void and of no effect.

4. **Entire Agreement.** (a) The Purchase Order sets forth the complete and final agreement between the parties with respect to the subject matter hereof, and supersedes any and all prior or contemporaneous oral or written communications relating thereto.

(b) Only if the Purchase Order is used as a release for Goods or Services under a pre-existing master agreement, then

these Terms and Conditions are deemed to supplement the provisions of such master agreement to the extent they are not inconsistent and such master agreement is hereby deemed to be appended to and form a part of the Purchase Order. In the event of any inconsistency between the terms of any pre-existing Master agreement, and these Terms and Conditions and those additionally set forth in the Purchase Order, the following order of precedence is hereby agreed: (1) the terms of the master agreement, (2) the terms on the face of the Purchase Order, and (3) these Terms and Conditions.

(c) Any reference to a proposal, quotation, or other communication given by the Supplier, unless expressly provided for in the Purchase Order to the contrary, is limited only to the description of the Goods or Services and by the terms set forth or incorporated by reference in the Purchase Order.

5. **Prices.** (a) The price(s) set forth in the Purchase Order are firm, and are not subject to increase.

(b) The Supplier represents that the price(s) charged for the Goods and Services covered by the Purchase Order are the lowest prices charged by the Supplier to buyers of a class similar to FMPA under conditions similar to those specified in the Purchase Order and the price(s) comply with the applicable government regulations in effect at the time of quotation, sale, or delivery. The Supplier agrees that any price reduction made in the Goods or Services covered by the Purchase Order within the 12 months subsequent to the placement of the Purchase Order will be applicable to the Purchase Order and FMPA. In such case, the Supplier shall issue a payment to FMPA to credit to FMPA the reduction in price from the price that FMPA has paid. If FMPA has not completed payment for the Goods and Services, the Supplier shall issue to FMPA a credit against future amounts owed under the Purchase Order.

(c) FMPA may require the Supplier to provide a performance and payment bond as an option. The bonds must be priced separately.

6. **Taxes.** FMPA is tax-exempt for most purchases. FMPA's Florida Consumer's Certificate of Exemption Number is 85-8012559814C-2. A copy of this Certificate is available upon request. However, should any federal, state, or local taxes be imposed upon or on account of such sale, the prices for the Goods and Services are hereby deemed to include all such amounts, unless otherwise expressly set forth in the Purchase Order.

7. **Invoices.** (a) All invoices shall be submitted to FMPA in duplicate and shall contain the following information: (1) Purchase Order number; (2) Purchase Order line item number, as applicable; (3) Purchase Order part number, as applicable; (4) part serial number (if serialized); (5) brief description of the Goods and Services that are the subject of the invoice; (6) unit of measure; (7) unit price; (8) item quantity; (9) extended item price; (10) total invoice value; (11) Supplier's contact information and remit-to address; (12) invoice number; (13) date prepared; and (14) payment due date. Each invoice must also be accompanied by the Supplier's waiver, in a form reasonably acceptable to FMPA, of all liens and lien rights associated with amounts set forth in the invoice, conditioned only upon FMPA's payment of such invoice, as required to keep all Good(s) free from liens and claims of lien arising out of the provisions of the Goods and Services.

(b) FMPA may invoice or set off against amounts owed to the Supplier under the Purchase Order, in its discretion, any amounts FMPA determines are owed to FMPA by the Supplier pursuant to the Purchase Order, including these Terms and Conditions.

8. **Payment.** (a) Unless otherwise expressly set forth in the Purchase Order, FMPA shall pay 100% of the uncontested Purchase Order price upon the completion of the provision of all Goods and Services within 30 days after receipt of the Supplier's invoice following the delivery and FMPA's acceptance of the Goods and Services. Payment of an invoice does not constitute acceptance of the Goods and Services and shall be subject to adjustment for errors, shortages, defects in the Goods and Services, damage to FMPA for which Supplier is partially or wholly responsible, or other failure of Supplier to meet the requirements of the Purchase Order, including any of these Terms and Conditions.

(b) If applicable, in addition to Supplier's hourly rate, FMPA shall reimburse Supplier for certain reasonable business related expenses supported by original receipt, which may include reasonable travel expenses, business mileage (paid at no more than the IRS approved rate), postage, copying, and other similar business related expenses. All requests for reimbursement of expenses will be subject to audit and approval by FMPA.

9. **Delivery and Performance.** (a) Time is of the essence, and the Goods must be received or Services performed on the date(s) and at the destination(s) set forth in the Purchase Order. If the Supplier fails to meet any such delivery or performance date, FMPA may, without limiting its other rights and remedies, direct expedited routing, charge excess costs incurred thereby to the Supplier, purchase substitute goods or services elsewhere and charge Supplier for any additional expense incurred, or cancel all or part of the Purchase Order, without further liability of FMPA.

(b) Any Services required to be performed under the Purchase Order will be performed with the skill and care which would be exercised by comparable highly qualified persons performing similar Services and exercising all diligence to perform the Services in a first class manner. If the failure to meet these standards results in deficiencies in the Services, the Supplier shall re- perform such non-conforming Services necessary to correct such deficiencies at no extra cost to FMPA. Such re-performance by the Supplier shall be done in a manner and on a schedule that is established by FMPA.

(c) If applicable, the Supplier shall provide to FMPA upon delivery of Goods all material safety datasheets and other materials reasonably required by FMPA, including without limitations, factory test reports, inspections and certifications documentation, instructions and procedures for operation and maintenance, technical specifications, shipping documentation, and other similar or FMPA-designated materials.

**10. Freight; Title and Risk of Loss.** (a) Unless otherwise specifically provided for, Supplier shall be responsible for all freight and delivery costs, including unloading costs, to the destination specified in the Purchase Order. All freight and delivery charges will be paid by Supplier. Notwithstanding anything else herein, Supplier shall bear all risks of loss and damage to the Goods until final acceptance by FMPA at the destination specified in the Purchase Order. Further, Supplier shall bear the same risks with respect to any Goods rejected by FMPA or as to which FMPA has revoked its acceptance, from the time of such rejection or revocation.

(b) Risk of loss, title, and ownership of the Goods and Services shall pass to FMPA upon FMPA's acceptance of the Goods and Services meeting the quantity, quality, and other requirements set forth in the Purchase Order, except that nothing prohibits FMPA from revoking such acceptance is subsequently FMPA determines any of the Goods and Services, despite the initial acceptance thereof, did not meet all requirements of the Purchase Order.

**11. Inspection and Acceptance.** (a) Notwithstanding any prior inspections or payments hereunder, all Goods and Services shall be subject to final inspection, which may include measurement, testing and examination, at FMPA's facility within a reasonable time (but not less than 90 days) after receipt at destination. Any inspection by FMPA does not relieve the Supplier of any obligations or liabilities under the Purchase Order.

(b) If FMPA determines that any Goods and Services delivered or performed do not meet all of the requirements of the Purchase order, FMPA shall have the right to reject such Goods and Services and return such rejected Goods to Supplier at Supplier's expense. FMPA may elect to reject the entire Goods and Services tendered even if only a portion thereof is nonconforming. If FMPA elects to accept nonconforming Goods or Services, FMPA, in addition to its other remedies, shall be entitled to an appropriate reduction in price, as reasonably determined by FMPA based upon the total Purchase Order price. Payment for any Goods or Services shall not be deemed an acceptance thereof. All Goods that fail to meet the requirements of the Purchase Order are subject to Supplier's payment of any "in and out" costs incurred by FMPA due to such failure.

(c) Acceptance of any part or portion of the Goods and Services subject to the Purchase Order does not bind FMPA to accept any future shipments nor deprive FMPA of its right to return nonconforming Goods that were previously accepted.

(d) If Services under the Purchase Order are performed on FMPA property, the Services are deemed to not be complete until all rubbish, trash, debris, and unused material due to or connected with the performance of the Services is removed and the premises are left in a safe, neat, and reasonably clean condition.

**12. Warranty.** (a) Supplier warrants that all Goods and Services furnished under the Purchase Order are: (1) be free from known, apparent, latent and inherent defects in workmanship, material, manufacture, and design (where design is the Supplier's responsibility); (2) comply with the requirements of the Purchase Order in all respects and any samples and warranties furnished by the Supplier; (3) be merchantable and safe for use, and fit and sufficient for the use intended by FMPA; (4) be free and clear of any lien, security interest, or other adverse claim against title; and (5) not infringe, including without limitation their sale or use alone or in combination, any United States or foreign patents, trademarks, trade secrets, copyrights, or proprietary rights of any third party.

(b) The foregoing warranties are in addition to all other warranties, expressed or implied, and shall survive any delivery, inspection, acceptance, and payment by FMPA.

(c) Supplier's warranties shall be effective for the period of time either (1) as set forth in the Purchase Order expressly, or (2) two years from the date of FMPA's final acceptance, whichever is greater plus an additional two (2) years from any warranty repair with the total period not to exceed four (4) years from the date of FMPA's final acceptance.

(d) If any of the Goods and Services furnished under the Purchase Order do not meet the warranties described in these Terms and Conditions or otherwise, FMPA may, at its option: (1) require the Supplier to correct, at no cost to FMPA, any defective or nonconforming Goods and Services by repair or replacement; or (2) return such defective or nonconforming Goods at the Supplier's expense to the Supplier and recover from the Supplier the price for such defective or nonconforming Goods and FMPA's related costs to determine such defect or nonconformance, for FMPA's return shipping costs to the Supplier, and for FMPA's acquisition and installation of replacement Goods meeting FMPA's requirements; (3) correct the defective or nonconforming Goods and Services itself and charge the Supplier for all costs and expenses incurred by FMPA related to such correction; or (4) accept the defective or nonconforming Goods and Services at a reduced price, as reasonably determined by FMPA based upon the total Purchase Order price. In all cases, for Goods and Services that do not meet the warranties described in these Terms and Conditions or otherwise, the Supplier shall be responsible for the costs of removal and reinstallation. Also, since the Goods and Services may be part of and operating power plant – the timing of repairs will in all cases be at FMPA's convenience.

13. **Changes.** FMPA reserves the right at any time to change the requirements of the Purchase Order and these Terms and Conditions in writing, and if such change causes an increase or decrease in price or delivery of the Goods or Services, an equitable written adjustment shall be made. Any price changes must be agreed to in writing at least 60 days prior to becoming effective. Any such change, modification, change order, or constructive change must be reasonable for the completion of the Services.

14. **License.** To the extent that the Supplier or third parties retain ownership rights in materials delivered with the Goods, or upon which any work product is based, the Supplier hereby grants to FMPA an irrevocable, worldwide, non-exclusive, royalty-free right and license to make, have made, modify, use, distribute, publicly perform or display, sell, offer to sell, and import such materials. Supplier hereby warrants that it owns or has acquired rights in all such intellectual property necessary to grant the licenses and intellectual property rights set forth in this provision.

15. **Liens.** As a governmental legal entity subject to Florida law, FMPA's property (real and personal) is not subject to lien or other security interests. The Supplier hereby acknowledges the foregoing and covenants to not attempt to nor permit the attempt to impose or attach a lien on FMPA's property by the Supplier associated with the Goods and Services purchased by FMPA under the Purchase Order.

16. **Indemnity.** (a) The Supplier shall defend, indemnify, and hold FMPA and its members, officers, directors, employees, agents, successors, and assigns harmless from and against any and all claims, suits, actions, liabilities, losses, costs, reasonable attorneys' fees and costs, expenses, judgments or damages, whether ordinary, special, or consequential arising directly or indirectly from or in connection with (1) the acts, negligence, omissions, or willful misconduct of Supplier; (2) the Goods or Services supplied; (3) a breach of any of Supplier's warranties or any other term or condition of the Purchase Order, including these Terms and Conditions; (4) the Supplier's negligent, unauthorized, or wrongful acts or omissions with regard to the transportation, use, handling, disposal, processing, or installation of hazardous materials; (5) a claim that any of the Goods and Services furnished by the Supplier infringe upon or misappropriate any patent, copyright, trademark, trade secret, or other intellectual property interest of another; (6) a claim of any lien, security interest, or other encumbrance made by a third party that is related to the Purchase Order; and (7) Supplier's violation of federal or state law, regulation, rule, permit, statute, or ordinance.

(b) It is understood and agreed that each party has an affirmative duty to promptly notify the other party in writing of any claims, demands, or suits brought or made against such notifying party with respect to its performance pursuant to the Purchase Order. FMPA may permit the Supplier, in FMPA's discretion, to settle any claim or suite indemnified by the Supplier hereunder, with

the written approval of FMPA and agrees, to the extent permissible by law, that it may permit the complete control of such defense by the Supplier. Any settlement offer negotiated by the Supplier pursuant to this indemnity provision shall, prior to being submitted to an adverse third party, be (1) a *bona fide* offer of settlement that releases with prejudice all claims and liabilities against FMPA, its members, directors, officers, agents, representatives, consultants, independent contractors, and employees, arising out of the claim or suit for which indemnity is sought; (2) made in good faith by the Supplier; (3) discussed, reviewed, and approved in writing by FMPA; and (4) not include any terms or conditions which impose on FMPA, its members, directors, officers, agents, representatives, consultants, independent contractors, and employees any obligation, legal or otherwise, to perform or refrain from any act which would have a legal, financial, or operational impact to FMPA and which would not be reimbursed by the Supplier as part of the proposed settlement.

(c) To the extent permissible by law, and deemed appropriate in the sole discretion of FMPA, FMPA its members, directors, officers, agents, representatives, consultants, independent contractors, and employees shall cooperate fully with the Supplier and its legal representatives in the investigation and defense of any claims or suits covered by this indemnity provision.

17. **Insurance.** (a) If required by FMPA and expressly stated in the Purchase Order, Supplier shall carry and maintain insurance coverage satisfactory to FMPA to cover its obligations in the Purchase Order, including without limitation, the following insurance with the respective minimum limits per occurrence:

- (1) Commercial General Liability - \$2,000,000;
- (2) Workers' Compensation - statutory;
- (3) Business Automobile Liability - \$1,000,000;
- (4) Product Liability Coverage - as set forth in the Purchase Order, if any; and
- (5) Pollution Insurance and Builder's All Risk - as set forth in the Purchase Order, if any.

(b) Supplier shall provide FMPA with a certificate evidencing compliance with the above requirements of subsection (6) and naming FMPA and the other entities specified in the Purchase Order (which in any event shall include the owner or any FMPA joint- owner(s) of the facility for or at which the Supplier is providing the Goods and Services) as an additional insured, except on the worker's compensation policy. Supplier shall provide FMPA with no less than 10 days prior notice of cancellation of any such insurance. At no time shall Supplier be without insurance in the above amounts during any performance related to the Purchase Order, which is deemed to be a material default under these Terms and Conditions.

18. **Termination.** (a) FMPA may, at any time, terminate the Purchase Order, in whole or in part, without cause, upon written notice to the Supplier. Upon any such termination the Supplier shall, to the extent specified by FMPA, stop all work on the Purchase order, and cause its suppliers and subcontractors to stop work. The Supplier's charges for any such termination of the Purchase Order are limited to actual non-recoverable costs incurred by the Supplier that the Supplier can demonstrate were properly incurred prior to the date of termination. In no event shall FMPA be obligated to reimburse Supplier for Good(s), inventory, or Services in excess of those required to meet FMPA's delivery schedule for binding forecasts. In no event shall such reimbursement include anticipated profits or revenue or other economic loss for undelivered Good(s) or unperformed Services.

(b) FMPA may delay the Supplier's performance for any reason upon written notice to the Supplier. If FMPA delays performance for more than three months and either FMPA or the Supplier elects to terminate the Purchase Order because of such delay, the Supplier's sole remedy shall be reimbursement for actual non-recoverable costs incurred by the Supplier that the Supplier can demonstrate were properly incurred prior to the date of termination. In no event will FMPA reimburse Supplier for Good(s), inventory, or Services in excess of those required to meet FMPA's delivery schedule for binding forecasts. In no event shall such reimbursement include anticipated profits or revenue or other economic loss for undelivered Good(s) or unperformed Services.

(c) FMPA may terminate this PO, in whole or in part, if Supplier: (1) is in material default of the Purchase Order; (2) fails to make delivery of the Good(s) or perform the Services within the time specified in the Purchase Order; (3) fails to replace or correct defective Goods and Services in accordance with the provisions of the Purchase Order, including these Terms and Conditions; (4) fails to perform any other provision of the Purchase Order or so fails to make progress as to endanger performance in accordance with its terms; or (5) becomes insolvent, files or has filed against it a petition in bankruptcy, or makes an assignment for the benefit of creditors. In the event of cancellation pursuant to this clause, FMPA may procure similar Goods or Services elsewhere by purchase order or otherwise and the Supplier shall be liable to FMPA for all of its excess costs.

(d) Any such termination shall not relieve the Supplier from any liability under the Purchase Order.

19. **Limitation of FMPA's Liability.** In no event shall FMPA be liable for special, incidental, or consequential damages or lost profits of the Supplier. Any action resulting from any breach on the part of FMPA as to the Good(s) delivered or Services performed under the Purchase Order must be commenced within one (1) year after such breach.

20. **Remedies.** FMPA's remedies are cumulative, and remedies herein specified do not exclude any remedies allowed by law or in equity. Waiver of any breach shall not constitute waiver of any other breach of the same or any other provision.

21. **Compliance with Laws.** Supplier warrants that all Goods and Services will be produced or performed in compliance with all applicable federal, state, and local laws, rules, and regulations, including without limitation:

- (1) the Environmental Protection Agency Toxic Substances Control Act's reporting regulation and any and all pre-manufacturing reporting required with regard to the Good(s), or any of the Good(s)' constituent ingredients, covered by the Purchase Order;

- (2) applicable state hazardous materials regulations in shipping the Good(s) covered by the Purchase Order;
- (3) the Occupational Safety and Health Act of 1970;
- (4) the Resource Conservation and Recovery Act, and the Immigration Reform and Control Act of 1986 (“IRCA”) and the IRCA’s implementing regulations as they pertain to any and all employees employed by Supplier in connection with performance hereunder.

Any provisions required thereby to be included herein shall be deemed to be incorporated by reference.

22. **Governing Law.** The validity and interpretation of the Purchase Order and the rights and obligations of the parties shall be governed and construed in accordance with the laws of the State of Florida without regard for any conflicts of law provisions that might cause the law of other jurisdictions to apply. All controversies, claims, or disputes arising out of or related to the Purchase Order or any agreement, instrument, or document contemplated by the Purchase Order must be brought exclusively in the County or Circuit Court for Leon County, Florida, or the United States District Court sitting in Tallahassee, Florida, as appropriate. The parties consent to and agree to submit to the personal jurisdiction of such courts. Each of the parties hereby waives, and agrees not to assert in any such controversy, claim, or dispute, to the fullest extent permitted by applicable law, any argument or claim that: (1) such party is not personally subject to the jurisdiction of such courts, (2) such party and such party’s property is immune from any legal process issued by such courts, or (3) any litigation or other process commenced in such courts is brought in an inconvenient forum.

23. **Independent Contractor.** In all matters relating to the Purchase Order, the Supplier is and will be deemed to be acting as an independent contractor of FMPA. The Supplier is not an employee, agent, partner, or representative of FMPA. The Supplier shall conduct its business under its own name as an independent contractor, and is hereby expressly prohibited from holding itself out as an employee, agent, partner, or representative of FMPA. It is agreed that any person employed by the Supplier to perform its obligations under the Purchase order is not and will not be deemed to be an employee of FMPA, and Supplier and Supplier’s employees, suppliers, subcontractors, agents, or representatives shall not be, nor represent themselves to be, officers, employees, agents, or representatives of FMPA and shall not bind, nor attempt to bind, FMPA to any agreement, liability, or obligation of any nature. Supplier agrees to pay, and hereby accepts full and exclusive liability for the payment of, any and all contributions and taxes for unemployment compensation or disability insurance or old age pension or annuities, and all similar provisions now or hereafter imposed by any federal or state governmental authority, which are imposed with respect to or measured by wages, salaries, or other compensation paid by the Supplier to persons employed by the Supplier; and the Supplier further agrees to indemnify and save FMPA harmless against any and all such liability or claims thereof.

24. **Force Majeure.** Neither party shall be liable for failure to perform under the Purchase Order if such failure to perform arises out of causes beyond the reasonable control and without the fault or negligence of the non- performing party (“**Force Majeure**”). Such causes may include, but are not limited to, acts of God or public enemy, wars, riots, fires, floods, explosions, epidemics, quarantine restrictions, freight embargoes, water shortages, and unusually severe weather. However, “Force Majeure” SHALL NOT MEAN NOR INCLUDE the negligence, gross negligence, or willful malfeasance of a party or any of its directors, officers, agents, representatives, independent contractors, or employees during the performance of the Purchase Order. This provision shall become effective only if the party failing to perform notifies the other party orally within 24 hours and provides written confirmation within two business days of the extent and nature of the problem, limits delay in performance to that required by the event, and takes all reasonable steps to minimize delays. This provision shall not be effective unless the failure to perform is beyond the reasonable control of the non-performing party. It is understood and agreed that FMPA shall not be liable to any other party for any damage occasioned by Force Majeure.

25. **Assignability and Subcontracting.** The Purchase Order is binding upon and inures to the benefit of the parties and their respective successors and permitted assigns. Notwithstanding the foregoing, neither the Purchase Order nor any interest in the Purchase Order may be assigned, delegated, or otherwise transferred by the Supplier except upon the prior written consent of FMPA, and any assignment or transfer without such consent shall be void and of no effect. The Supplier shall not appoint any subcontractor or non-employee to carry out its obligations under the Purchase Order without the prior written consent of FMPA. In any event, even with FMPA’s consent, the Supplier shall remain liable for the performance of all such obligations and shall ensure that any permitted subcontractor or non-employee reads and understands the terms of the Purchase Order and that the Goods and Services are provided in accordance with all requirements. FMPA may assign its rights or obligations under the Purchase Order to any FMPA affiliate or successor without Supplier’s consent.

26. **Survivorship.** All provisions, representations, and warranties contained in the Purchase Order, including in these Terms and Conditions, which by their nature are required or intended to be observed or performed after termination or completion of

the Purchase Order are hereby intended by the parties to survive its termination or completion.

27. **Notices.** (a) Each party giving or making any notice, request, demand, or other communication (each, a “notice”) pursuant to this agreement shall give the notice in writing, unless otherwise expressly permitted in this agreement, and shall use one of the following methods of delivery, each of which for purposes of this agreement is a writing: (1) personal delivery; (2) registered or certified mail, in each case, return receipt requested and postage prepaid; (3) nationally recognized overnight courier, with all fees prepaid; (4) electronic mail with electronic confirmation of the addressee opening the electronic mail (*i.e.*, read receipt) or (5) facsimile.

(b) Each party giving a notice shall address the notice to the appropriate person at the receiving party (the “Addressee”) at the address listed below or to another Addressee or at another address designated by a party in a notice pursuant to this section 27:

If to FMPA: Florida Municipal Power Agency  
8553 Commodity Circle  
Orlando, Florida 32819-9002  
Attention: Chief Operating Officer  
Facsimile No.: (407) 355-5794  
Email: [ken.rutter@fmpa.com](mailto:ken.rutter@fmpa.com)  
[david.schumann@fmpa.com](mailto:david.schumann@fmpa.com)  
Telephone No. (for verification purposes only): (407) 355-7767

With a required copy to: Florida Municipal Power Agency  
Office of the General Counsel  
2061-2 Delta Way (32303-4240)  
Post Office Box 3209  
Tallahassee, Florida 32315-3209  
Attention: Purchase Order Terms and Conditions  
Facsimile No.: (850) 297-2014  
Email: [jody.lamar.finklea@fmpa.com](mailto:jody.lamar.finklea@fmpa.com)  
Telephone No. (for verification purposes only): (850) 297-2011

If to the Supplier: As provided in the Purchase order.

(c) Except as provided else-where in this agreement, a notice is effective only if the party giving or making the notice has complied with subsections (a) and (b) and if the Addressee has received the notice. A notice is deemed to have been received as follows:

- (1) If a notice is delivered in person, or sent by registered or certified mail, or nationally recognized overnight courier, upon receipt as indicated by the date on the signed receipt.
- (2) If a notice is sent by facsimile, upon receipt by the party giving or making the notice of an acknowledgment or transmission report generated by the machine from which the facsimile was sent indicating that the facsimile was sent in its entirety to the Addressee’s facsimile number.
- (3) If the Addressee rejects or otherwise refuses to accept the notice, or if the notice cannot be delivered because of a change of address for which no notice was given, then upon the rejection, refusal, or inability to deliver.
- (4) Despite the other clauses in this subsection (c), if any notice is received after 5:00 p.m. on a business day where the Addressee is located, or on a day that is not a business day where the addressee is located, then the notice is deemed received at 9:00 a.m. on the next business day where the Addressee is located.

28. **Public Records.** All documents submitted and received by FMPA may become public records and FMPA shall treat them as subject to the Florida Public Records Law, including chapter 119, Florida Statutes.



29. **Enforcement.** In the event that either party is required to enforce the Purchase Order by court proceedings or otherwise, the prevailing party shall be entitled to recover all fees and costs incurred, including reasonable attorney's fees and costs, for cost of investigation, trial, alternative dispute resolution, cost of settlement, and/or appellate proceedings.

30. **Interpretation.** Each reference to the Purchase Order in these Terms and Conditions always includes these Terms and Conditions as a material part of the Purchase Order, whether or not the language "including these Terms and Conditions" or similar language is provided.

31. **General Provisions.** (a) In the event that any of the terms, covenants or conditions of the Purchase Order, or the application of any such term, covenant or condition, shall be held invalid as to any person or circumstance by any court having jurisdiction under the circumstances, the remainder of the Purchase Order and the application of its terms, covenants or conditions to such persons or circumstances shall not be affected by that invalidity.

(b) Except as provided in section 13, no amendment to the Purchase Order is valid unless mutually agreed and signed by both parties.

(c) The Purchase Order reflects the negotiated agreement of the parties. Accordingly, the Purchase Order, including these Terms and Conditions, is to be construed as if both parties jointly prepared it, and no presumption shall be made as to whether one party or the other prepared the Purchase Order for purposes of interpreting or construing any of the provisions of the Purchase Order or otherwise.

(d) The headings provided in the Purchase Order, including these Terms and Conditions, are for convenience only and do not affect its meaning.

(e) The Purchase Order may be executed in counterparts, each of which is deemed to be an original, but all of which together shall constitute one and the same instrument.

CONTRACTOR

FLORIDA MUNICIPAL POWER AGENCY

Signature: \_\_\_\_\_

Signature: \_\_\_\_\_

Name: \_\_\_\_\_

Name: \_\_\_\_\_

Title: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

Date: \_\_\_\_\_

## **APPENDIX C**

### **BID FORMS**

**PROPOSAL TO FURNISH AND DELIVER  
TCEC CT EXHAUST SEAL REPLACEMENT  
FOR THE FLORIDA MUNICIPAL POWER AGENCY**

I have carefully examined the RFP, Terms and Conditions, Technical Specifications, Bid Forms, and any other documents accompanying or made a part of this RFP. With full knowledge and understanding of the aforesaid, I agree to abide by all conditions of this bid.

I hereby propose to furnish the materials/services specified in the RFP at the prices quoted in my proposal as indicated in the appropriate spaces on this and the attached sheet BF-2.

I certify that I am duly authorized to submit this proposal; on behalf of the vendor and that the vendor is ready, willing and able to perform if awarded the bid.

Prices quoted shall remain firm and irrevocable for duration of project.

**ADDENDA.** The undersigned bidder acknowledges receipt of the following addenda, which have been considered in preparing this proposal (if applicable).

Number \_\_\_\_\_ Dated \_\_\_\_\_

Number \_\_\_\_\_ Dated \_\_\_\_\_

Respectfully submitted:

Company Name: \_\_\_\_\_

Signature: \_\_\_\_\_

(Authorized Representative)

\_\_\_\_\_  
(Type or Print Name of Signer)

Address: \_\_\_\_\_

E-Mail Address: \_\_\_\_\_

Telephone Number: \_\_\_\_\_

Toll Free Number: \_\_\_\_\_

Date: \_\_\_\_\_

## BID FORM – TCEC CT Exhaust Seal Replacement

BID FORM
<p>Provide a <u>Lump Sum Total Price</u> to furnish and deliver a turn-key solution as described in the scope of work. Pricing must include materials &amp; work as described in Appendix A.</p> <p><b>TOTAL PRICE</b> _____</p>

Please also provide a time & materials rate for the project.
<b>T&amp;M Rates</b>
Please include a T&M Rate Sheet for all work offered by your company.

**FMPA RFP 2025-209  
Intent-to-Bid Form**

**Form Due Date: July 14, 2025**

If you intend to submit a response to this Request for Proposal, we ask that you complete this form as soon as possible and e-mail it to [sharon.samuels@fmpa.com](mailto:sharon.samuels@fmpa.com). You may also mail a copy of this form to the following address:

Sharon Samuels  
Florida Municipal Power Agency  
8553 Commodity Circle  
Orlando, Florida 32819

**If you identify yourself as a potential respondent, FMPA will be able to notify you of any RFP changes or revisions and forward to you any addenda to the RFP.**

**Please note:**

Filing an Intent-to-Bid form is voluntary: It is NOT required by FMPA in order for you to submit a response.

Filing an Intent-to-Bid form does not commit you to responding.

Filing an Intent-to-Bid form is **required** if you submit specific questions concerning this RFP.

**----- Intent-to-Bid -----**

RFP 2025-209 – TCEC CT Exhaust Seal Replacement

Name of Company:

Address:

Name of Contact Person:

E-Mail Address:

Phone:

## **DISPUTE DISCLOSURE**

**Answer the following questions by placing an "X" in the appropriate "YES" or "NO" box. If you answer "YES", please explain in the space provided, or via attachment.**

Has your firm, or any of its officers, received a reprimand of any nature or been suspended by the Department of Professional Regulation or any other regulatory agency or professional association within the last five (5) years?

YES ☐

NO ☐

Has your firm, or any member of your firm, been declared in default, terminated or removed from a contract or job related to the services your firm provides in the regular course of business within the last five (5) years?

YES ☐

NO ☐

Has your firm had filed against it or filed any requests for equitable adjustment, contract claims or litigation in the past five (5) years that is related to the services your firm provides in the regular course of business?

YES ☐

NO ☐

If yes, state the nature of the request for equitable adjustment, contract claim or litigation, a brief description of the case, the outcome or status of suit and the monetary amounts or extended contract time involved.

I hereby certify that all statements made are true and agree and understand that any misstatement or misrepresentation or falsification of facts shall be cause for forfeiture of rights for further consideration of this project:

***Project: FMPA RFP# 2025-209***

---

**Company or Firm**

---

**Date**

---

**Authorized Signature**

---

**Officer Title**

---

**Printed or Typed Name**

# **AFFIDAVIT OF COMPLIANCE**

FMPA RFP 2025-209

\_\_\_\_\_ We DO NOT take exception to any items included in the RFP.

\_\_\_\_\_ We TAKE exception as follows:

---

---

---

---

---

---

Company Name:

---

By:

---

(Authorized Person's Signature)

---

(Print or type name and title of signer)

Company Address: \_\_\_\_\_

Telephone Number: \_\_\_\_\_

Toll Free Number: \_\_\_\_\_

Fax Number: \_\_\_\_\_

Date: \_\_\_\_\_

## HUMAN TRAFFICKING AFFIDAVIT

Pursuant to Section 787.06 Subsection (13), FLORIDA STATUTES, all bidders should be aware:

“When a contract is executed, renewed, or extended between a nongovernmental entity and a governmental entity, the nongovernmental entity must provide the governmental entity with an affidavit signed by an officer or a representative of the nongovernmental entity under penalty of perjury attesting that the nongovernmental entity does not use coercion for labor or services as defined in this section.

\_\_\_\_\_ (Company) does not use  
coercion for labor or services, as those terms are defined in Florida Statute 787.06.

Company Name:

\_\_\_\_\_

By:

\_\_\_\_\_

(Authorized Person's Signature)

\_\_\_\_\_

(Print or type name and title of signer)

Company Address: \_\_\_\_\_

Telephone Number: \_\_\_\_\_

Date: \_\_\_\_\_



# DRUG-FREE WORKPLACE COMPLIANCE FORM

Preference shall be given to businesses with drug-free workplace programs. Pursuant to Section 287.087, Florida Statutes, whenever two or more proposals which are equal with respect to price, quality, and service are received by the State or by any political subdivision for the procurement of commodities or contractual services, a proposal received from a business that certifies that it has implemented a drug-free workplace program shall be given preference in the award process.

The undersigned proposer in conformity with Florida Statute 287.087 hereby certifies that \_\_\_\_\_ does:

(Name of business)

1. Publish a statement notifying employees that the unlawful manufacture, distribution, dispensing, possession, or use of a controlled substance is prohibited in the workplace and specifying the actions that will be taken against employees for violations of such prohibition.
2. Inform employees about the dangers of drug abuse in the workplace, the business's policy of maintaining a drug-free workplace, any available drug counseling, rehabilitation, and employee assistance programs, and the penalties that may be imposed upon employees for drug abuse violations.
3. Give each employee engaged in providing the commodities or contractual services that are under proposal a copy of the statement specified in Subsection 1.
4. In the statement specified in Subsection 1, notify the employees that, as a condition of working on the commodities or contractual services that are under proposal, the employee will abide by the terms of the statement and will notify the employer of any conviction of, or plea of guilty or nolo contendere to, any violation of Chapter 893 or of any controlled substance law of the United States or any state, for a violation occurring in the workplace no later than five (5) days after such conviction.
5. Impose a sanction on, or require the satisfactory participation in a drug abuse assistance or rehabilitation program if such is available in the employee's community, by any employee who is so convicted.
6. Make a good faith effort to continue to maintain a drug-free workplace through implementation of this section.

As the person authorized to sign the statement, I certify that the undersigned complies fully with the above requirements.

\_\_\_\_\_  
Signature

\_\_\_\_\_  
Name of Proposer

\_\_\_\_\_  
Date

## STATEMENT OF NO PROPOSAL

Sharon Samuels  
Florida Municipal Power Agency  
8553 Commodity Circle  
Orlando, FL 32819

We, the undersigned, have declined to submit a proposal on your Request for Proposals Number 2025-209, Florida Municipal Power Agency, TCEC Exhaust Seal Replacement - for the following reasons:

- ☐ We do not offer this service/product.
- ☐ Our schedule would not permit us to perform.
- ☐ Unable to meet specifications.
- ☐ Unable to meet bond requirements.
- ☐ Other

We understand that if the Statement of No Proposal letter is not executed and returned, our name may be deleted from the list of qualified proposers of the Florida Municipal Power Agency.

Company Name: \_\_\_\_\_

By: \_\_\_\_\_  
(Authorized Person's Signature)

\_\_\_\_\_  
(Print or type name and title of signer)

Company Address: \_\_\_\_\_

\_\_\_\_\_

Telephone Number: \_\_\_\_\_

Toll Free Number: \_\_\_\_\_

Fax Number: \_\_\_\_\_

Date: \_\_\_\_\_



**Thanks for your interest in servicing FMPSA.**